

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P792736

Luminaire Tested: LER6D45BD010-EC6DR2540509030-6LBDP1H

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P792736
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-4)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D45BD010-EC6DR2540509030-6LBDP1H
Description: 6 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 25° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4381.6 lumens
Efficiency: N/A
Efficacy: 113.2 lumens/watt
Spacing Criteria (0/90/45): 0.42 / 0.42 / 0.45
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 38.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P792736

CATALOG NUMBER: LER6D45BD010-EC6DR2540509030-6LBDP1H

Luminous Intensity Polar Plot

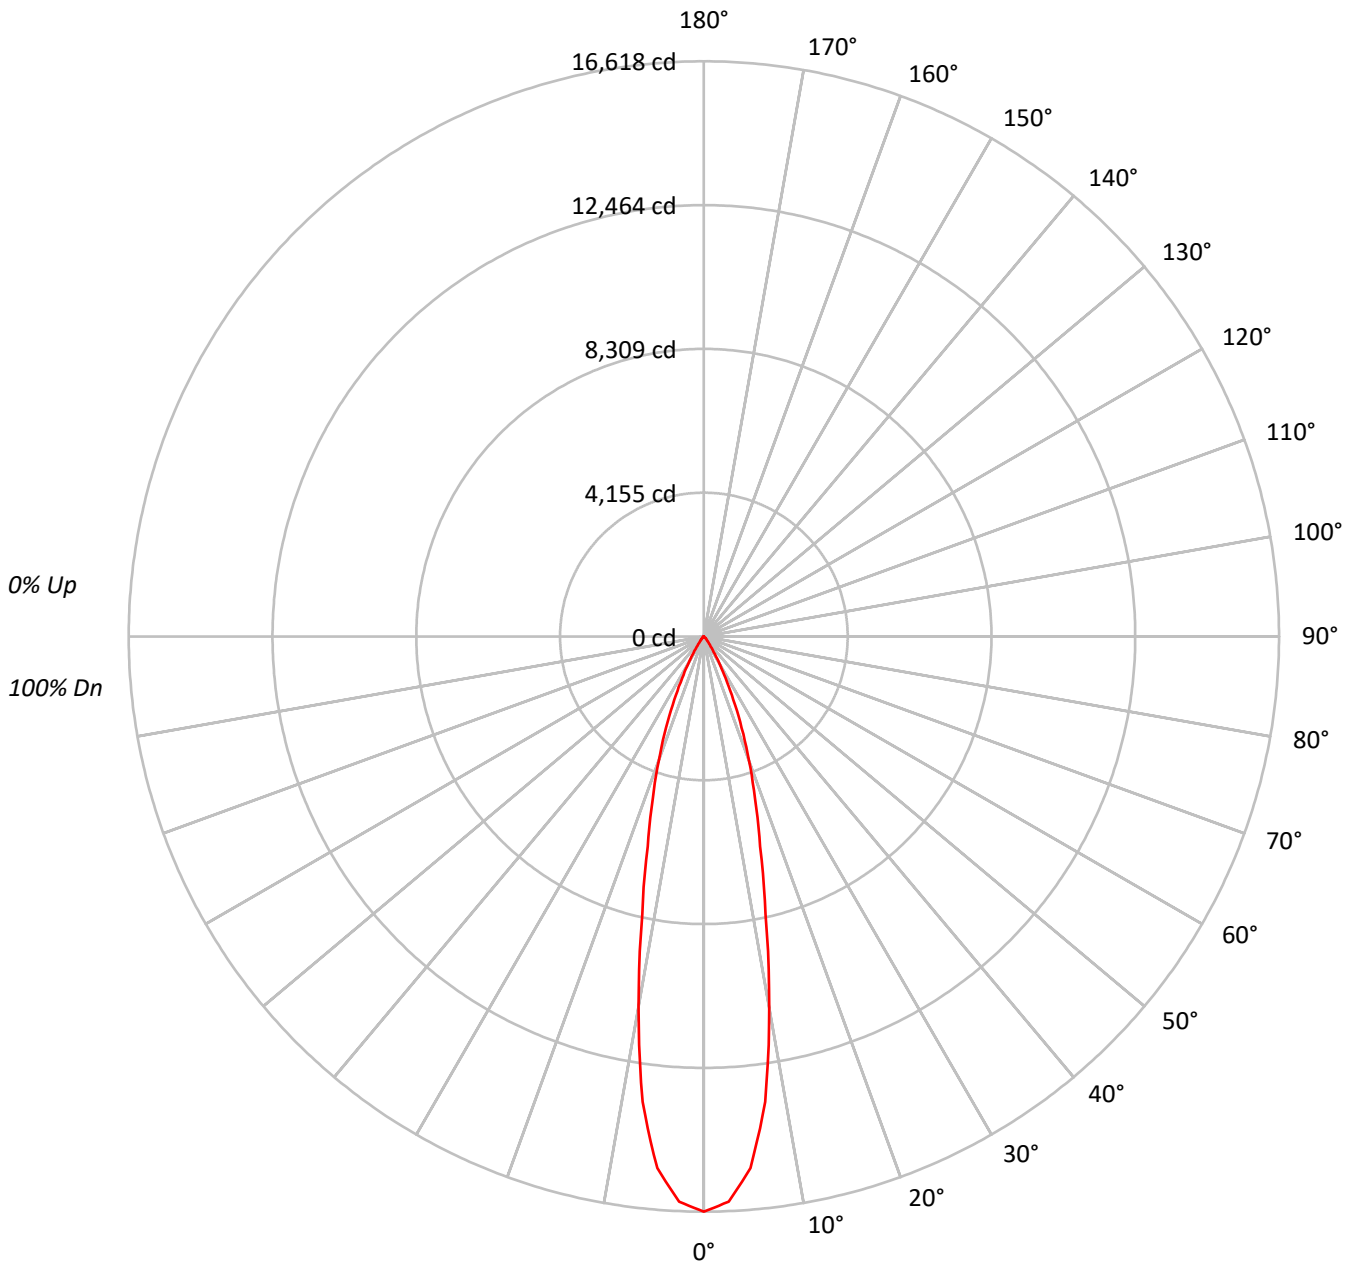



TEST NUMBER: P792736

CATALOG NUMBER: LER6D45BD010-EC6DR2540509030-6LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									20								
RC	80									50									30									10									0								
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0															
RCR	0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100	100	100	100	100	100	100	100																
	1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96	96	96	96	96	96	96	96	96	96	96	96															
	2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92	92	92	92	92	92	92	92	92	92	92	92															
	3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89	89	89	89	89	89	89	89	89	89	89	89															
	4	103	97	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85	85	85	85	85	85	85	85	85	85	85	85															
	5	100	93	89	86	98	93	89	86	91	87	85	89	86	84	88	85	83	82	82	82	82	82	82	82	82	82	82	82	82															
	6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79	79	79	79	79	79	79	79	79	79	79	79															
	7	93	87	82	79	92	86	82	79	85	81	78	84	80	78	83	80	78	77	77	77	77	77	77	77	77	77	77	77	77															
	8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74	74	74	74	74	74	74	74	74	74	74	74															
	9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72	72	72	72	72	72	72	72	72	72	72	72															
	10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69	69	69	69	69	69	69	69	69	69	69	69															

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1815717
5°	1691116
10°	1206319
15°	710476
20°	442069
25°	242607
30°	110948
35°	42016
40°	19027
45°	11434
50°	4742
55°	3067
60°	2142
65°	1448
70°	224
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 11434 cd/sqm



TEST NUMBER: P792736

CATALOG NUMBER: LER6D45BD010-EC6DR2540509030-6LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1325.1	30.2
10°-20°	1794.8	41.0
20°-30°	949.8	21.7
30°-40°	234.5	5.4
40°-50°	57.2	1.3
50°-60°	15.1	0.3
60°-70°	5.1	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4069.7	92.9
0°-40°	4304.1	98.2
0°-60°	4376.4	99.9
0°-90°	4381.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4381.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	16618	
5°	15419	###
15°	6281	1795
25°	2012	950
35°	315	234
45°	74	57
55°	16	15
65°	6	5
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P792736

CATALOG NUMBER: LER6D45BD010-EC6DR2540509030-6LBDP1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	16618.2
2.5°	16345.1
5°	15418.9
7.5°	13558.0
10°	10873.0
12.5°	8219.3
15°	6281.0
17.5°	4895.1
20°	3802.0
22.5°	2851.3
25°	2012.4
27.5°	1349.5
30°	879.4
32.5°	535.1
35°	315.0
37.5°	192.8
40°	133.4
42.5°	102.0
45°	74.0
47.5°	44.7
50°	27.9
52.5°	20.3
55°	16.1
57.5°	12.6
60°	9.8
62.5°	7.7
65°	5.6
67.5°	2.1
70°	0.7
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)