

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P792981

Luminaire Tested: LER6D45BD010-EC6DR5040509030-6LBS1LI

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P792981  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-44)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D45BD010-EC6DR5040509030-6LBS1LI  
Description: 6 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 50° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 5622.4 lumens  
Efficiency: N/A  
Efficacy: 145.3 lumens/watt  
Spacing Criteria (0/90/45): 0.8 / 0.8 / 0.73  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct


Input Watts (W): 38.7  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



Downlight

TEST NUMBER: P792981  
CATALOG NUMBER: LER6D45BD010-EC6DR5040509030-6LBS1LI

### Luminous Intensity Polar Plot

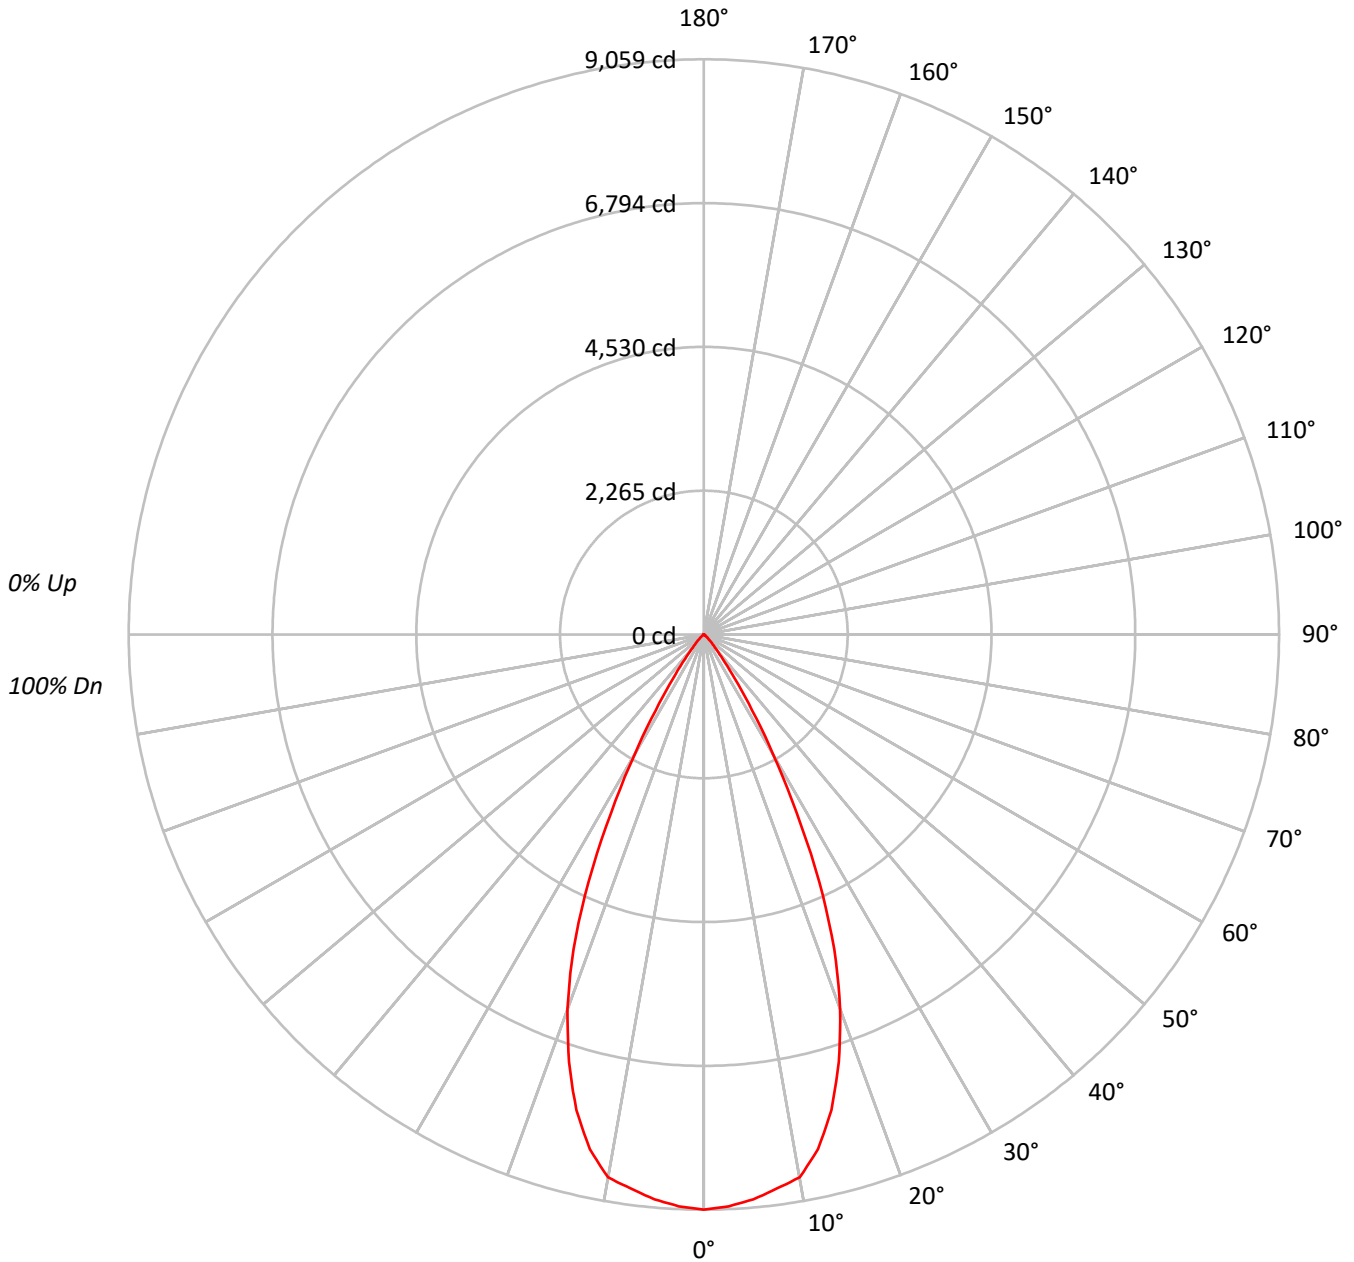



TEST NUMBER: P792981

CATALOG NUMBER: LER6D45BD010-EC6DR5040509030-6LBS1LI

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	114	112	109	107	112	110	108	106	106	104	102	102	101	99	98	97	97	95																			
2	109	105	101	98	107	103	100	97	100	98	95	97	95	93	95	93	91	90																			
3	105	99	95	91	103	98	94	90	95	92	89	93	90	88	91	88	86	85																			
4	100	94	89	85	99	93	88	85	90	87	84	89	85	83	87	84	82	80																			
5	96	89	84	80	95	88	83	79	86	82	79	85	81	78	83	80	77	76																			
6	92	84	79	75	91	83	79	75	82	78	74	81	77	74	79	76	74	72																			
7	88	80	75	71	87	79	74	71	78	74	71	77	73	70	76	73	70	69																			
8	85	76	71	67	84	76	71	67	75	70	67	74	70	67	73	69	66	65																			
9	81	73	68	64	80	72	67	64	71	67	64	71	67	64	70	66	63	62																			
10	78	70	64	61	77	69	64	61	68	64	61	68	64	61	67	63	60	59																			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	989804
5°	979426
10°	963302
15°	877162
20°	729891
25°	518113
30°	274241
35°	111761
40°	41505
45°	19006
50°	7785
55°	4076
60°	2010
65°	595
70°	0
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 19006 cd/sqm



TEST NUMBER: P792981

CATALOG NUMBER: LER6D45BD010-EC6DR5040509030-6LBS1LI

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	844.1	15.0
10°-20°	2133.1	37.9
20°-30°	1916.1	34.1
30°-40°	599.9	10.7
40°-50°	105.0	1.9
50°-60°	20.9	0.4
60°-70°	3.2	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4893.3	87.0
0°-40°	5493.3	97.7
0°-60°	5619.2	99.9
0°-90°	5622.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5622.4	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	9059	
5°	8930	844
15°	7755	2133
25°	4298	1916
35°	838	600
45°	123	105
55°	21	21
65°	2	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P792981

CATALOG NUMBER: LER6D45BD010-EC6DR5040509030-6LBS1LI

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	9059.1
2.5°	9014.0
5°	8930.0
7.5°	8801.7
10°	8682.6
12.5°	8300.7
15°	7754.6
17.5°	7061.1
20°	6277.4
22.5°	5370.8
25°	4297.7
27.5°	3159.7
30°	2173.7
32.5°	1415.3
35°	837.9
37.5°	481.2
40°	291.0
42.5°	189.4
45°	123.0
47.5°	74.8
50°	45.8
52.5°	31.3
55°	21.4
57.5°	14.5
60°	9.2
62.5°	5.3
65°	2.3
67.5°	0.8
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)