

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P793015

Luminaire Tested: LER6D45BD010-EC6DR5540509027-6LBDP1B

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P793015  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-52)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D45BD010-EC6DR5540509027-6LBDP1B  
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 55° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 3837.7 lumens  
Efficiency: N/A  
Efficacy: 99.2 lumens/watt  
Spacing Criteria (0/90/45): 0.89 / 0.89 / 0.87  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 38.7  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight

TEST NUMBER: P793015

CATALOG NUMBER: LER6D45BD010-EC6DR5540509027-6LBDP1B

### Luminous Intensity Polar Plot

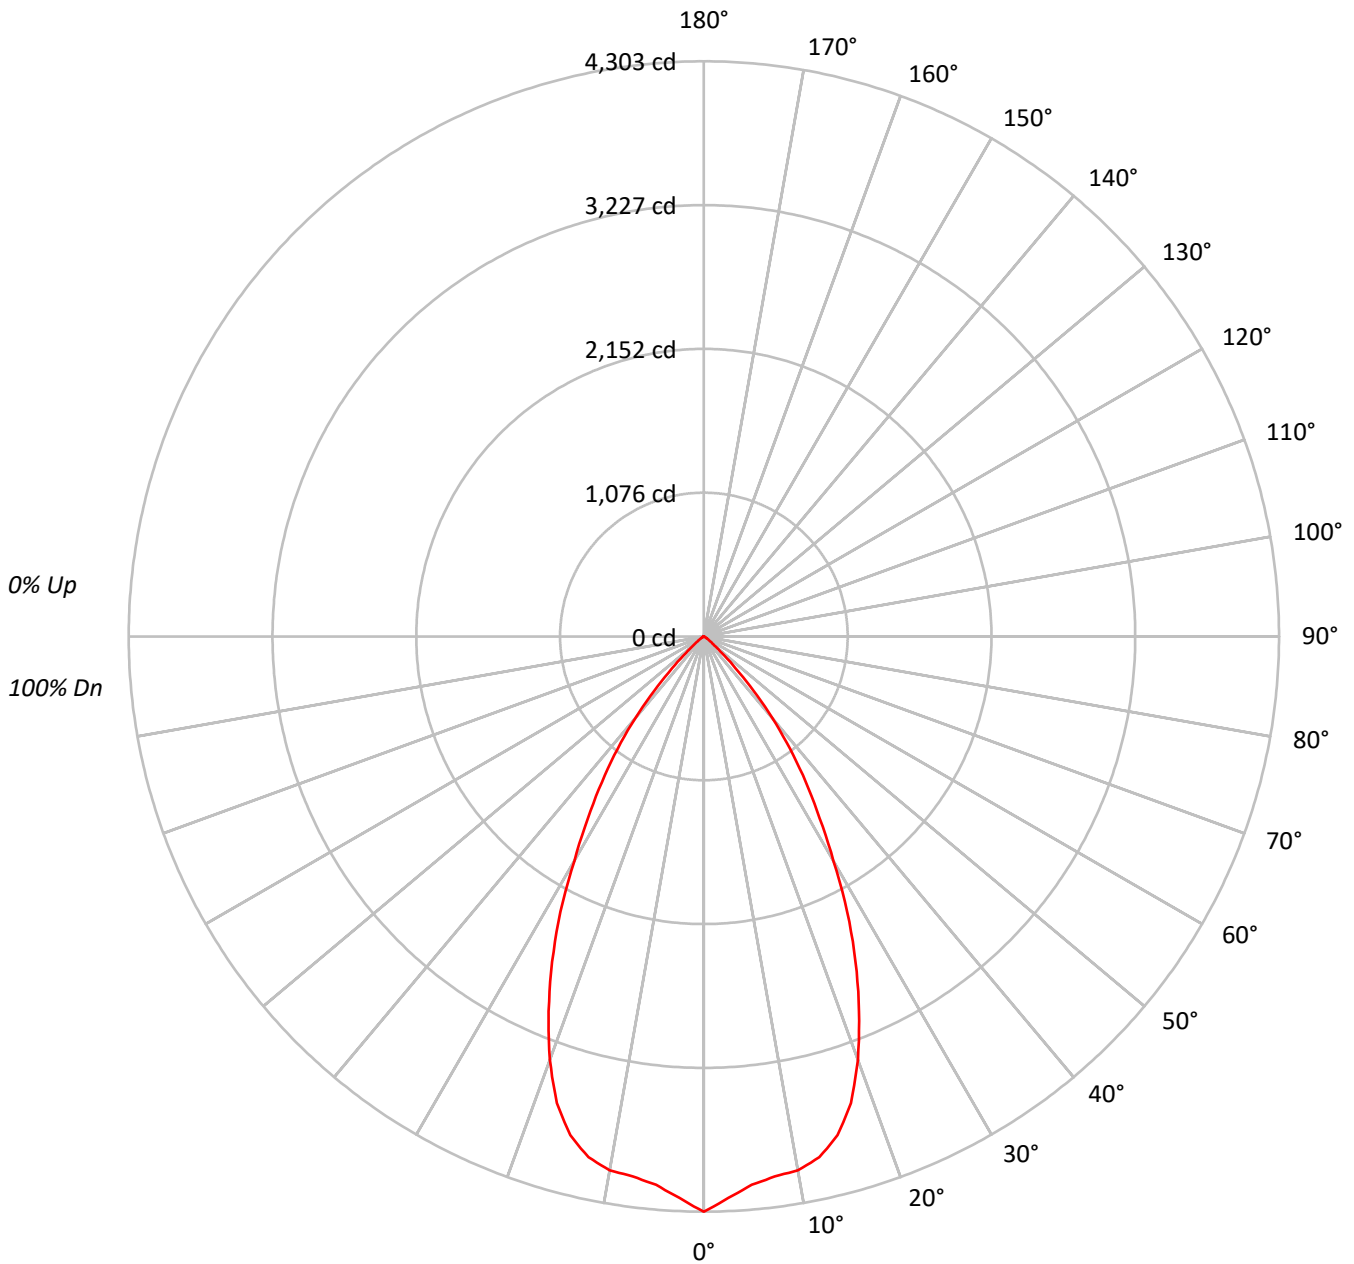



TEST NUMBER: P793015

CATALOG NUMBER: LER6D45BD010-EC6DR5540509027-6LBDP1B

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	94																			
2	108	103	99	96	106	101	98	95	98	95	92	95	93	90	92	90	89	87																			
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81																			
4	97	90	84	80	95	88	83	79	86	82	78	84	81	78	82	79	77	75																			
5	92	84	78	74	91	83	77	73	81	76	73	79	75	72	78	74	71	70																			
6	88	79	73	68	86	78	72	68	76	71	68	75	70	67	74	70	67	65																			
7	83	74	68	64	82	73	67	63	72	67	63	71	66	63	70	65	62	61																			
8	79	69	63	59	78	69	63	59	68	63	59	67	62	59	66	62	58	57																			
9	75	66	60	56	74	65	59	55	64	59	55	63	58	55	62	58	55	54																			
10	72	62	56	52	71	61	56	52	61	56	52	60	55	52	59	55	52	50																			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	470193
5°	451523
10°	449821
15°	436896
20°	391747
25°	323753
30°	244555
35°	177319
40°	113476
45°	51825
50°	16947
55°	7315
60°	3147
65°	414
70°	0
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 51825 cd/sqm



TEST NUMBER: P793015

CATALOG NUMBER: LER6D45BD010-EC6DR5540509027-6LBDP1B

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	391.7	10.2
10°-20°	1069.1	27.9
20°-30°	1218.4	31.7
30°-40°	829.4	21.6
40°-50°	285.8	7.4
50°-60°	39.5	1.0
60°-70°	3.8	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2679.2	69.8
0°-40°	3508.6	91.4
0°-60°	3833.9	99.9
0°-90°	3837.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3837.7	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	4303	
5°	4117	392
15°	3862	1069
25°	2686	1218
35°	1329	829
45°	335	286
55°	38	40
65°	2	4
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P793015

CATALOG NUMBER: LER6D45BD010-EC6DR5540509027-6LBDP1B

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	4303.4
2.5°	4204.8
5°	4116.8
7.5°	4073.6
10°	4054.4
12.5°	3990.4
15°	3862.4
17.5°	3659.3
20°	3369.2
22.5°	3034.3
25°	2685.5
27.5°	2322.4
30°	1938.4
32.5°	1613.1
35°	1329.4
37.5°	1059.6
40°	795.6
42.5°	551.4
45°	335.4
47.5°	180.8
50°	99.7
52.5°	59.2
55°	38.4
57.5°	24.5
60°	14.4
62.5°	6.4
65°	1.6
67.5°	0.5
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)