

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P793074

Luminaire Tested: LER6D45BD010-EC6DR6040509030-6LBDP1MW

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P793074
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-57)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D45BD010-EC6DR6040509030-6LBDP1MW
Description: 6 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4453.5 lumens
Efficiency: N/A
Efficacy: 115.1 lumens/watt
Spacing Criteria (0/90/45): 0.91 / 0.91 / 0.83
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 38.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P793074

CATALOG NUMBER: LER6D45BD010-EC6DR6040509030-6LBDP1MW

Luminous Intensity Polar Plot

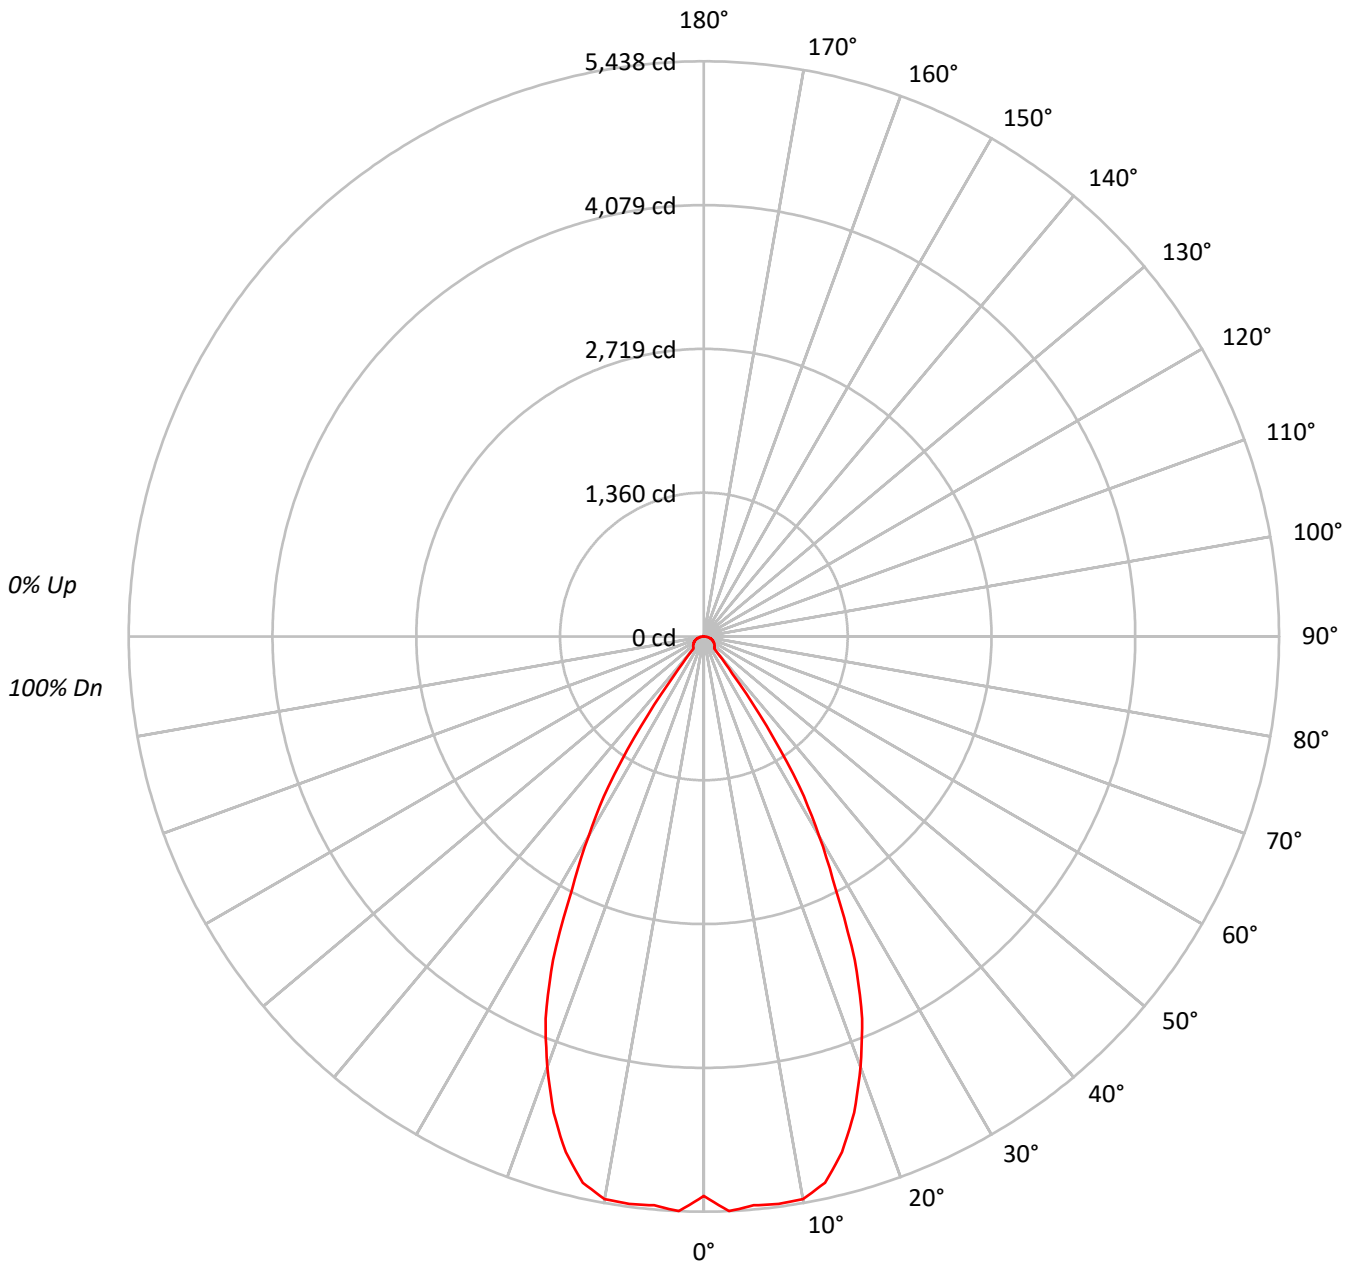



TEST NUMBER: P793074

CATALOG NUMBER: LER6D45BD010-EC6DR6040509030-6LBDP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93			93																
2	107	102	98	95	105	101	97	94	97	94	92	94	92	90	92	90	88	86			86																
3	102	96	90	86	100	94	89	86	91	88	84	89	86	83	87	84	82	80			80																
4	97	89	84	80	95	88	83	79	86	82	78	84	80	77	82	79	76	75			75																
5	92	84	78	74	91	83	78	74	81	77	73	80	76	72	78	75	72	70			70																
6	88	79	73	69	87	78	73	69	77	72	68	75	71	68	74	70	67	66			66																
7	84	75	69	65	83	74	68	64	73	68	64	72	67	64	71	67	63	62			62																
8	80	71	65	61	79	70	65	61	69	64	60	68	64	60	67	63	60	59			59																
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55			55																
10	73	64	58	54	72	63	58	54	62	58	54	62	57	54	61	57	54	53			53																

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	577891
5°	592097
10°	599243
15°	570869
20°	503322
25°	407105
30°	275377
35°	137984
40°	22379
45°	21911
50°	22352
55°	22687
60°	23316
65°	23837
70°	24407
75°	24696
80°	23847
85°	19807

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 75°
 Luminance: 24696 cd/sqm



TEST NUMBER: P793074

CATALOG NUMBER: LER6D45BD010-EC6DR6040509030-6LBDP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	516.0	11.6
10°-20°	1396.0	31.3
20°-30°	1502.0	33.7
30°-40°	652.9	14.7
40°-50°	109.6	2.5
50°-60°	106.6	2.4
60°-70°	91.2	2.0
70°-80°	61.0	1.4
80°-90°	18.2	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3413.9	76.7
0°-40°	4066.7	91.3
0°-60°	4283.0	96.2
0°-90°	4453.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4453.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	5289	
5°	5398	516
15°	5047	1396
25°	3377	1502
35°	1034	653
45°	142	110
55°	119	107
65°	92	91
75°	58	61
85°	16	18
90°	0	



TEST NUMBER: P793074

CATALOG NUMBER: LER6D45BD010-EC6DR6040509030-6LBDP1MW

CANDELA DISTRIBUTION (FULL):

0°	
0°	5289.1
2.5°	5437.7
5°	5398.5
7.5°	5410.9
10°	5401.2
12.5°	5289.7
15°	5046.8
17.5°	4720.5
20°	4328.8
22.5°	3909.7
25°	3376.9
27.5°	2701.0
30°	2182.7
32.5°	1682.3
35°	1034.5
37.5°	442.6
40°	156.9
42.5°	144.5
45°	141.8
47.5°	137.0
50°	131.5
52.5°	125.3
55°	119.1
57.5°	112.9
60°	106.7
62.5°	99.8
65°	92.2
67.5°	84.7
70°	76.4
72.5°	67.5
75°	58.5
77.5°	48.2
80°	37.9
82.5°	26.8
85°	15.8
87.5°	5.5
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)