

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P793096

Luminaire Tested: LER6D45BD010-EC6DR6040509050-6LBDP1H

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P793096
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-57)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D45BD010-EC6DR6040509050-6LBDP1H
Description: 6 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5238.9 lumens
Efficiency: N/A
Efficacy: 135.4 lumens/watt
Spacing Criteria (0/90/45): 0.91 / 0.91 / 0.83
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 38.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P793096

CATALOG NUMBER: LER6D45BD010-EC6DR6040509050-6LBDP1H

Luminous Intensity Polar Plot

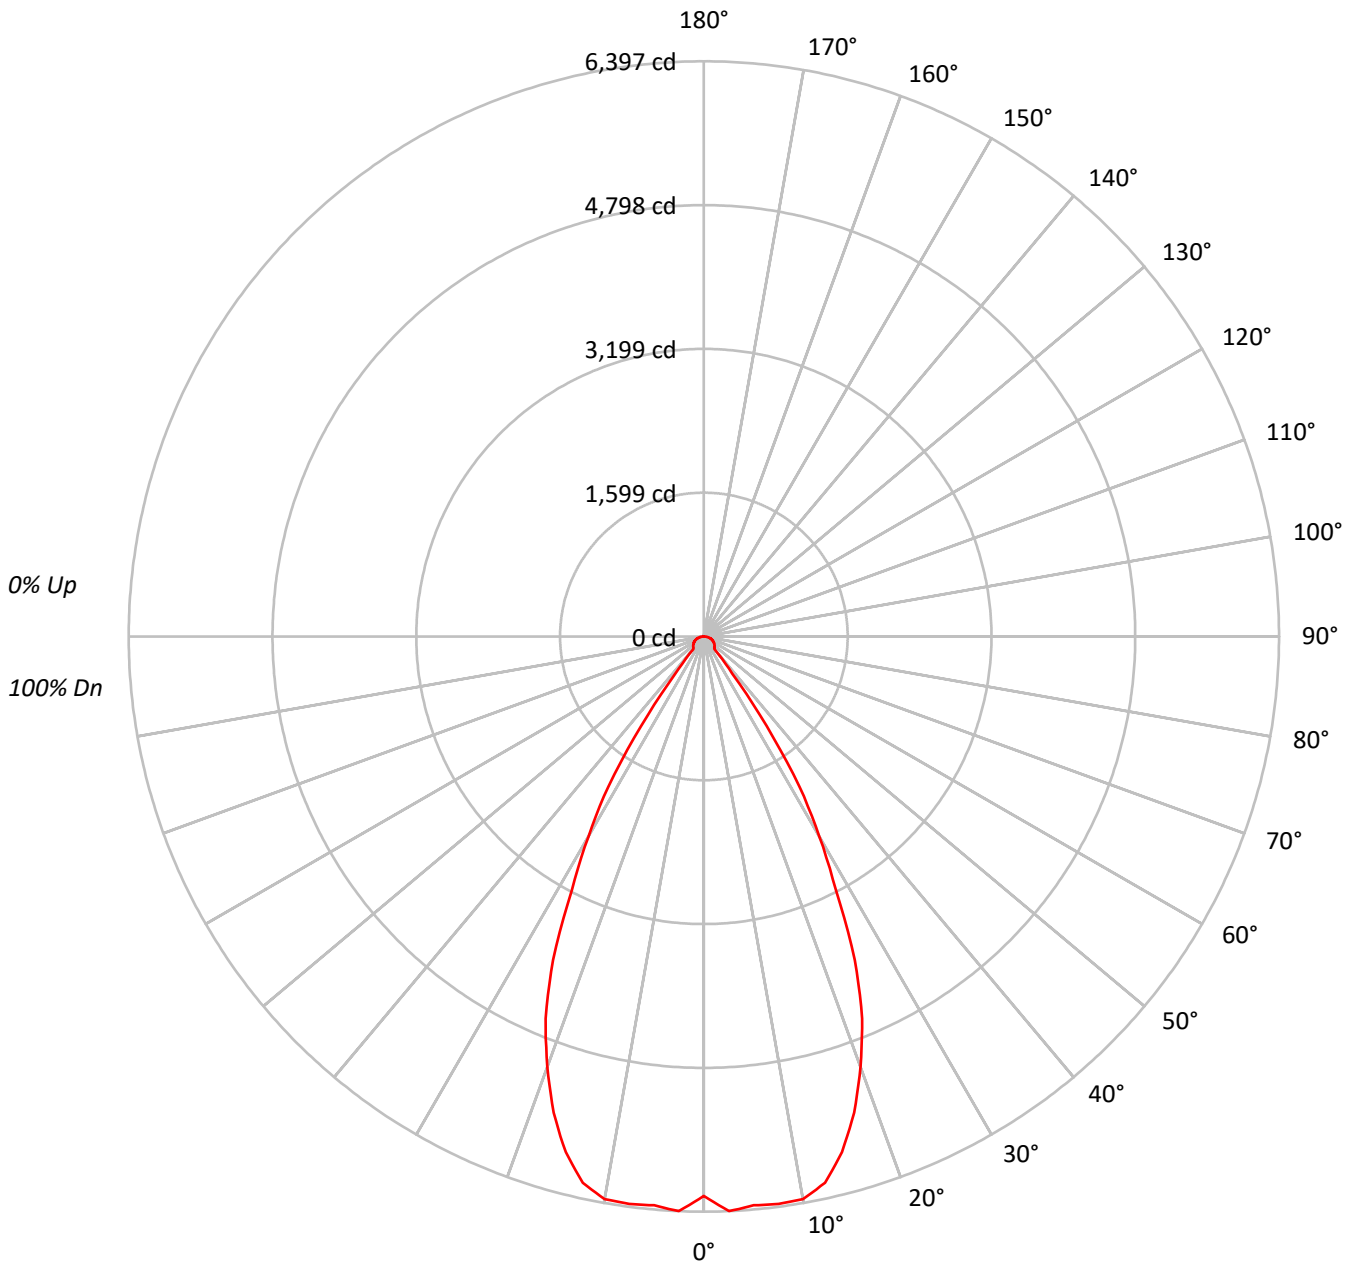



TEST NUMBER: P793096

CATALOG NUMBER: LER6D45BD010-EC6DR6040509050-6LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93			93																
2	107	102	98	95	105	101	97	94	97	94	92	94	92	90	92	90	88	86			86																
3	102	96	90	86	100	94	89	86	91	88	84	89	86	83	87	84	82	80			80																
4	97	89	84	80	95	88	83	79	86	82	78	84	80	77	82	79	76	75			75																
5	92	84	78	74	91	83	78	74	81	77	73	80	76	72	78	75	72	70			70																
6	88	79	73	69	87	78	73	69	77	72	68	75	71	68	74	70	67	66			66																
7	84	75	69	65	83	74	68	64	73	68	64	72	67	64	71	67	63	62			62																
8	80	71	65	61	79	70	65	61	69	64	60	68	64	60	67	63	60	59			59																
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55			55																
10	73	64	58	54	72	63	58	54	62	58	54	62	57	54	61	57	54	53			53																

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	679809
5°	696522
10°	704942
15°	671553
20°	592096
25°	478908
30°	323937
35°	162327
40°	26329
45°	25774
50°	26296
55°	26688
60°	27424
65°	28051
70°	28719
75°	29044
80°	28000
85°	23317

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 75°
 Luminance: 29044 cd/sqm



TEST NUMBER: P793096

CATALOG NUMBER: LER6D45BD010-EC6DR6040509050-6LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	607.0	11.6
10°-20°	1642.2	31.3
20°-30°	1766.8	33.7
30°-40°	768.0	14.7
40°-50°	129.0	2.5
50°-60°	125.4	2.4
60°-70°	107.3	2.0
70°-80°	71.8	1.4
80°-90°	21.5	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4016.0	76.7
0°-40°	4784.0	91.3
0°-60°	5038.4	96.2
0°-90°	5238.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5238.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	6222	
5°	6351	607
15°	5937	1642
25°	3972	1767
35°	1217	768
45°	167	129
55°	140	125
65°	108	107
75°	69	72
85°	19	21
90°	0	



TEST NUMBER: P793096

CATALOG NUMBER: LER6D45BD010-EC6DR6040509050-6LBDP1H

CANDELA DISTRIBUTION (FULL):

0°	
0°	6221.9
2.5°	6396.8
5°	6350.6
7.5°	6365.2
10°	6353.9
12.5°	6222.7
15°	5936.9
17.5°	5553.1
20°	5092.3
22.5°	4599.2
25°	3972.5
27.5°	3177.3
30°	2567.6
32.5°	1979.0
35°	1217.0
37.5°	520.6
40°	184.6
42.5°	170.0
45°	166.8
47.5°	161.1
50°	154.7
52.5°	147.4
55°	140.1
57.5°	132.8
60°	125.5
62.5°	117.4
65°	108.5
67.5°	99.6
70°	89.9
72.5°	79.4
75°	68.8
77.5°	56.7
80°	44.5
82.5°	31.6
85°	18.6
87.5°	6.5
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)