

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P793105

Luminaire Tested: LER6D45BD010-EC6DR6540509024-6LBDP1LI

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P793105
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D45BD010-EC6DR6540509024-6LBDP1LI
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3866.0 lumens
Efficiency: N/A
Efficacy: 99.9 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 38.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P793105

CATALOG NUMBER: LER6D45BD010-EC6DR6540509024-6LBDP1LI

Luminous Intensity Polar Plot

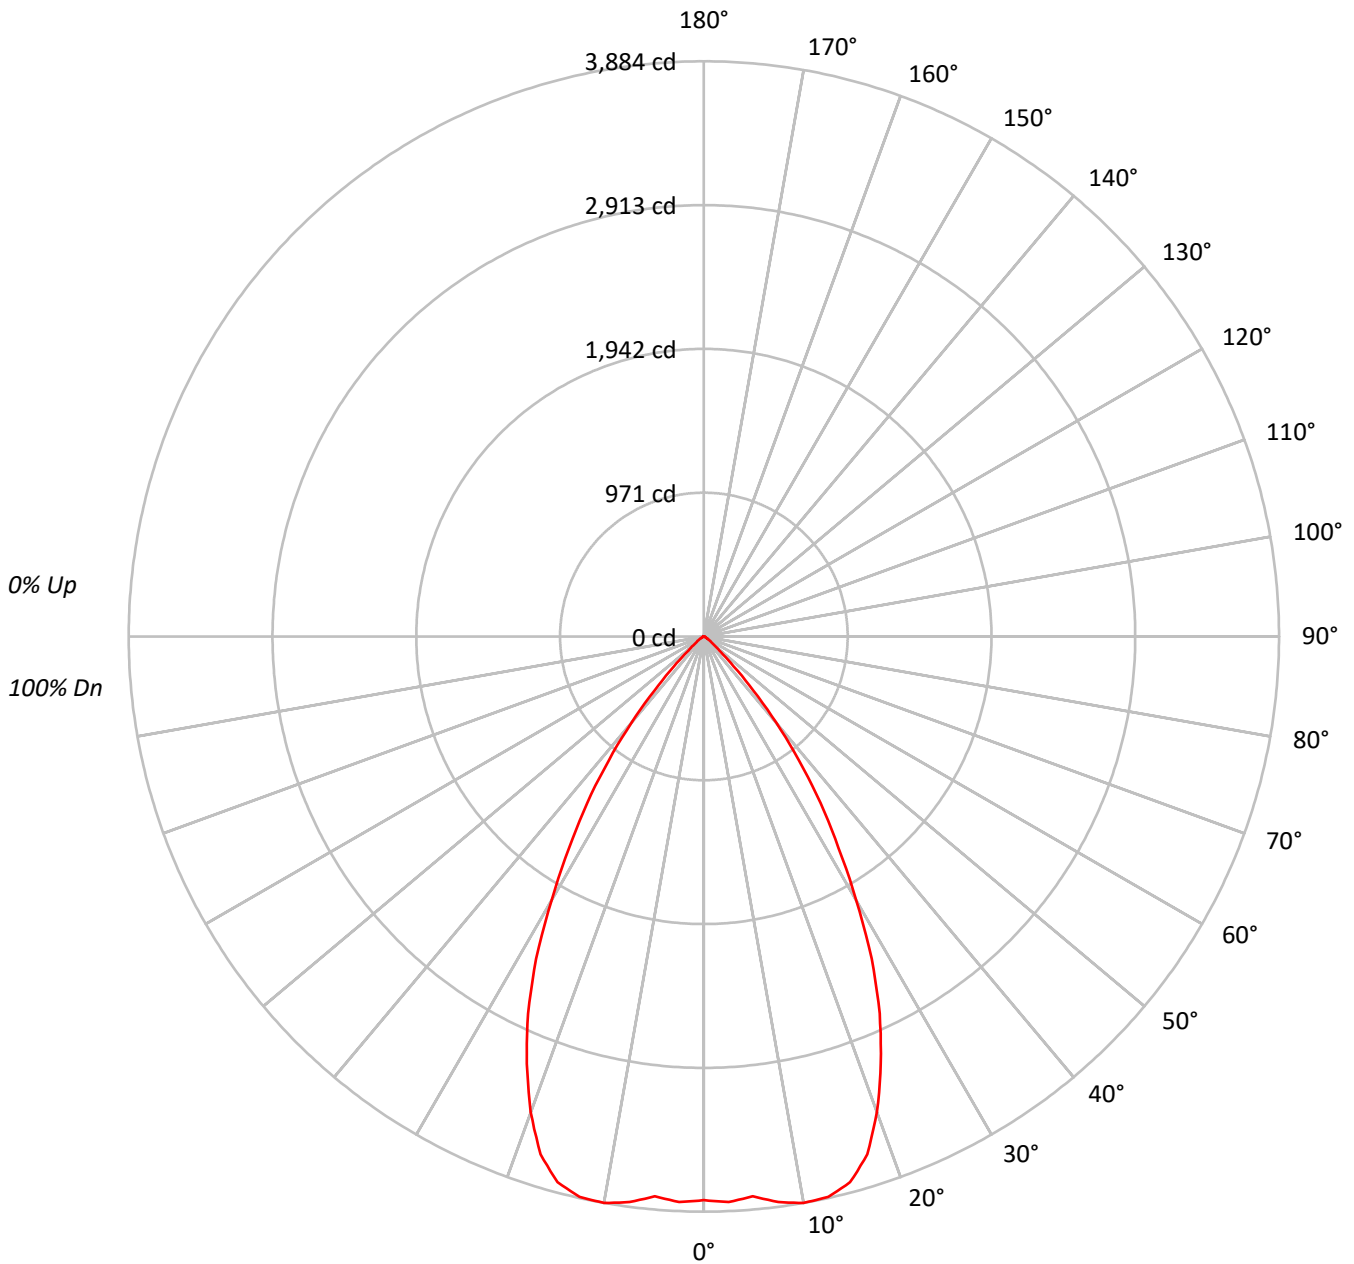



TEST NUMBER: P793105

CATALOG NUMBER: LER6D45BD010-EC6DR6540509024-6LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93			
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87			
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80			
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75			
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69			
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65			
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60			
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57			
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53			
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	415890
5°	416228
10°	430893
15°	431602
20°	397363
25°	338569
30°	259190
35°	183108
40°	108085
45°	43883
50°	15910
55°	8858
60°	5092
65°	2792
70°	2939
75°	2280
80°	2391
85°	2006

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 43883 cd/sqm



TEST NUMBER: P793105

CATALOG NUMBER: LER6D45BD010-EC6DR6540509024-6LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	366.5	9.5
10°-20°	1057.3	27.3
20°-30°	1268.5	32.8
30°-40°	852.5	22.1
40°-50°	255.2	6.6
50°-60°	45.0	1.2
60°-70°	12.8	0.3
70°-80°	6.3	0.2
80°-90°	2.0	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2692.3	69.6
0°-40°	3544.8	91.7
0°-60°	3845.0	99.5
0°-90°	3866.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3866.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3806	
5°	3795	367
15°	3816	1057
25°	2808	1268
35°	1373	852
45°	284	255
55°	46	45
65°	11	13
75°	5	6
85°	2	2
90°	0	



TEST NUMBER: P793105

CATALOG NUMBER: LER6D45BD010-EC6DR6540509024-6LBDP1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	3806.4
2.5°	3822.6
5°	3795.0
7.5°	3852.4
10°	3883.8
12.5°	3876.2
15°	3815.6
17.5°	3667.4
20°	3417.5
22.5°	3123.2
25°	2808.4
27.5°	2453.0
30°	2054.4
32.5°	1693.1
35°	1372.8
37.5°	1056.4
40°	757.8
42.5°	494.9
45°	284.0
47.5°	150.4
50°	93.6
52.5°	64.9
55°	46.5
57.5°	33.5
60°	23.3
62.5°	15.1
65°	10.8
67.5°	9.7
70°	9.2
72.5°	7.0
75°	5.4
77.5°	4.9
80°	3.8
82.5°	2.7
85°	1.6
87.5°	1.1
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)