

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P793183

Luminaire Tested: LER6D45BD010-EC6DR7040509040-6LBDP1B

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P793183
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-73)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D45BD010-EC6DR7040509040-6LBDP1B
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 70° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3046.3 lumens
Efficiency: N/A
Efficacy: 78.7 lumens/watt
Spacing Criteria (0/90/45): 0.88 / 0.88 / 0.82
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 38.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P793183

CATALOG NUMBER: LER6D45BD010-EC6DR7040509040-6LBDP1B

Luminous Intensity Polar Plot

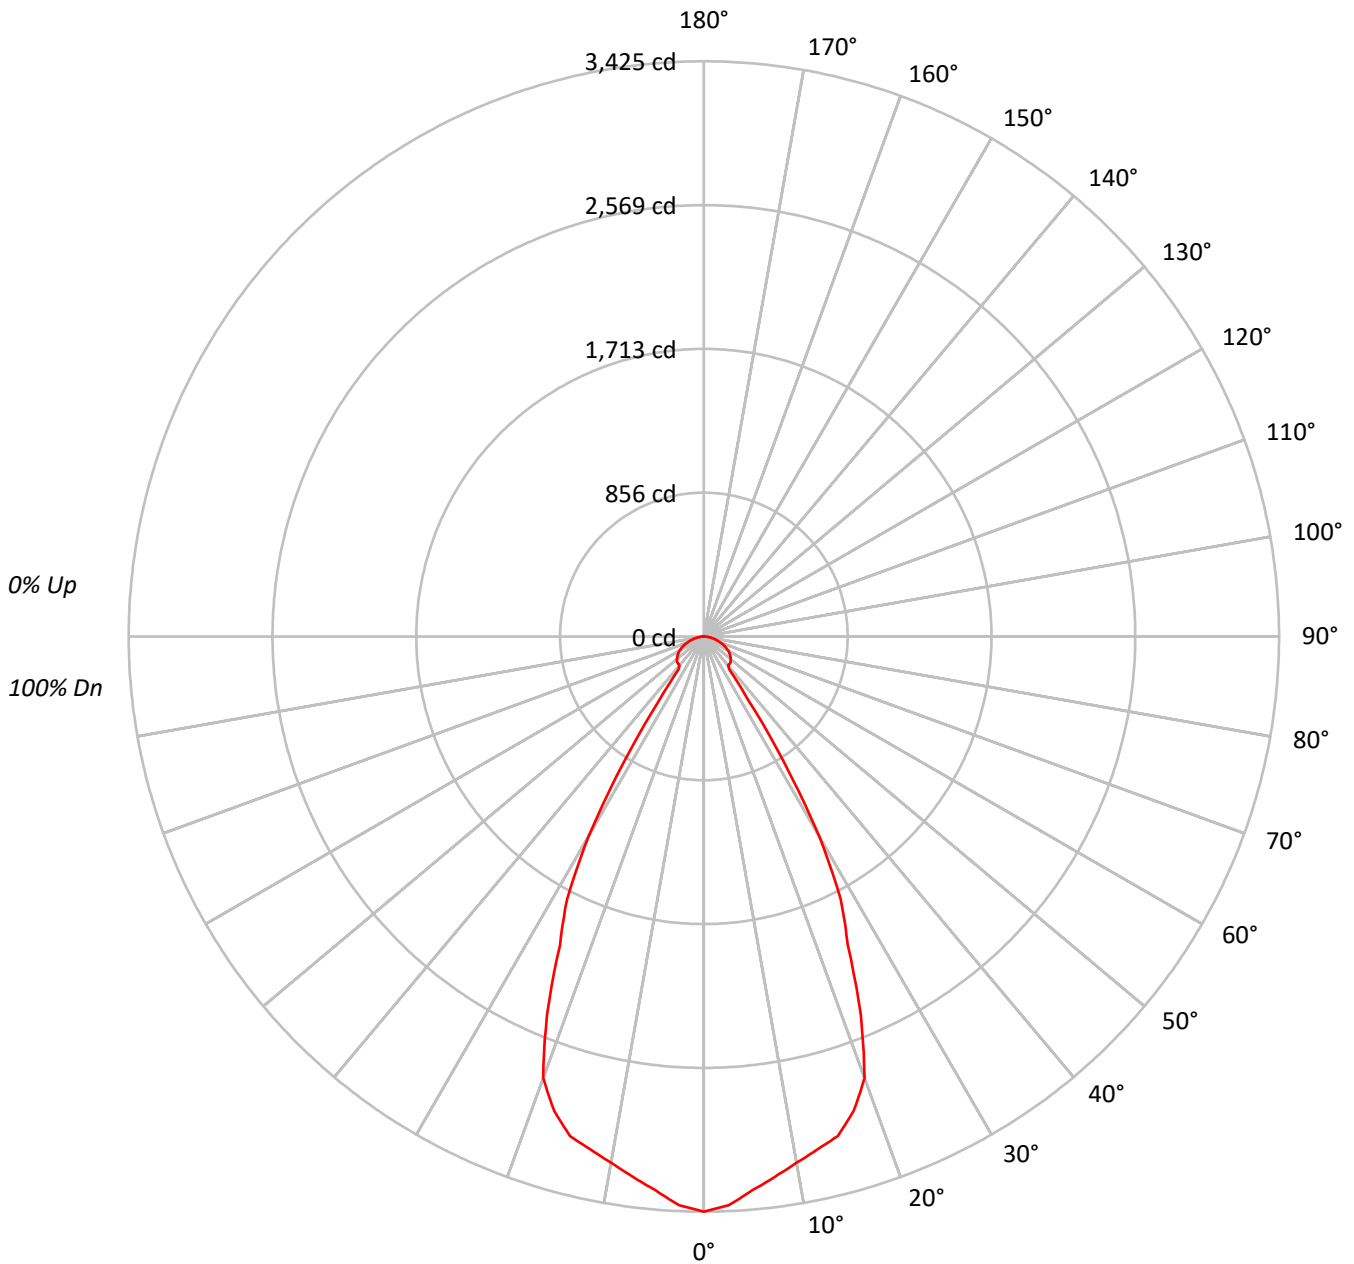



TEST NUMBER: P793183

CATALOG NUMBER: LER6D45BD010-EC6DR7040509040-6LBDP1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	112	109	106	103	110	107	104	102	103	101	99	99	97	96	95	94	93	91			
2	106	100	95	91	103	98	94	90	95	91	88	92	89	86	89	87	85	83			
3	100	92	87	82	98	91	86	81	88	84	80	86	82	79	83	80	78	76			
4	94	86	80	75	92	85	79	74	82	77	73	80	76	73	78	75	72	70			
5	89	80	74	69	87	79	73	69	77	72	68	75	71	67	74	70	67	65			
6	85	75	68	64	83	74	68	64	73	67	63	71	66	63	70	66	62	61			
7	80	70	64	59	79	70	64	59	68	63	59	67	62	59	66	62	58	57			
8	77	66	60	56	75	66	60	56	65	59	55	64	59	55	63	58	55	53			
9	73	63	57	52	72	62	56	52	61	56	52	60	55	52	60	55	52	50			
10	70	59	53	49	69	59	53	49	58	53	49	57	52	49	57	52	49	48			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	374218
5°	363100
10°	352976
15°	348349
20°	325285
25°	244367
30°	172743
35°	61196
40°	32177
45°	34272
50°	35492
55°	36155
60°	36384
65°	35600
70°	33607
75°	31113
80°	27622
85°	22440

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 60°
 Luminance: 36384 cd/sqm



TEST NUMBER: P793183

CATALOG NUMBER: LER6D45BD010-EC6DR7040509040-6LBDP1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	312.3	10.3
10°-20°	856.5	28.1
20°-30°	943.3	31.0
30°-40°	360.4	11.8
40°-50°	170.2	5.6
50°-60°	169.2	5.6
60°-70°	135.5	4.4
70°-80°	77.8	2.6
80°-90°	21.1	0.7
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2112.1	69.3
0°-40°	2472.5	81.2
0°-60°	2811.9	92.3
0°-90°	3046.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3046.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3425	
5°	3311	312
15°	3080	857
25°	2027	943
35°	459	360
45°	222	170
55°	190	169
65°	138	135
75°	74	78
85°	18	21
90°	0	



TEST NUMBER: P793183

CATALOG NUMBER: LER6D45BD010-EC6DR7040509040-6LBDP1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	3425.0
2.5°	3389.2
5°	3310.6
7.5°	3244.9
10°	3181.5
12.5°	3127.8
15°	3079.6
17.5°	2963.0
20°	2797.6
22.5°	2440.8
25°	2027.0
27.5°	1764.5
30°	1369.2
32.5°	884.4
35°	458.8
37.5°	247.8
40°	225.6
42.5°	224.0
45°	221.8
47.5°	216.9
50°	208.8
52.5°	199.6
55°	189.8
57.5°	178.9
60°	166.5
62.5°	152.4
65°	137.7
67.5°	121.5
70°	105.2
72.5°	88.9
75°	73.7
77.5°	58.0
80°	43.9
82.5°	30.9
85°	17.9
87.5°	7.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)