

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P793186

Luminaire Tested: LER6D45BD010-EC6DR7040509040-6LBDP1MW

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P793186
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-73)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D45BD010-EC6DR7040509040-6LBDP1MW
Description: 6 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 70° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4089.7 lumens
Efficiency: N/A
Efficacy: 105.7 lumens/watt
Spacing Criteria (0/90/45): 0.88 / 0.88 / 0.82
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 38.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P793186

CATALOG NUMBER: LER6D45BD010-EC6DR7040509040-6LBDP1MW

Luminous Intensity Polar Plot

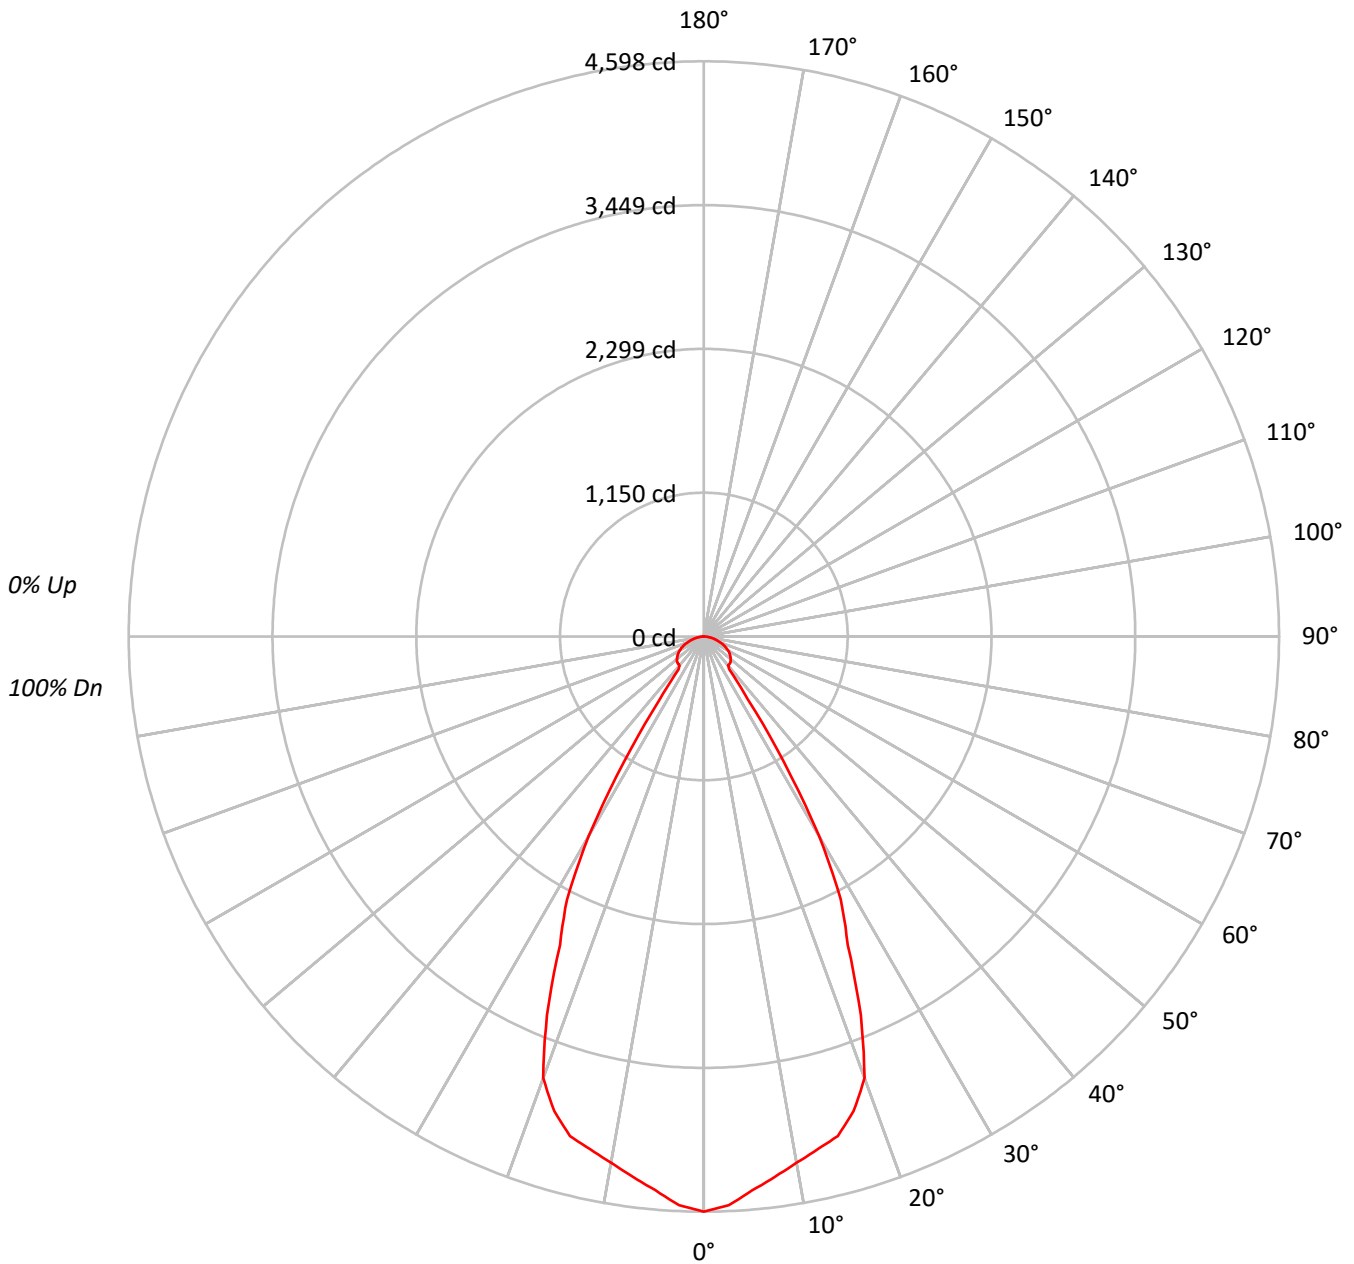



TEST NUMBER: P793186

CATALOG NUMBER: LER6D45BD010-EC6DR7040509040-6LBDP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20																		
RC	80									70									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR	0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100	100	100	100	100	100	100	100																	
	1	112	109	106	103	110	107	104	102	103	101	99	99	97	96	95	94	93	91	91	91	91	91	91	91	91	91	91	91																	
	2	106	100	95	91	103	98	94	90	95	91	88	92	89	86	89	87	85	83	83	83	83	83	83	83	83	83	83	83																	
	3	100	92	87	82	98	91	86	81	88	84	80	86	82	79	83	80	78	76	76	76	76	76	76	76	76	76	76	76																	
	4	94	86	80	75	92	85	79	74	82	77	73	80	76	73	78	75	72	70	70	70	70	70	70	70	70	70	70	70																	
	5	89	80	74	69	87	79	73	69	77	72	68	75	71	67	74	70	67	65	65	65	65	65	65	65	65	65	65	65																	
	6	85	75	68	64	83	74	68	64	73	67	63	71	66	63	70	66	62	61	61	61	61	61	61	61	61	61	61	61																	
	7	80	70	64	59	79	70	64	59	68	63	59	67	62	59	66	62	58	57	57	57	57	57	57	57	57	57	57	57																	
	8	77	66	60	56	75	66	60	56	65	59	55	64	59	55	63	58	55	53	53	53	53	53	53	53	53	53	53	53																	
	9	73	63	57	52	72	62	56	52	61	56	52	60	55	52	60	55	52	50	50	50	50	50	50	50	50	50	50	50																	
	10	70	59	53	49	69	59	53	49	58	53	49	57	52	49	57	52	49	48	48	48	48	48	48	48	48	48	48	48																	

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	502381
5°	487453
10°	473863
15°	467652
20°	436686
25°	328057
30°	231914
35°	82150
40°	43188
45°	46000
50°	47645
55°	48537
60°	48840
65°	47803
70°	45107
75°	41793
80°	37123
85°	30087

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 57.5°
 Luminance: 48845 cd/sqm



TEST NUMBER: P793186

CATALOG NUMBER: LER6D45BD010-EC6DR7040509040-6LBDP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	419.2	10.3
10°-20°	1149.9	28.1
20°-30°	1266.4	31.0
30°-40°	483.9	11.8
40°-50°	228.5	5.6
50°-60°	227.1	5.6
60°-70°	181.9	4.4
70°-80°	104.5	2.6
80°-90°	28.4	0.7
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2835.5	69.3
0°-40°	3319.3	81.2
0°-60°	3774.9	92.3
0°-90°	4089.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4089.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4598	
5°	4444	419
15°	4134	1150
25°	2721	1266
35°	616	484
45°	298	228
55°	255	227
65°	185	182
75°	99	105
85°	24	28
90°	0	



TEST NUMBER: P793186

CATALOG NUMBER: LER6D45BD010-EC6DR7040509040-6LBDP1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	4598.0
2.5°	4550.0
5°	4444.4
7.5°	4356.3
10°	4271.1
12.5°	4199.1
15°	4134.3
17.5°	3977.8
20°	3755.7
22.5°	3276.7
25°	2721.2
27.5°	2368.9
30°	1838.2
32.5°	1187.4
35°	615.9
37.5°	332.7
40°	302.8
42.5°	300.7
45°	297.7
47.5°	291.2
50°	280.3
52.5°	267.9
55°	254.8
57.5°	240.2
60°	223.5
62.5°	204.6
65°	184.9
67.5°	163.1
70°	141.2
72.5°	119.4
75°	99.0
77.5°	77.9
80°	59.0
82.5°	41.5
85°	24.0
87.5°	9.5
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)