

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P793188

Luminaire Tested: LER6D45BD010-EC6DR7040509040-6LBS1H

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P793188  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-76)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D45BD010-EC6DR7040509040-6LBS1H  
Description: 6 INCH ROUND SHALLOW SEMI-SPECULAR CLEAR TRIM, WITH 70° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 5511.5 lumens  
Efficiency: N/A  
Efficacy: 142.4 lumens/watt  
Spacing Criteria (0/90/45): 1.1 / 1.1 / 1.04  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct


Input Watts (W): 38.7  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



Downlight

TEST NUMBER: P793188  
CATALOG NUMBER: LER6D45BD010-EC6DR7040509040-6LBS1H

### Luminous Intensity Polar Plot

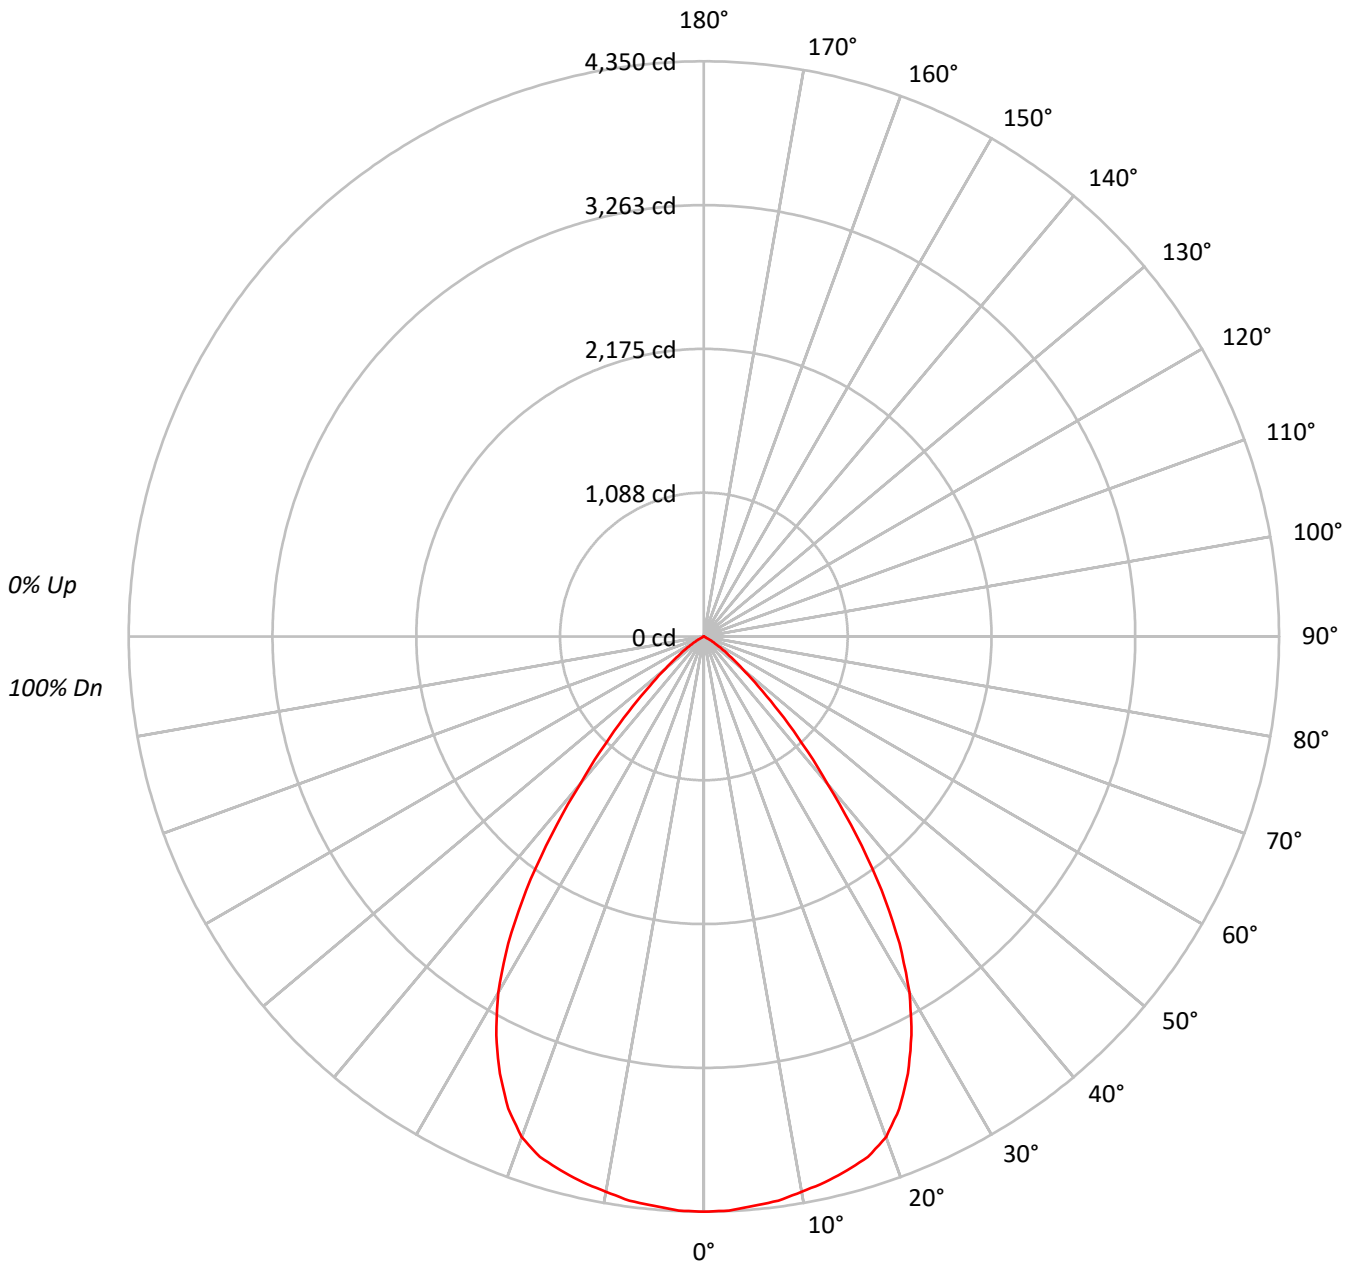



TEST NUMBER: P793188

CATALOG NUMBER: LER6D45BD010-EC6DR7040509040-6LBS1H

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	113	110	107	105	111	108	106	103	104	102	100	100	99	97	97	95	94	93																			
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85																			
3	101	94	88	84	99	92	87	83	90	85	82	87	84	81	85	82	79	78																			
4	95	87	81	76	93	86	80	76	83	78	75	81	77	74	79	76	73	71																			
5	89	80	74	69	88	79	73	69	78	72	68	76	71	68	74	70	67	65																			
6	84	75	68	63	83	74	68	63	72	67	63	71	66	62	69	65	62	60																			
7	80	69	63	58	78	69	62	58	67	62	58	66	61	57	65	61	57	56																			
8	75	65	58	54	74	64	58	54	63	57	53	62	57	53	61	56	53	51																			
9	71	61	54	50	70	60	54	50	59	53	50	58	53	49	57	53	49	48																			
10	67	57	50	46	66	56	50	46	55	50	46	55	50	46	54	49	46	44																			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	475295
5°	474106
10°	473086
15°	472945
20°	468324
25°	439933
30°	392204
35°	312703
40°	207640
45°	124140
50°	64354
55°	33831
60°	11975
65°	207
70°	0
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 124140 cd/sqm



TEST NUMBER: P793188

CATALOG NUMBER: LER6D45BD010-EC6DR7040509040-6LBS1H

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	411.1	7.5
10°-20°	1179.0	21.4
20°-30°	1663.2	30.2
30°-40°	1435.8	26.1
40°-50°	643.0	11.7
50°-60°	168.4	3.1
60°-70°	11.0	0.2
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3253.3	59.0
0°-40°	4689.2	85.1
0°-60°	5500.5	99.8
0°-90°	5511.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5511.5	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	4350	
5°	4323	411
15°	4181	1179
25°	3649	1663
35°	2344	1436
45°	803	643
55°	178	168
65°	1	11
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P793188

CATALOG NUMBER: LER6D45BD010-EC6DR7040509040-6LBS1H

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	4350.1
2.5°	4345.4
5°	4322.7
7.5°	4304.0
10°	4264.1
12.5°	4228.1
15°	4181.1
17.5°	4127.2
20°	4027.8
22.5°	3864.3
25°	3649.2
27.5°	3399.7
30°	3108.7
32.5°	2752.8
35°	2344.4
37.5°	1893.8
40°	1455.8
42.5°	1106.1
45°	803.4
47.5°	553.8
50°	378.6
52.5°	261.3
55°	177.6
57.5°	107.2
60°	54.8
62.5°	17.2
65°	0.8
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)