

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P793193

Luminaire Tested: LER6D45BD010-EC6DR7040509050-6LBDP1LI

Issue Date: 2/5/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P793193  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-73)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/5/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D45BD010-EC6DR7040509050-6LBDP1LI  
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 70° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 5536.9 lumens  
Efficiency: N/A  
Efficacy: 143.1 lumens/watt  
Spacing Criteria (0/90/45): 0.88 / 0.88 / 0.82  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 38.7  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight

TEST NUMBER: P793193

CATALOG NUMBER: LER6D45BD010-EC6DR7040509050-6LBDP1LI

### Luminous Intensity Polar Plot

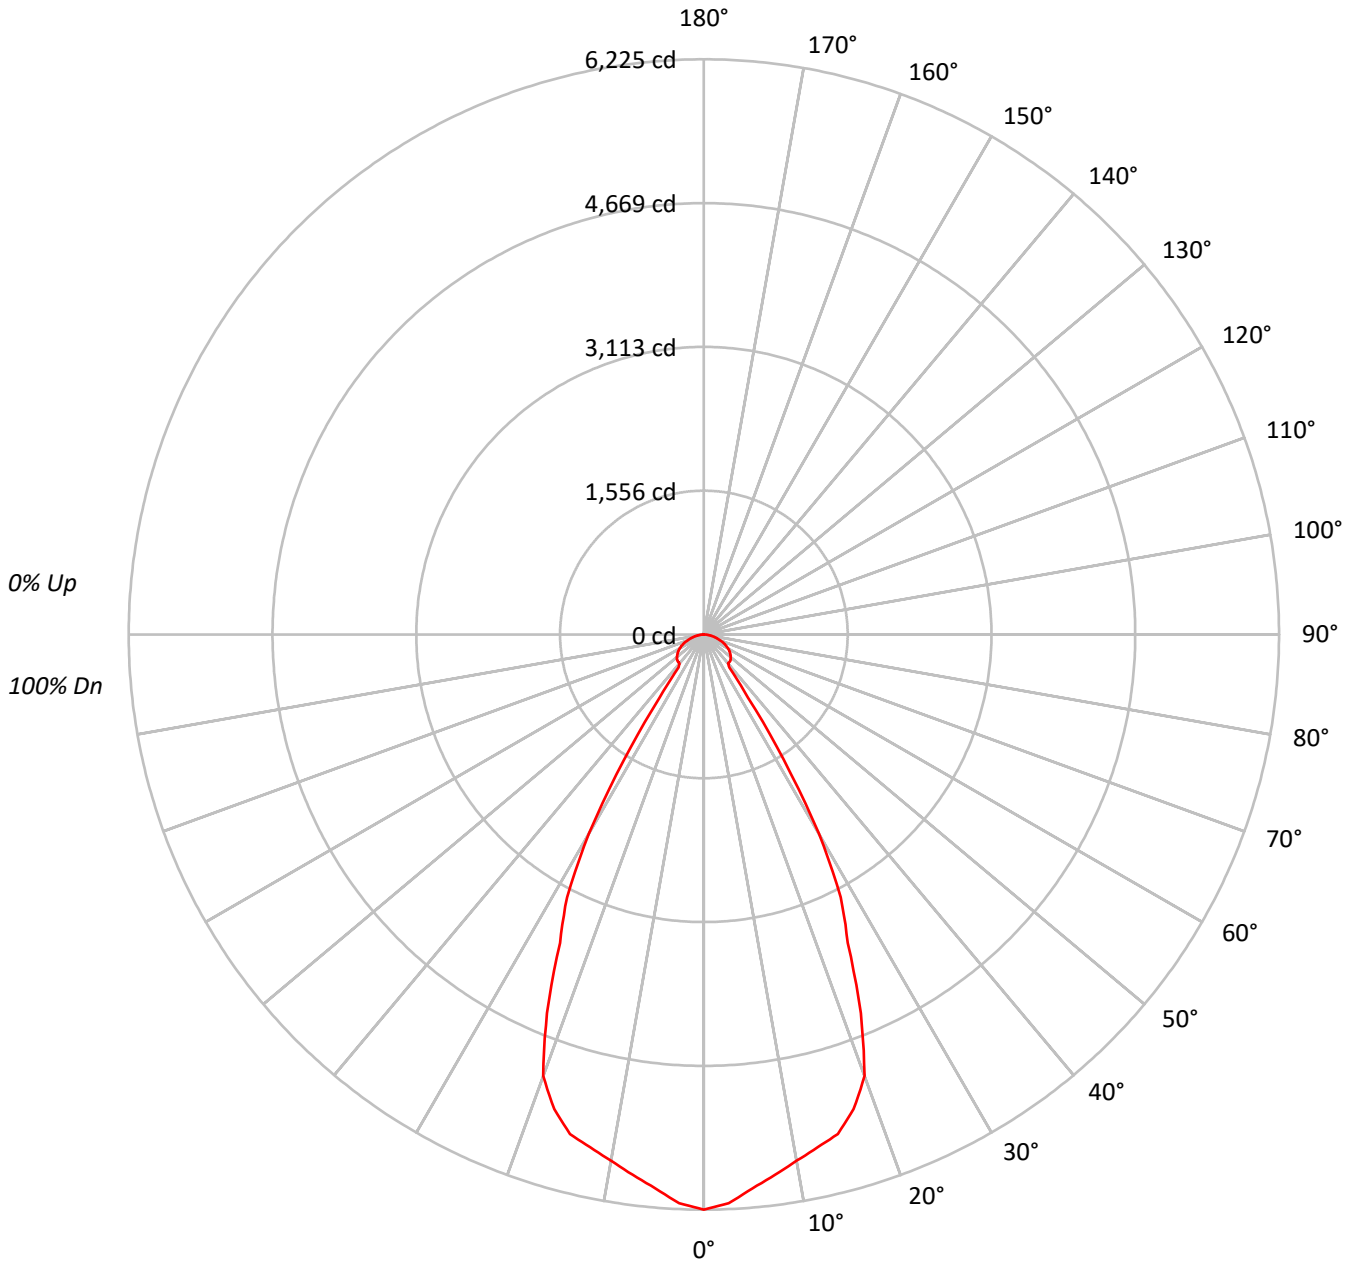



TEST NUMBER: P793193

CATALOG NUMBER: LER6D45BD010-EC6DR7040509050-6LBDP1LI

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |     |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|-----|
| RF  | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |    |    |     |
| RC  | 80  |     |     |     | 70  |     |     |     | 50  |     |     |     | 30  |     |     |     | 10  |     |    | 0  |     |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30 | 10 | 0   |
| RCR |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |     |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 |    |    | 100 |
| 1   | 112 | 109 | 106 | 103 | 110 | 107 | 104 | 102 | 103 | 101 | 99  | 99  | 97  | 96  | 95  | 94  | 93  | 91  |    |    | 91  |
| 2   | 106 | 100 | 95  | 91  | 103 | 98  | 94  | 90  | 95  | 91  | 88  | 92  | 89  | 86  | 89  | 87  | 85  | 83  |    |    | 83  |
| 3   | 100 | 92  | 87  | 82  | 98  | 91  | 86  | 81  | 88  | 84  | 80  | 86  | 82  | 79  | 83  | 80  | 78  | 76  |    |    | 76  |
| 4   | 94  | 86  | 80  | 75  | 92  | 85  | 79  | 74  | 82  | 77  | 73  | 80  | 76  | 73  | 78  | 75  | 72  | 70  |    |    | 70  |
| 5   | 89  | 80  | 74  | 69  | 87  | 79  | 73  | 69  | 77  | 72  | 68  | 75  | 71  | 67  | 74  | 70  | 67  | 65  |    |    | 65  |
| 6   | 85  | 75  | 68  | 64  | 83  | 74  | 68  | 64  | 73  | 67  | 63  | 71  | 66  | 63  | 70  | 66  | 62  | 61  |    |    | 61  |
| 7   | 80  | 70  | 64  | 59  | 79  | 70  | 64  | 59  | 68  | 63  | 59  | 67  | 62  | 59  | 66  | 62  | 58  | 57  |    |    | 57  |
| 8   | 77  | 66  | 60  | 56  | 75  | 66  | 60  | 56  | 65  | 59  | 55  | 64  | 59  | 55  | 63  | 58  | 55  | 53  |    |    | 53  |
| 9   | 73  | 63  | 57  | 52  | 72  | 62  | 56  | 52  | 61  | 56  | 52  | 60  | 55  | 52  | 60  | 55  | 52  | 50  |    |    | 50  |
| 10  | 70  | 59  | 53  | 49  | 69  | 59  | 53  | 49  | 58  | 53  | 49  | 57  | 52  | 49  | 57  | 52  | 49  | 48  |    |    | 48  |

**AVERAGE LUMINANCE (cd/sqm):**

|     |        |
|-----|--------|
|     | 0°     |
| 0°  | 680159 |
| 5°  | 659955 |
| 10° | 641558 |
| 15° | 633139 |
| 20° | 591224 |
| 25° | 444152 |
| 30° | 313983 |
| 35° | 111215 |
| 40° | 58478  |
| 45° | 62286  |
| 50° | 64507  |
| 55° | 65719  |
| 60° | 66125  |
| 65° | 64711  |
| 70° | 61080  |
| 75° | 56568  |
| 80° | 50211  |
| 85° | 40743  |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 57.5°  
 Luminance: 66150 cd/sqm



TEST NUMBER: P793193

CATALOG NUMBER: LER6D45BD010-EC6DR7040509050-6LBDP1LI

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 567.5  | 10.3      |
| 10°-20°   | 1556.8 | 28.1      |
| 20°-30°   | 1714.6 | 31.0      |
| 30°-40°   | 655.1  | 11.8      |
| 40°-50°   | 309.3  | 5.6       |
| 50°-60°   | 307.5  | 5.6       |
| 60°-70°   | 246.2  | 4.4       |
| 70°-80°   | 141.5  | 2.6       |
| 80°-90°   | 38.5   | 0.7       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| 0°-30°    | 3838.9 | 69.3      |
| 0°-40°    | 4493.9 | 81.2      |
| 0°-60°    | 5110.8 | 92.3      |
| 0°-90°    | 5536.9 | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 5536.9 | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°   | Flux |
|-----|------|------|
| 0°  | 6225 |      |
| 5°  | 6017 | 568  |
| 15° | 5597 | 1557 |
| 25° | 3684 | 1715 |
| 35° | 834  | 655  |
| 45° | 403  | 309  |
| 55° | 345  | 308  |
| 65° | 250  | 246  |
| 75° | 134  | 141  |
| 85° | 32   | 38   |
| 90° | 0    |      |



TEST NUMBER: P793193

CATALOG NUMBER: LER6D45BD010-EC6DR7040509050-6LBDP1LI

**CANDELA DISTRIBUTION (FULL):**

| 0°    |        |
|-------|--------|
| 0°    | 6225.1 |
| 2.5°  | 6160.1 |
| 5°    | 6017.2 |
| 7.5°  | 5897.9 |
| 10°   | 5782.6 |
| 12.5° | 5685.0 |
| 15°   | 5597.3 |
| 17.5° | 5385.4 |
| 20°   | 5084.8 |
| 22.5° | 4436.2 |
| 25°   | 3684.2 |
| 27.5° | 3207.2 |
| 30°   | 2488.7 |
| 32.5° | 1607.5 |
| 35°   | 833.8  |
| 37.5° | 450.4  |
| 40°   | 410.0  |
| 42.5° | 407.1  |
| 45°   | 403.1  |
| 47.5° | 394.2  |
| 50°   | 379.5  |
| 52.5° | 362.7  |
| 55°   | 345.0  |
| 57.5° | 325.3  |
| 60°   | 302.6  |
| 62.5° | 277.0  |
| 65°   | 250.3  |
| 67.5° | 220.8  |
| 70°   | 191.2  |
| 72.5° | 161.6  |
| 75°   | 134.0  |
| 77.5° | 105.5  |
| 80°   | 79.8   |
| 82.5° | 56.2   |
| 85°   | 32.5   |
| 87.5° | 12.8   |
| 90°   | 0.0    |

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)