

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P793283

Luminaire Tested: LER6D50D010-EC6DR3040509040-6LBS1B

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P793283
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-16)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D50D010-EC6DR3040509040-6LBS1B
Description: 6 INCH ROUND SHALLOW SPECULAR BLACK TRIM, WITH 30° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5871.0 lumens
Efficiency: N/A
Efficacy: 124.9 lumens/watt
Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.49
Luminous Opening: Rectangular (W 0.38' x L: 0.38' x H: 0')
CIE Type: Direct

Input Watts (W): 47
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P793283

CATALOG NUMBER: LER6D50D010-EC6DR3040509040-6LBS1B

Luminous Intensity Polar Plot

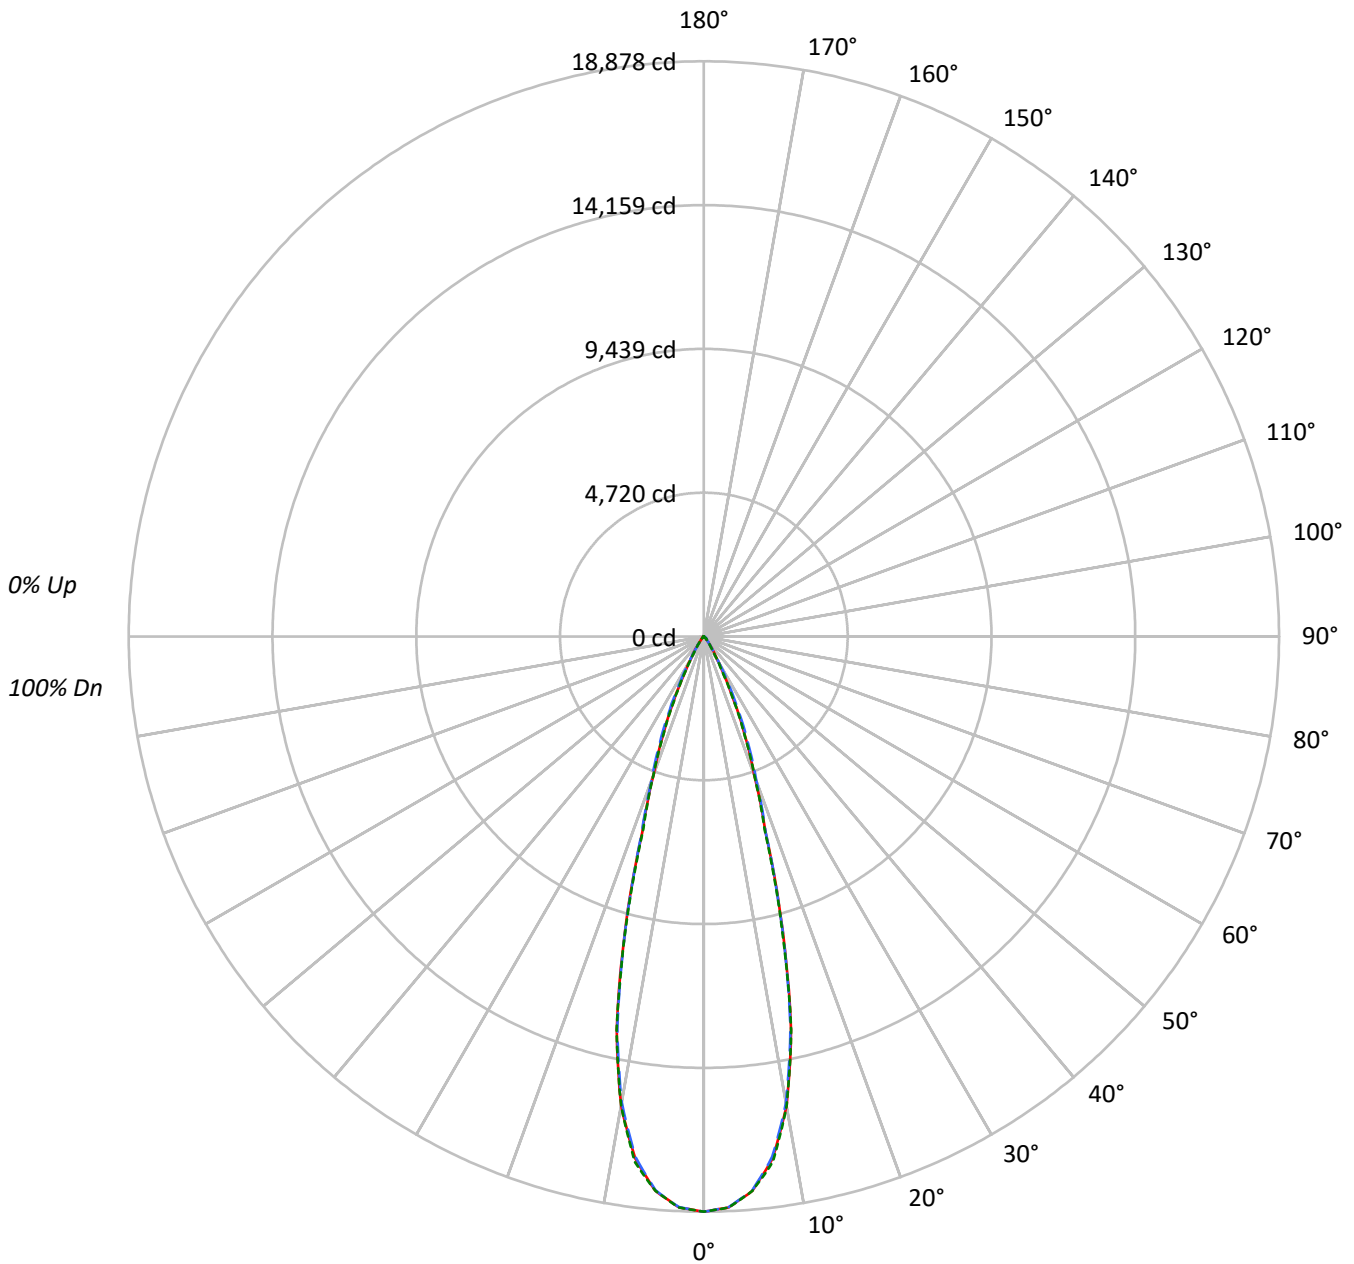



TEST NUMBER: P793283

CATALOG NUMBER: LER6D50D010-EC6DR3040509040-6LBS1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96																			
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92																			
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89																			
4	103	98	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85																			
5	100	94	89	86	98	93	89	86	91	88	85	90	86	84	88	86	83	82																			
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79																			
7	94	87	82	79	92	86	82	79	85	81	78	84	81	78	83	80	78	77																			
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74																			
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72																			
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69																			

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1444994	1444994	1444994
5°	1403505	1401869	1403582
10°	1215653	1207080	1215366
15°	793149	788893	784923
20°	394401	409193	393871
25°	198667	224029	194596
30°	79546	86670	69302
35°	36891	35340	29621
40°	15927	17686	14998
45°	11236	13942	11334
50°	3858	10158	4084
55°	2229	4204	2349
60°	1561	1837	1561
65°	1014	1014	1014
70°	627	425	627
75°	0	266	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 22.5°

Vertical Angle: 45°

Luminance: 13942 cd/sqm



TEST NUMBER: P793283

CATALOG NUMBER: LER6D50D010-EC6DR3040509040-6LBS1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1660.0	28.3
10°-20°	2673.5	45.5
20°-30°	1155.3	19.7
30°-40°	263.3	4.5
40°-50°	90.4	1.5
50°-60°	22.1	0.4
60°-70°	5.7	0.1
70°-80°	0.6	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5488.8	93.5
0°-40°	5752.2	98.0
0°-60°	5864.6	99.9
0°-90°	5871.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5871.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	18878	18878	18878	18878	18878	
5°	18266	18249	18245	18283	18267	1661
15°	10009	9888	9955	9923	9905	2680
25°	2352	2441	2653	2379	2304	1126
35°	395	403	378	375	317	268
45°	104	129	129	129	105	74
55°	17	18	32	18	18	16
65°	6	6	6	6	6	5
75°	0	0	1	0	0	1
85°	0	0	0	0	0	0
90°	0	0	0	0	0	



TEST NUMBER: P793283

CATALOG NUMBER: LER6D50D010-EC6DR3040509040-6LBS1B

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	18878.1	18878.1	18878.1	18878.1	18878.1
2.5°	18752.9	18740.0	18747.4	18756.6	18760.3
5°	18266.3	18248.7	18245.0	18283.0	18267.3
7.5°	17284.8	17259.8	17221.8	17308.0	17388.6
10°	15640.6	15612.8	15530.3	15571.1	15636.9
12.5°	13213.2	13123.2	13121.4	13251.2	13233.5
15°	10009.0	9888.5	9955.3	9922.8	9905.2
17.5°	6730.8	6684.4	6773.4	6746.5	6630.7
20°	4841.9	4853.9	5023.5	4938.2	4835.4
22.5°	3533.1	3576.7	3777.8	3558.2	3477.5
25°	2352.3	2441.3	2652.6	2379.2	2304.1
27.5°	1446.8	1487.6	1701.7	1428.3	1387.5
30°	900.0	879.6	980.6	841.6	784.1
32.5°	590.4	564.5	596.9	535.7	489.4
35°	394.8	403.2	378.2	375.4	317.0
37.5°	246.5	283.6	250.2	266.9	203.9
40°	159.4	205.8	177.0	195.6	150.1
42.5°	130.7	158.5	145.5	154.8	133.5
45°	103.8	128.8	128.8	128.8	104.7
47.5°	57.5	86.2	110.3	88.1	61.2
50°	32.4	43.6	85.3	45.4	34.3
52.5°	22.2	25.0	58.4	26.0	23.2
55°	16.7	17.6	31.5	18.5	17.6
57.5°	13.0	13.9	16.7	13.9	13.0
60°	10.2	10.2	12.0	11.1	10.2
62.5°	7.4	7.4	8.3	7.4	7.4
65°	5.6	5.6	5.6	5.6	5.6
67.5°	2.8	3.7	3.7	3.7	3.7
70°	2.8	1.9	1.9	1.9	2.8
72.5°	1.9	0.9	0.9	0.9	0.9
75°	0.0	0.0	0.9	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)