

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P793417

Luminaire Tested: LER6D50D010-EC6DR4540509035-6LBDP1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P793417
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D50D010-EC6DR4540509035-6LBDDP1LI
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 6258.6 lumens
Efficiency: N/A
Efficacy: 133.2 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 47
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P793417
CATALOG NUMBER: LER6D50D010-EC6DR4540509035-6LBDP1LI

Luminous Intensity Polar Plot

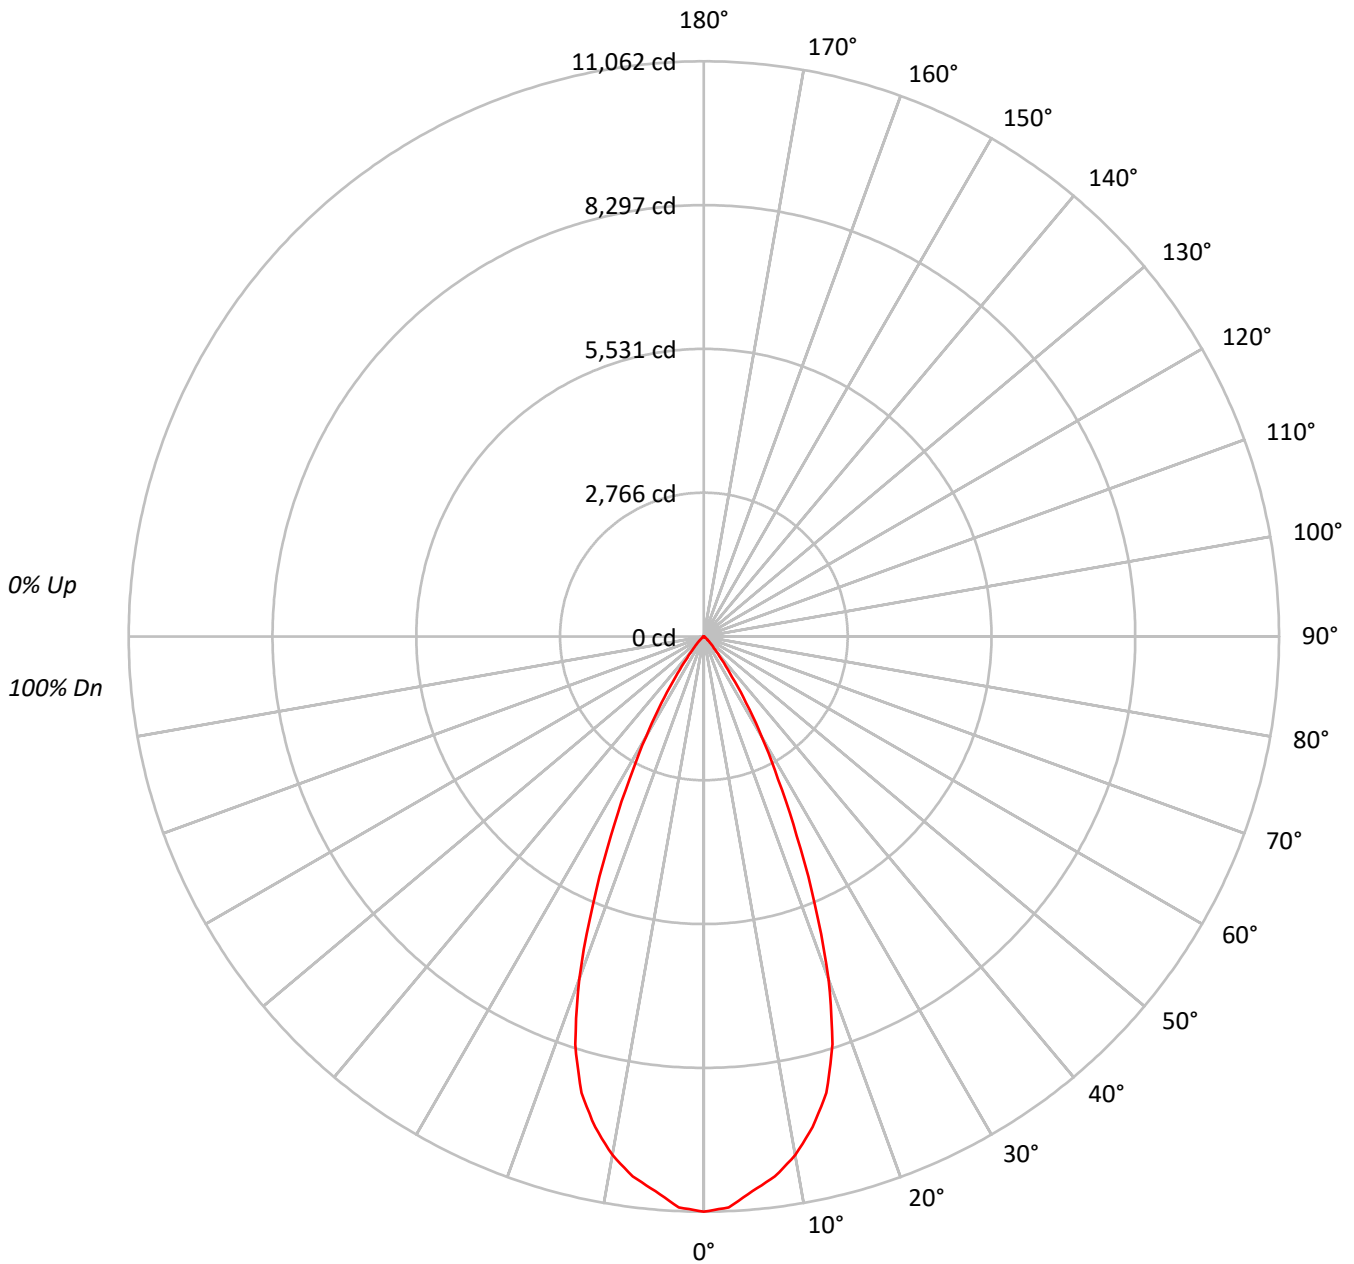



TEST NUMBER: P793417

CATALOG NUMBER: LER6D50D010-EC6DR4540509035-6LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95			95																
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90			90																
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85			85																
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81			81																
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77			77																
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73			73																
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69			69																
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66			66																
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63			63																
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60			60																

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1208653
5°	1174247
10°	1123431
15°	1028182
20°	815701
25°	509252
30°	280688
35°	126033
40°	49635
45°	23394
50°	11100
55°	5810
60°	2863
65°	672
70°	288
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 23394 cd/sqm



TEST NUMBER: P793417

CATALOG NUMBER: LER6D50D010-EC6DR4540509035-6LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1006.0	16.1
10°-20°	2475.8	39.6
20°-30°	1960.6	31.3
30°-40°	652.9	10.4
40°-50°	129.6	2.1
50°-60°	29.4	0.5
60°-70°	4.3	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5442.3	87.0
0°-40°	6095.2	97.4
0°-60°	6254.2	99.9
0°-90°	6258.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6258.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	11062	
5°	10706	###
15°	9090	2476
25°	4224	1961
35°	945	653
45°	151	130
55°	30	29
65°	3	4
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P793417

CATALOG NUMBER: LER6D50D010-EC6DR4540509035-6LBDP1LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	11062.1
2.5°	10989.9
5°	10706.3
7.5°	10472.2
10°	10125.9
12.5°	9664.8
15°	9089.7
17.5°	8224.8
20°	7015.4
22.5°	5574.6
25°	4224.2
27.5°	3093.1
30°	2224.8
32.5°	1513.1
35°	944.9
37.5°	560.3
40°	348.0
42.5°	228.8
45°	151.4
47.5°	97.4
50°	65.3
52.5°	43.5
55°	30.5
57.5°	20.0
60°	13.1
62.5°	7.0
65°	2.6
67.5°	0.9
70°	0.9
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)