

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P793843

Luminaire Tested: LER6D55D010-EC6DR4055659030-6LBS1B

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P793843  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-28)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D55D010-EC6DR4055659030-6LBS1B  
Description: 6 INCH ROUND SHALLOW SPECULAR BLACK TRIM, WITH 40° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 6719.3 lumens  
Efficiency: N/A  
Efficacy: 115.5 lumens/watt  
Spacing Criteria (0/90/45): 0.68 / 0.68 / 0.6  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 58.2  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight

TEST NUMBER: P793843

CATALOG NUMBER: LER6D55D010-EC6DR4055659030-6LBS1B

### Luminous Intensity Polar Plot

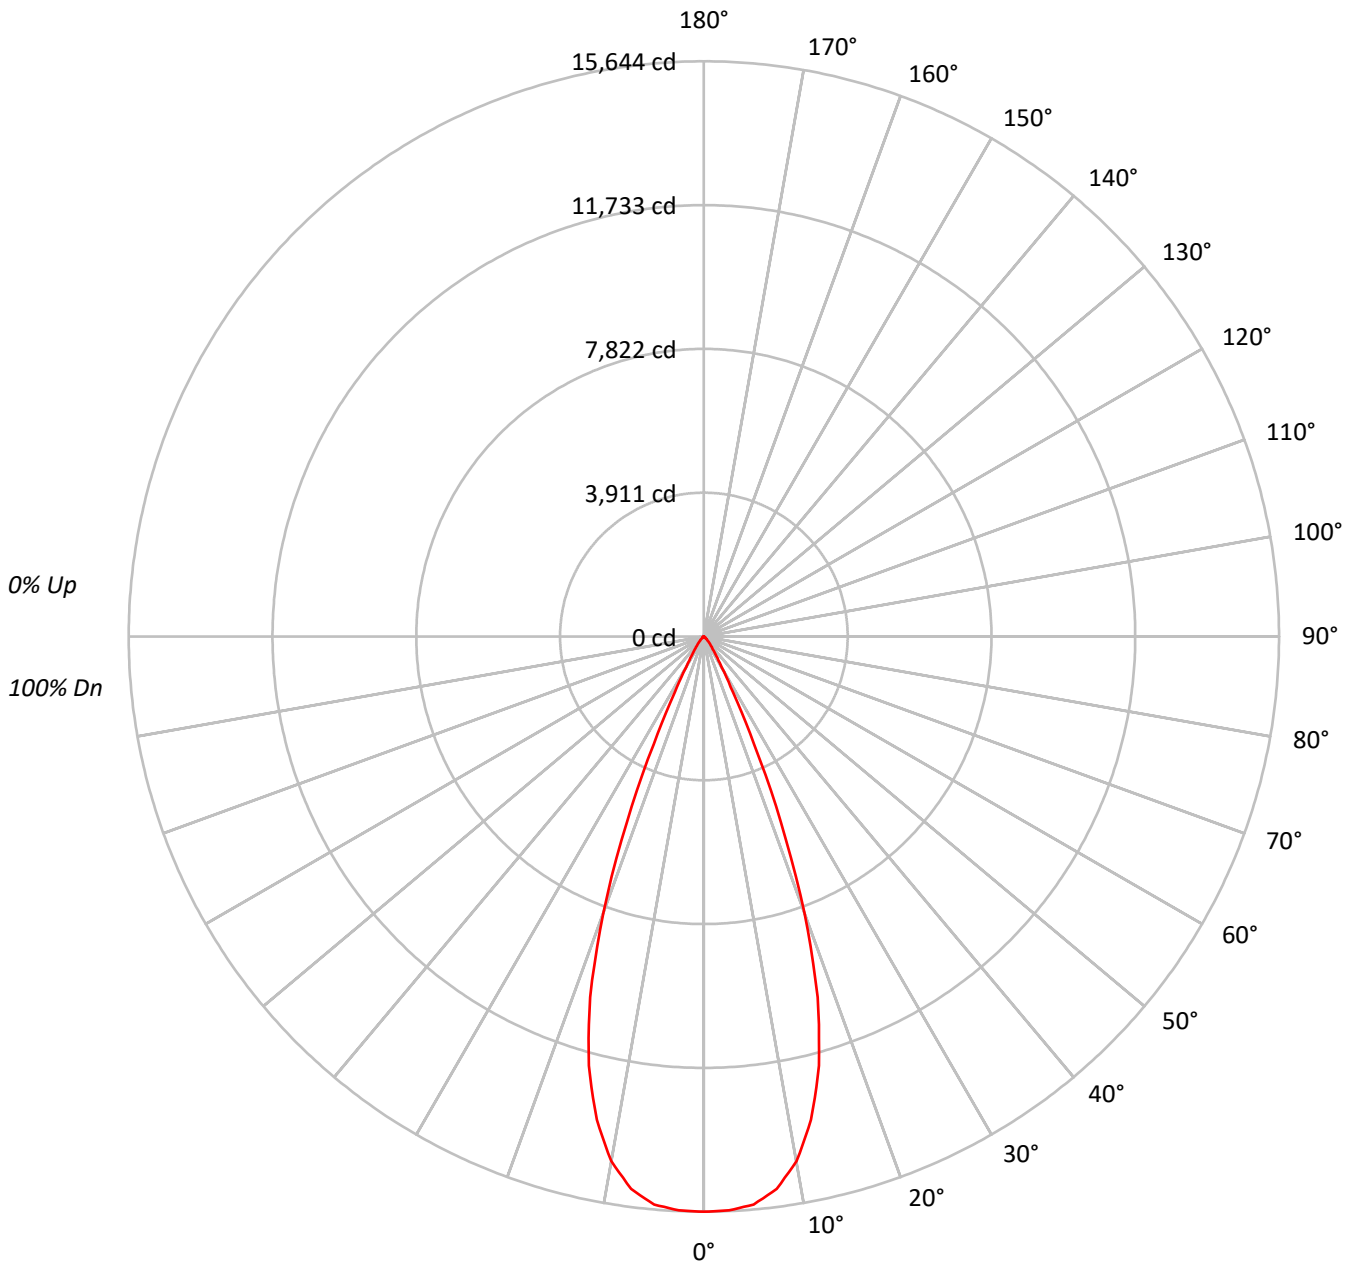



TEST NUMBER: P793843

CATALOG NUMBER: LER6D55D010-EC6DR4055659030-6LBS1B

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20																	
RC	80									50									30									10									0								
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0															
RCR																																													
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																											
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	97	96																											
2	110	106	103	100	108	105	102	99	102	99	97	99	97	95	96	95	93	92																											
3	106	101	97	94	104	100	96	93	97	94	92	95	93	90	93	91	89	88																											
4	102	97	92	89	101	95	91	88	93	90	87	92	89	86	90	87	85	84																											
5	99	92	88	84	97	91	87	84	90	86	83	88	85	83	87	84	82	81																											
6	95	88	84	80	94	88	83	80	86	82	80	85	82	79	84	81	79	77																											
7	92	85	80	77	91	84	80	77	83	79	76	82	79	76	81	78	76	74																											
8	89	82	77	74	88	81	77	74	80	76	73	79	76	73	78	75	73	72																											
9	86	79	74	71	85	78	74	71	77	73	71	76	73	70	76	72	70	69																											
10	83	76	71	68	82	75	71	68	75	71	68	74	70	68	73	70	68	67																											

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	1709319
5°	1701009
10°	1607822
15°	1366860
20°	931613
25°	388708
30°	122215
35°	56808
40°	31421
45°	14401
50°	6986
55°	3829
60°	1989
65°	698
70°	288
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 14401 cd/sqm



TEST NUMBER: P793843

CATALOG NUMBER: LER6D55D010-EC6DR4055659030-6LBS1B

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	1448.2	21.6
10°-20°	3244.3	48.3
20°-30°	1624.0	24.2
30°-40°	297.7	4.4
40°-50°	82.1	1.2
50°-60°	19.3	0.3
60°-70°	3.7	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	6316.4	94.0
0°-40°	6614.1	98.4
0°-60°	6715.5	99.9
0°-90°	6719.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6719.3	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	15644	
5°	15509	###
15°	12084	3244
25°	3224	1624
35°	426	298
45°	93	82
55°	20	19
65°	3	4
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P793843

CATALOG NUMBER: LER6D55D010-EC6DR4055659030-6LBS1B

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	15644.4
2.5°	15621.5
5°	15509.1
7.5°	15150.9
10°	14491.9
12.5°	13464.7
15°	12083.8
17.5°	10287.9
20°	8012.3
22.5°	5462.5
25°	3224.3
27.5°	1704.5
30°	968.7
32.5°	626.0
35°	425.9
37.5°	304.3
40°	220.3
42.5°	150.8
45°	93.2
47.5°	59.4
50°	41.1
52.5°	29.2
55°	20.1
57.5°	12.8
60°	9.1
62.5°	5.5
65°	2.7
67.5°	1.8
70°	0.9
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)