

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P793869

Luminaire Tested: LER6D55D010-EC6DR4055659050-6LBS1LI

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P793869  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-28)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D55D010-EC6DR4055659050-6LBS1LI  
Description: 6 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 40° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 8003.5 lumens  
Efficiency: N/A  
Efficacy: 137.5 lumens/watt  
Spacing Criteria (0/90/45): 0.68 / 0.68 / 0.6  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct


Input Watts (W): 58.2  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



Downlight

TEST NUMBER: P793869  
CATALOG NUMBER: LER6D55D010-EC6DR4055659050-6LBS1LI

### Luminous Intensity Polar Plot

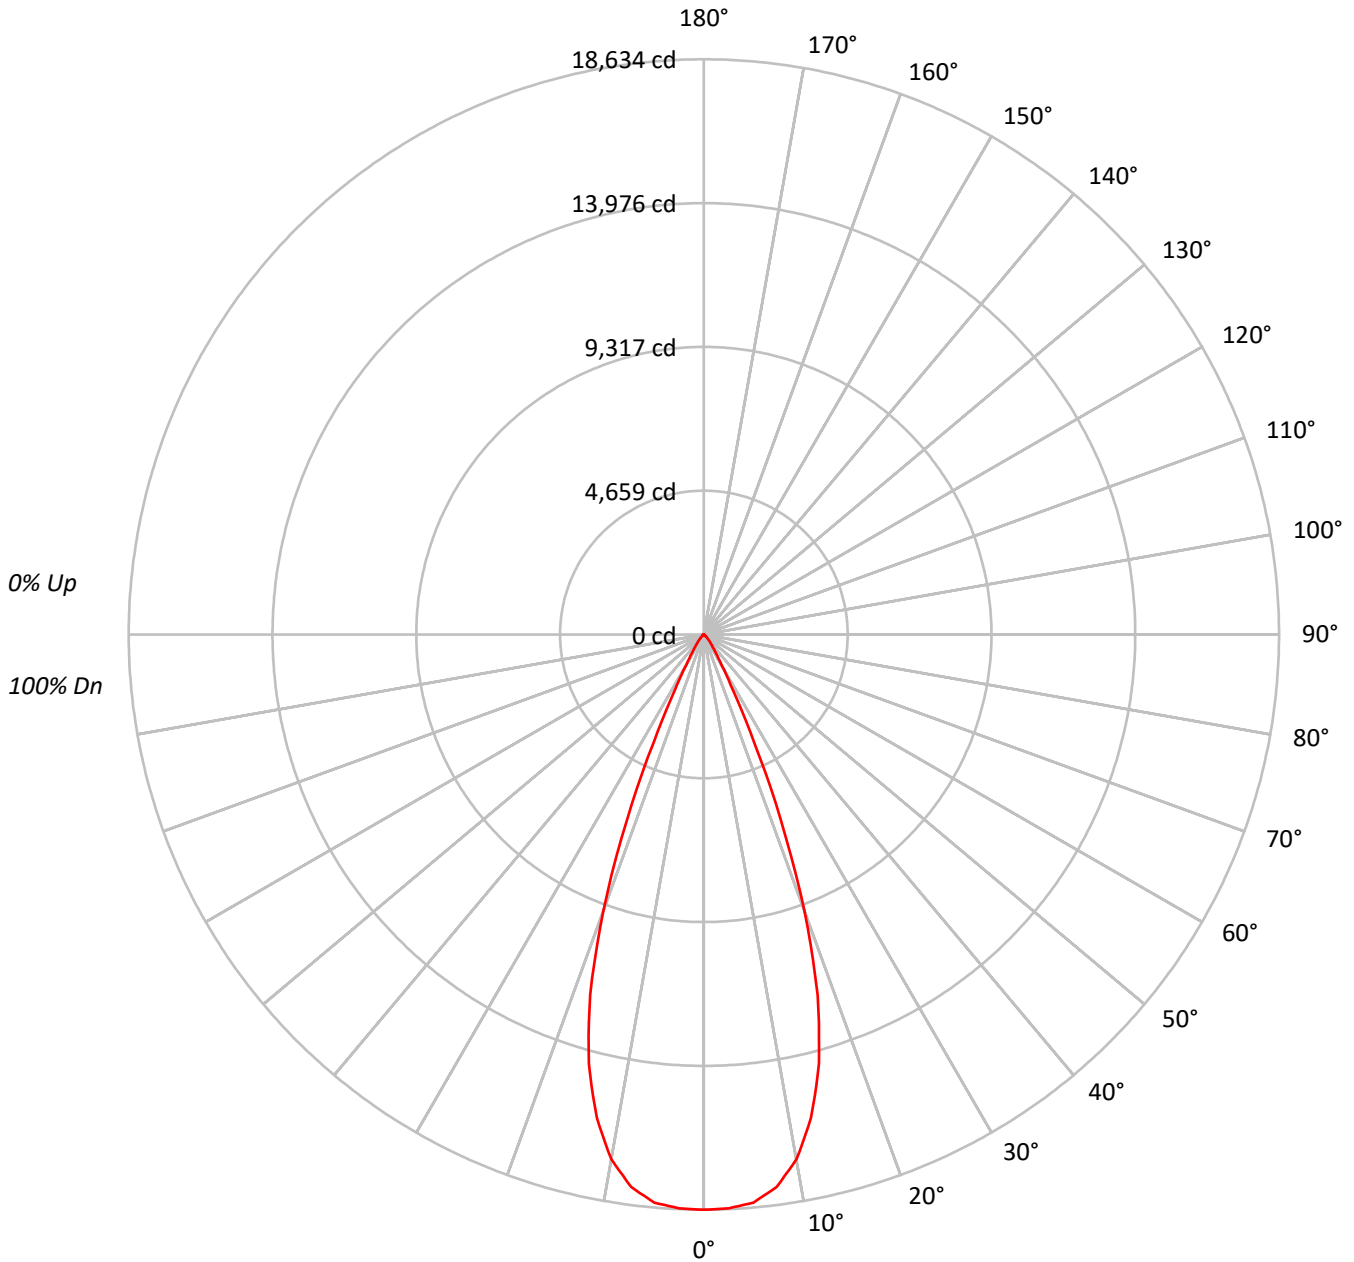



TEST NUMBER: P793869

CATALOG NUMBER: LER6D55D010-EC6DR4055659050-6LBS1LI

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	97	96																			
2	110	106	103	100	108	105	102	99	102	99	97	99	97	95	96	95	93	92																			
3	106	101	97	94	104	100	96	93	97	94	92	95	93	90	93	91	89	88																			
4	102	97	92	89	101	95	91	88	93	90	87	92	89	86	90	87	85	84																			
5	99	92	88	84	97	91	87	84	90	86	83	88	85	83	87	84	82	81																			
6	95	88	84	80	94	88	83	80	86	82	80	85	82	79	84	81	79	77																			
7	92	85	80	77	91	84	80	77	83	79	76	82	79	76	81	78	76	74																			
8	89	82	77	74	88	81	77	74	80	76	73	79	76	73	78	75	73	72																			
9	86	79	74	71	85	78	74	71	77	73	71	76	73	70	76	72	70	69																			
10	83	76	71	68	82	75	71	68	75	71	68	74	70	68	73	70	68	67																			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	2035987
5°	2026095
10°	1915099
15°	1628076
20°	1109650
25°	462995
30°	145580
35°	67665
40°	37412
45°	17152
50°	8329
55°	4553
60°	2382
65°	853
70°	351
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 17152 cd/sqm



TEST NUMBER: P793869

CATALOG NUMBER: LER6D55D010-EC6DR4055659050-6LBS1LI

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	1724.9	21.6
10°-20°	3864.3	48.3
20°-30°	1934.3	24.2
30°-40°	354.6	4.4
40°-50°	97.8	1.2
50°-60°	23.0	0.3
60°-70°	4.4	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	7523.5	94.0
0°-40°	7878.1	98.4
0°-60°	7998.9	99.9
0°-90°	8003.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	8003.5	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	18634	
5°	18473	###
15°	14393	3864
25°	3840	1934
35°	507	355
45°	111	98
55°	24	23
65°	3	4
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P793869

CATALOG NUMBER: LER6D55D010-EC6DR4055659050-6LBS1LI

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	18634.2
2.5°	18607.0
5°	18473.1
7.5°	18046.4
10°	17261.5
12.5°	16038.0
15°	14393.1
17.5°	12254.1
20°	9543.5
22.5°	6506.4
25°	3840.5
27.5°	2030.2
30°	1153.9
32.5°	745.7
35°	507.3
37.5°	362.5
40°	262.3
42.5°	179.6
45°	111.0
47.5°	70.8
50°	49.0
52.5°	34.8
55°	23.9
57.5°	15.2
60°	10.9
62.5°	6.5
65°	3.3
67.5°	2.2
70°	1.1
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)