

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P793894

Luminaire Tested: LER6D55D010-EC6DR4555659030-6LBS1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P793894
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D55D010-EC6DR4555659030-6LBS1MW
Description: 6 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 6665.4 lumens
Efficiency: N/A
Efficacy: 114.5 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 58.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P793894

CATALOG NUMBER: LER6D55D010-EC6DR4555659030-6LBS1MW

Luminous Intensity Polar Plot

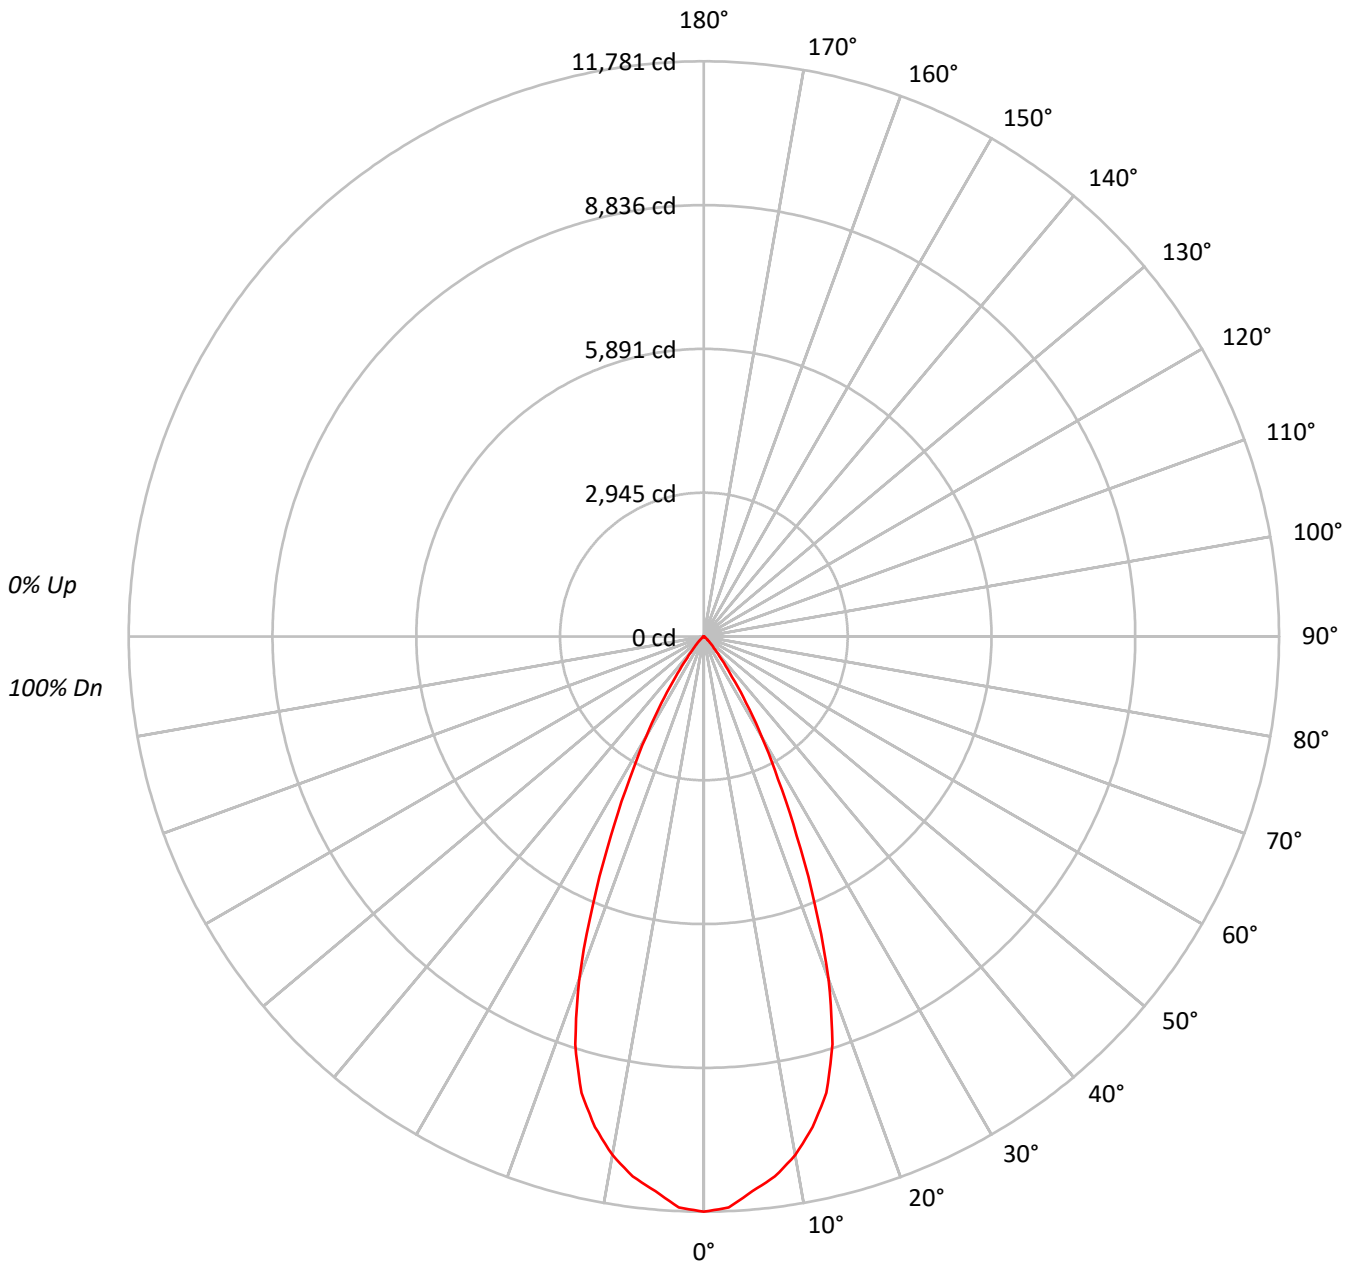



TEST NUMBER: P793894

CATALOG NUMBER: LER6D55D010-EC6DR4555659030-6LBS1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95			95																
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90			90																
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85			85																
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81			81																
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77			77																
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73			73																
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69			69																
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66			66																
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63			63																
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60			60																

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1287234
5°	1250583
10°	1196467
15°	1095022
20°	868733
25°	542357
30°	298932
35°	134223
40°	52873
45°	24908
50°	11814
55°	6172
60°	3037
65°	724
70°	288
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 24908 cd/sqm



TEST NUMBER: P793894

CATALOG NUMBER: LER6D55D010-EC6DR4555659030-6LBS1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1071.4	16.1
10°-20°	2636.7	39.6
20°-30°	2088.0	31.3
30°-40°	695.3	10.4
40°-50°	138.0	2.1
50°-60°	31.3	0.5
60°-70°	4.5	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5796.1	87.0
0°-40°	6491.4	97.4
0°-60°	6660.8	99.9
0°-90°	6665.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6665.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	11781	
5°	11402	###
15°	9681	2637
25°	4499	2088
35°	1006	695
45°	161	138
55°	32	31
65°	3	5
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P793894

CATALOG NUMBER: LER6D55D010-EC6DR4555659030-6LBS1MW

CANDELA DISTRIBUTION (FULL):

0°	
0°	11781.3
2.5°	11704.4
5°	11402.3
7.5°	11153.0
10°	10784.2
12.5°	10293.1
15°	9680.6
17.5°	8759.5
20°	7471.5
22.5°	5937.0
25°	4498.8
27.5°	3294.2
30°	2369.4
32.5°	1611.4
35°	1006.3
37.5°	596.8
40°	370.7
42.5°	243.7
45°	161.2
47.5°	103.8
50°	69.5
52.5°	46.3
55°	32.4
57.5°	21.3
60°	13.9
62.5°	7.4
65°	2.8
67.5°	0.9
70°	0.9
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)