

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P793964

Luminaire Tested: LER6D55D010-EC6DR5055659050-6LBS1H

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P793964
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-44)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D55D010-EC6DR5055659050-6LBS1H
Description: 6 INCH ROUND SHALLOW SEMI-SPECULAR CLEAR TRIM, WITH 50° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 7574.3 lumens
Efficiency: N/A
Efficacy: 130.1 lumens/watt
Spacing Criteria (0/90/45): 0.8 / 0.8 / 0.73
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 58.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P793964

CATALOG NUMBER: LER6D55D010-EC6DR5055659050-6LBS1H

Luminous Intensity Polar Plot

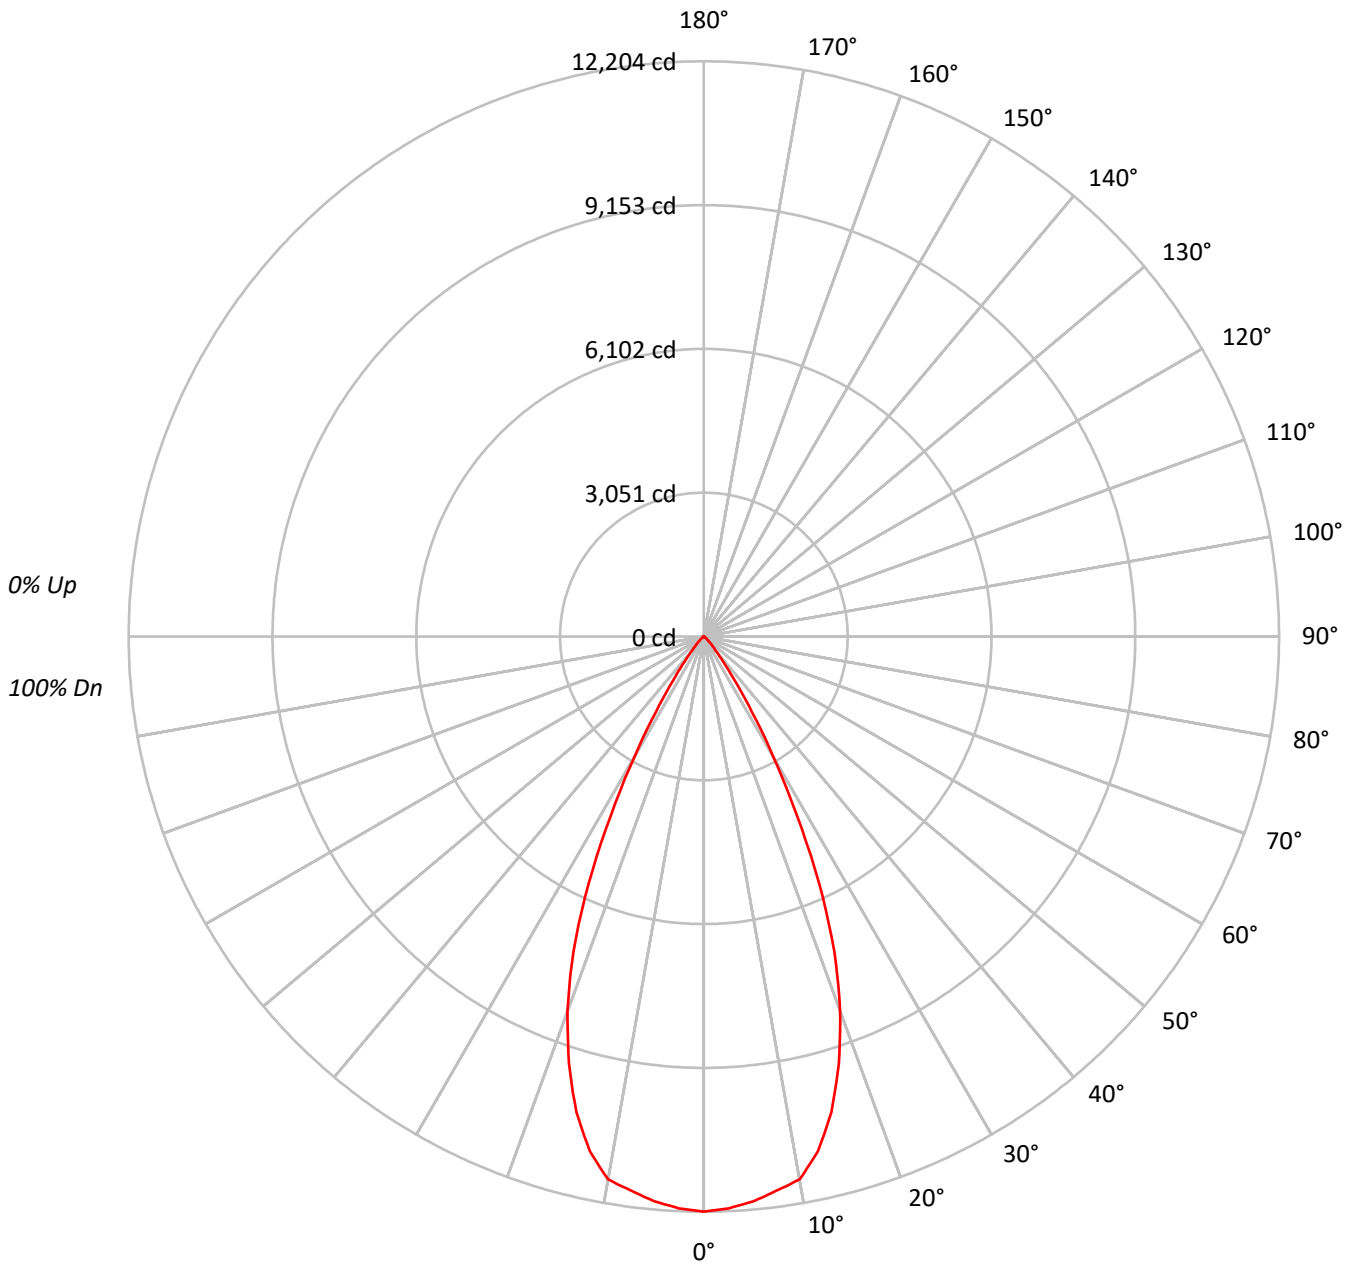



TEST NUMBER: P793964

CATALOG NUMBER: LER6D55D010-EC6DR5055659050-6LBS1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	114	112	109	107	112	110	108	106	106	104	102	102	101	99	98	97	97	95						95													
2	109	105	101	98	107	103	100	97	100	98	95	97	95	93	95	93	91	90						90													
3	105	99	95	91	103	98	94	90	95	92	89	93	90	88	91	88	86	85						85													
4	100	94	89	85	99	93	88	85	90	87	84	89	85	83	87	84	82	80						80													
5	96	89	84	80	95	88	83	79	86	82	79	85	81	78	83	80	77	76						76													
6	92	84	79	75	91	83	79	75	82	78	74	81	77	74	79	76	74	72						72													
7	88	80	75	71	87	79	74	71	78	74	71	77	73	70	76	73	70	69						69													
8	85	76	71	67	84	76	71	67	75	70	67	74	70	67	73	69	66	65						65													
9	81	73	68	64	80	72	67	64	71	67	64	71	67	64	70	66	63	62						62													
10	78	70	64	61	77	69	64	61	68	64	61	68	64	61	67	63	60	59						59													

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1333440
5°	1319461
10°	1297728
15°	1181690
20°	983296
25°	697995
30°	369444
35°	150549
40°	55911
45°	25604
50°	10488
55°	5486
60°	2688
65°	801
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 25604 cd/sqm



TEST NUMBER: P793964

CATALOG NUMBER: LER6D55D010-EC6DR5055659050-6LBS1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1137.1	15.0
10°-20°	2873.7	37.9
20°-30°	2581.3	34.1
30°-40°	808.2	10.7
40°-50°	141.5	1.9
50°-60°	28.2	0.4
60°-70°	4.3	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	6592.2	87.0
0°-40°	7400.3	97.7
0°-60°	7570.1	99.9
0°-90°	7574.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7574.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	12204	
5°	12030	###
15°	10447	2874
25°	5790	2581
35°	1129	808
45°	166	142
55°	29	28
65°	3	4
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P793964

CATALOG NUMBER: LER6D55D010-EC6DR5055659050-6LBS1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	12204.2
2.5°	12143.5
5°	12030.3
7.5°	11857.4
10°	11696.9
12.5°	11182.5
15°	10446.8
17.5°	9512.5
20°	8456.8
22.5°	7235.5
25°	5789.8
27.5°	4256.7
30°	2928.3
32.5°	1906.6
35°	1128.7
37.5°	648.2
40°	392.0
42.5°	255.2
45°	165.7
47.5°	100.8
50°	61.7
52.5°	42.2
55°	28.8
57.5°	19.5
60°	12.3
62.5°	7.2
65°	3.1
67.5°	1.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)