

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P794056

Luminaire Tested: LER6D55D010-EC6DR6055659050-6LBDP1H

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P794056
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-57)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D55D010-EC6DR6055659050-6LBDP1H
Description: 6 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 6956.2 lumens
Efficiency: N/A
Efficacy: 119.5 lumens/watt
Spacing Criteria (0/90/45): 0.91 / 0.91 / 0.83
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 58.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P794056
CATALOG NUMBER: LER6D55D010-EC6DR6055659050-6LBDP1H

Luminous Intensity Polar Plot

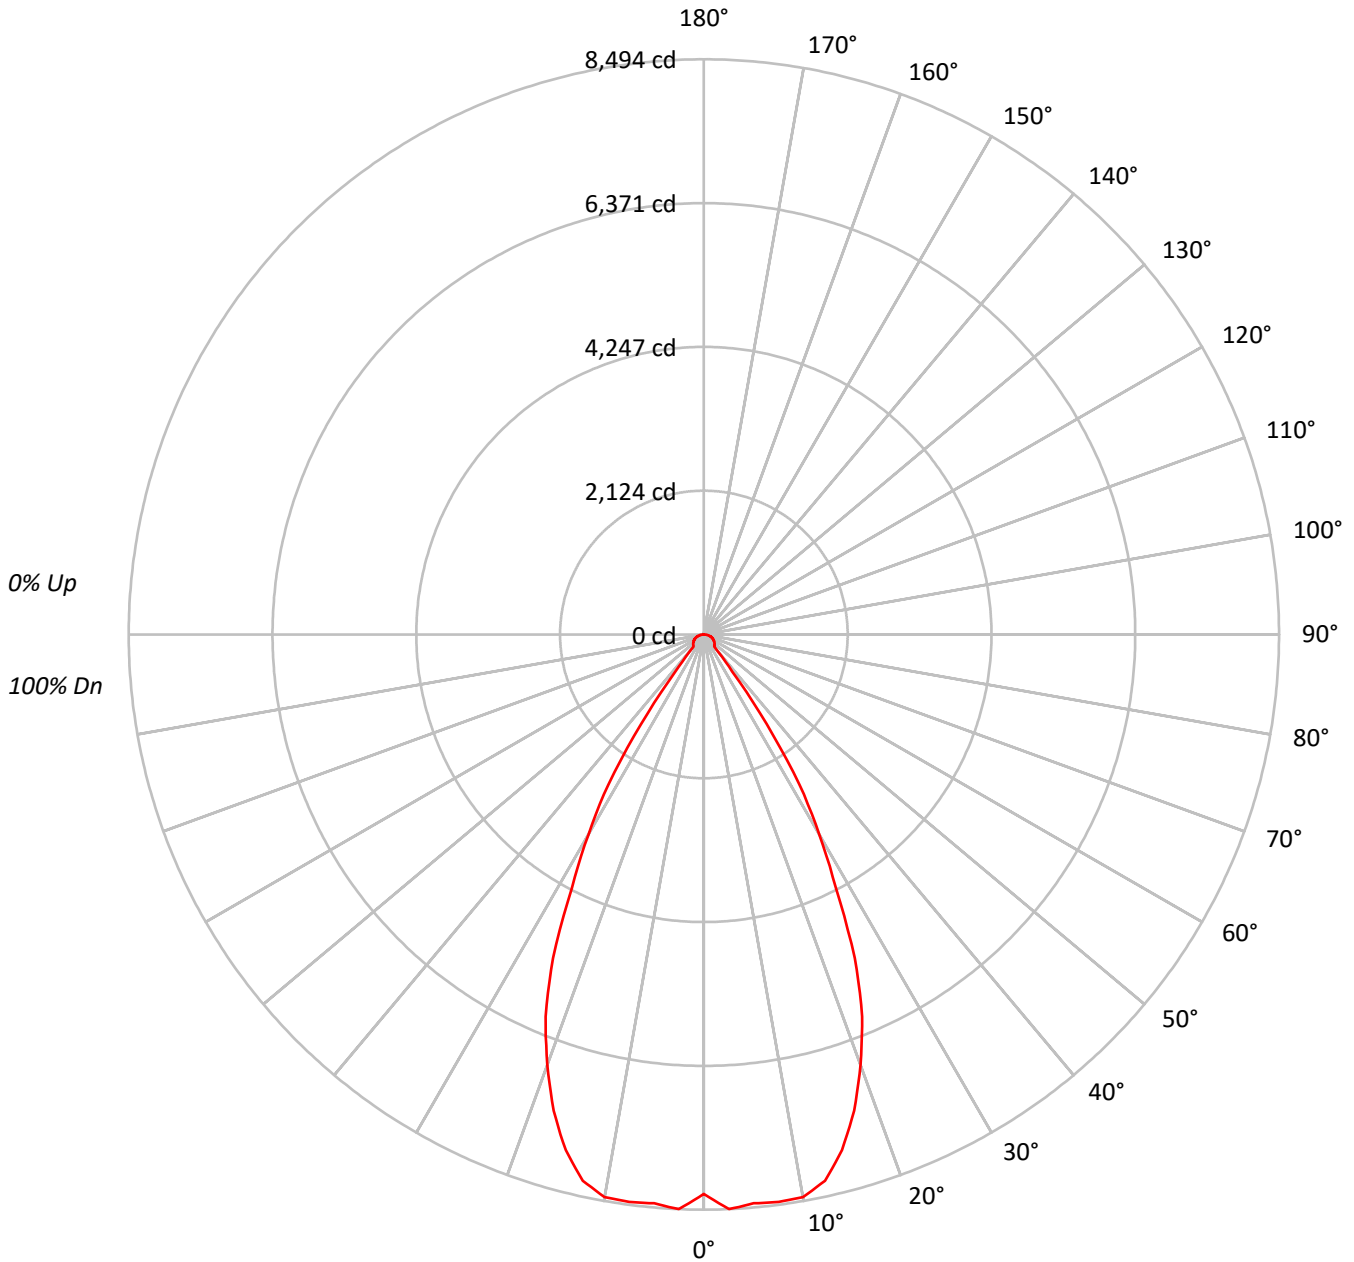



TEST NUMBER: P794056

CATALOG NUMBER: LER6D55D010-EC6DR6055659050-6LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | | | | |
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | | | 0 | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 |
| RCR | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | 100 | 100 | 100 |
| 1 | 113 | 110 | 108 | 105 | 111 | 108 | 106 | 104 | 104 | 102 | 100 | 100 | 99 | 97 | 97 | 96 | 95 | 93 | 93 | 93 | 93 |
| 2 | 107 | 102 | 98 | 95 | 105 | 101 | 97 | 94 | 97 | 94 | 92 | 94 | 92 | 90 | 92 | 90 | 88 | 86 | 86 | 86 | 86 |
| 3 | 102 | 96 | 90 | 86 | 100 | 94 | 89 | 86 | 91 | 88 | 84 | 89 | 86 | 83 | 87 | 84 | 82 | 80 | 80 | 80 | 80 |
| 4 | 97 | 89 | 84 | 80 | 95 | 88 | 83 | 79 | 86 | 82 | 78 | 84 | 80 | 77 | 82 | 79 | 76 | 75 | 75 | 75 | 75 |
| 5 | 92 | 84 | 78 | 74 | 91 | 83 | 78 | 74 | 81 | 77 | 73 | 80 | 76 | 72 | 78 | 75 | 72 | 70 | 70 | 70 | 70 |
| 6 | 88 | 79 | 73 | 69 | 87 | 78 | 73 | 69 | 77 | 72 | 68 | 75 | 71 | 68 | 74 | 70 | 67 | 66 | 66 | 66 | 66 |
| 7 | 84 | 75 | 69 | 65 | 83 | 74 | 68 | 64 | 73 | 68 | 64 | 72 | 67 | 64 | 71 | 67 | 63 | 62 | 62 | 62 | 62 |
| 8 | 80 | 71 | 65 | 61 | 79 | 70 | 65 | 61 | 69 | 64 | 60 | 68 | 64 | 60 | 67 | 63 | 60 | 59 | 59 | 59 | 59 |
| 9 | 77 | 67 | 61 | 57 | 75 | 67 | 61 | 57 | 66 | 61 | 57 | 65 | 60 | 57 | 64 | 60 | 57 | 55 | 55 | 55 | 55 |
| 10 | 73 | 64 | 58 | 54 | 72 | 63 | 58 | 54 | 62 | 58 | 54 | 62 | 57 | 54 | 61 | 57 | 54 | 53 | 53 | 53 | 53 |

AVERAGE LUMINANCE (cd/sqm):

| | |
|-----|--------|
| | 0° |
| 0° | 902636 |
| 5° | 924839 |
| 10° | 936009 |
| 15° | 891675 |
| 20° | 786179 |
| 25° | 635884 |
| 30° | 430116 |
| 35° | 215533 |
| 40° | 34959 |
| 45° | 34226 |
| 50° | 34914 |
| 55° | 35431 |
| 60° | 36406 |
| 65° | 37255 |
| 70° | 38111 |
| 75° | 38585 |
| 80° | 37186 |
| 85° | 30965 |

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 75°
 Luminance: 38585 cd/sqm



TEST NUMBER: P794056

CATALOG NUMBER: LER6D55D010-EC6DR6055659050-6LBDP1H

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 805.9 | 11.6 |
| 10°-20° | 2180.5 | 31.3 |
| 20°-30° | 2346.0 | 33.7 |
| 30°-40° | 1019.7 | 14.7 |
| 40°-50° | 171.3 | 2.5 |
| 50°-60° | 166.5 | 2.4 |
| 60°-70° | 142.4 | 2.0 |
| 70°-80° | 95.3 | 1.4 |
| 80°-90° | 28.5 | 0.4 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 5332.3 | 76.7 |
| 0°-40° | 6352.1 | 91.3 |
| 0°-60° | 6689.9 | 96.2 |
| 0°-90° | 6956.2 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 6956.2 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 8261 | |
| 5° | 8432 | 806 |
| 15° | 7883 | 2180 |
| 25° | 5275 | 2346 |
| 35° | 1616 | 1020 |
| 45° | 222 | 171 |
| 55° | 186 | 167 |
| 65° | 144 | 142 |
| 75° | 91 | 95 |
| 85° | 25 | 28 |
| 90° | 0 | |



TEST NUMBER: P794056

CATALOG NUMBER: LER6D55D010-EC6DR6055659050-6LBDP1H

CANDELA DISTRIBUTION (FULL):

| 0° | |
|-------|--------|
| 0° | 8261.3 |
| 2.5° | 8493.6 |
| 5° | 8432.3 |
| 7.5° | 8451.6 |
| 10° | 8436.6 |
| 12.5° | 8262.4 |
| 15° | 7882.9 |
| 17.5° | 7373.3 |
| 20° | 6761.5 |
| 22.5° | 6106.8 |
| 25° | 5274.6 |
| 27.5° | 4218.8 |
| 30° | 3409.2 |
| 32.5° | 2627.6 |
| 35° | 1615.9 |
| 37.5° | 691.3 |
| 40° | 245.1 |
| 42.5° | 225.8 |
| 45° | 221.5 |
| 47.5° | 214.0 |
| 50° | 205.4 |
| 52.5° | 195.7 |
| 55° | 186.0 |
| 57.5° | 176.3 |
| 60° | 166.6 |
| 62.5° | 155.9 |
| 65° | 144.1 |
| 67.5° | 132.2 |
| 70° | 119.3 |
| 72.5° | 105.4 |
| 75° | 91.4 |
| 77.5° | 75.3 |
| 80° | 59.1 |
| 82.5° | 41.9 |
| 85° | 24.7 |
| 87.5° | 8.6 |
| 90° | 0.0 |

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)