

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P794089

Luminaire Tested: LER6D55D010-EC6DR6555659035-6LBDP1LI

Issue Date: 2/5/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P794089  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/5/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D55D010-EC6DR6555659035-6LBDDP1LI  
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 65° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 6053.6 lumens  
Efficiency: N/A  
Efficacy: 104.0 lumens/watt  
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 58.2  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight

TEST NUMBER: P794089

CATALOG NUMBER: LER6D55D010-EC6DR6555659035-6LBDP1LI

### Luminous Intensity Polar Plot

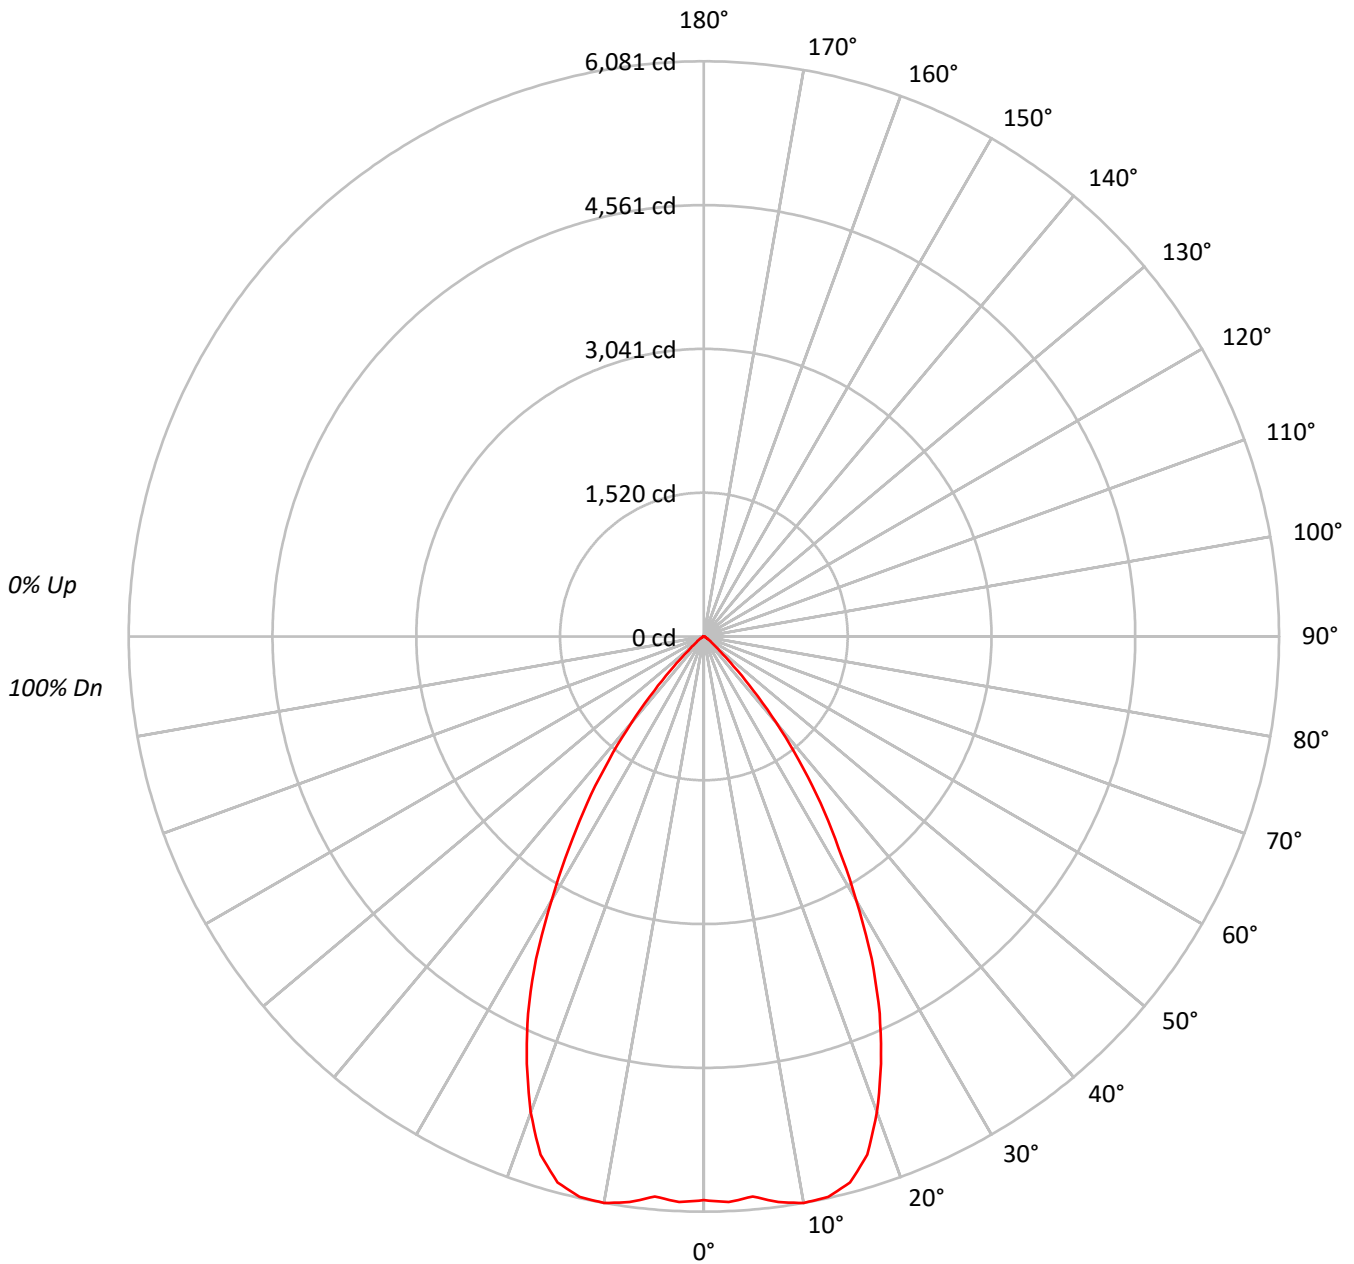



TEST NUMBER: P794089

CATALOG NUMBER: LER6D55D010-EC6DR6555659035-6LBDP1LI

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93																			
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87																			
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80																			
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75																			
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69																			
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65																			
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60																			
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57																			
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53																			
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50																			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	651227
5°	651762
10°	674709
15°	675829
20°	622211
25°	530157
30°	405855
35°	286733
40°	169245
45°	68714
50°	24902
55°	13868
60°	7954
65°	4369
70°	4600
75°	3588
80°	3712
85°	3134

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 68714 cd/sqm



TEST NUMBER: P794089

CATALOG NUMBER: LER6D55D010-EC6DR6555659035-6LBDP1LI

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	573.9	9.5
10°-20°	1655.5	27.3
20°-30°	1986.3	32.8
30°-40°	1334.9	22.1
40°-50°	399.6	6.6
50°-60°	70.5	1.2
60°-70°	20.0	0.3
70°-80°	9.8	0.2
80°-90°	3.1	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4215.7	69.6
0°-40°	5550.6	91.7
0°-60°	6020.7	99.5
0°-90°	6053.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6053.6	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	5960	
5°	5942	574
15°	5975	1656
25°	4398	1986
35°	2150	1335
45°	445	400
55°	73	70
65°	17	20
75°	8	10
85°	2	3
90°	0	



TEST NUMBER: P794089

CATALOG NUMBER: LER6D55D010-EC6DR6555659035-6LBDP1LI

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	5960.3
2.5°	5985.7
5°	5942.5
7.5°	6032.3
10°	6081.4
12.5°	6069.6
15°	5974.7
17.5°	5742.6
20°	5351.3
22.5°	4890.5
25°	4397.6
27.5°	3841.1
30°	3216.9
32.5°	2651.1
35°	2149.7
37.5°	1654.2
40°	1186.6
42.5°	775.0
45°	444.7
47.5°	235.5
50°	146.5
52.5°	101.6
55°	72.8
57.5°	52.5
60°	36.4
62.5°	23.7
65°	16.9
67.5°	15.2
70°	14.4
72.5°	11.0
75°	8.5
77.5°	7.6
80°	5.9
82.5°	4.2
85°	2.5
87.5°	1.7
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)