

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P794178

Luminaire Tested: LER6D60D010-EC6DR2555659030-6LBDP1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P794178
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-4)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D60D010-EC6DR2555659030-6LB DP1MW
Description: 6 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 25° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5665.3 lumens
Efficiency: N/A
Efficacy: 88.0 lumens/watt
Spacing Criteria (0/90/45): 0.42 / 0.42 / 0.45
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 64.4
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P794178
CATALOG NUMBER: LER6D60D010-EC6DR2555659030-6LBDP1MW

Luminous Intensity Polar Plot

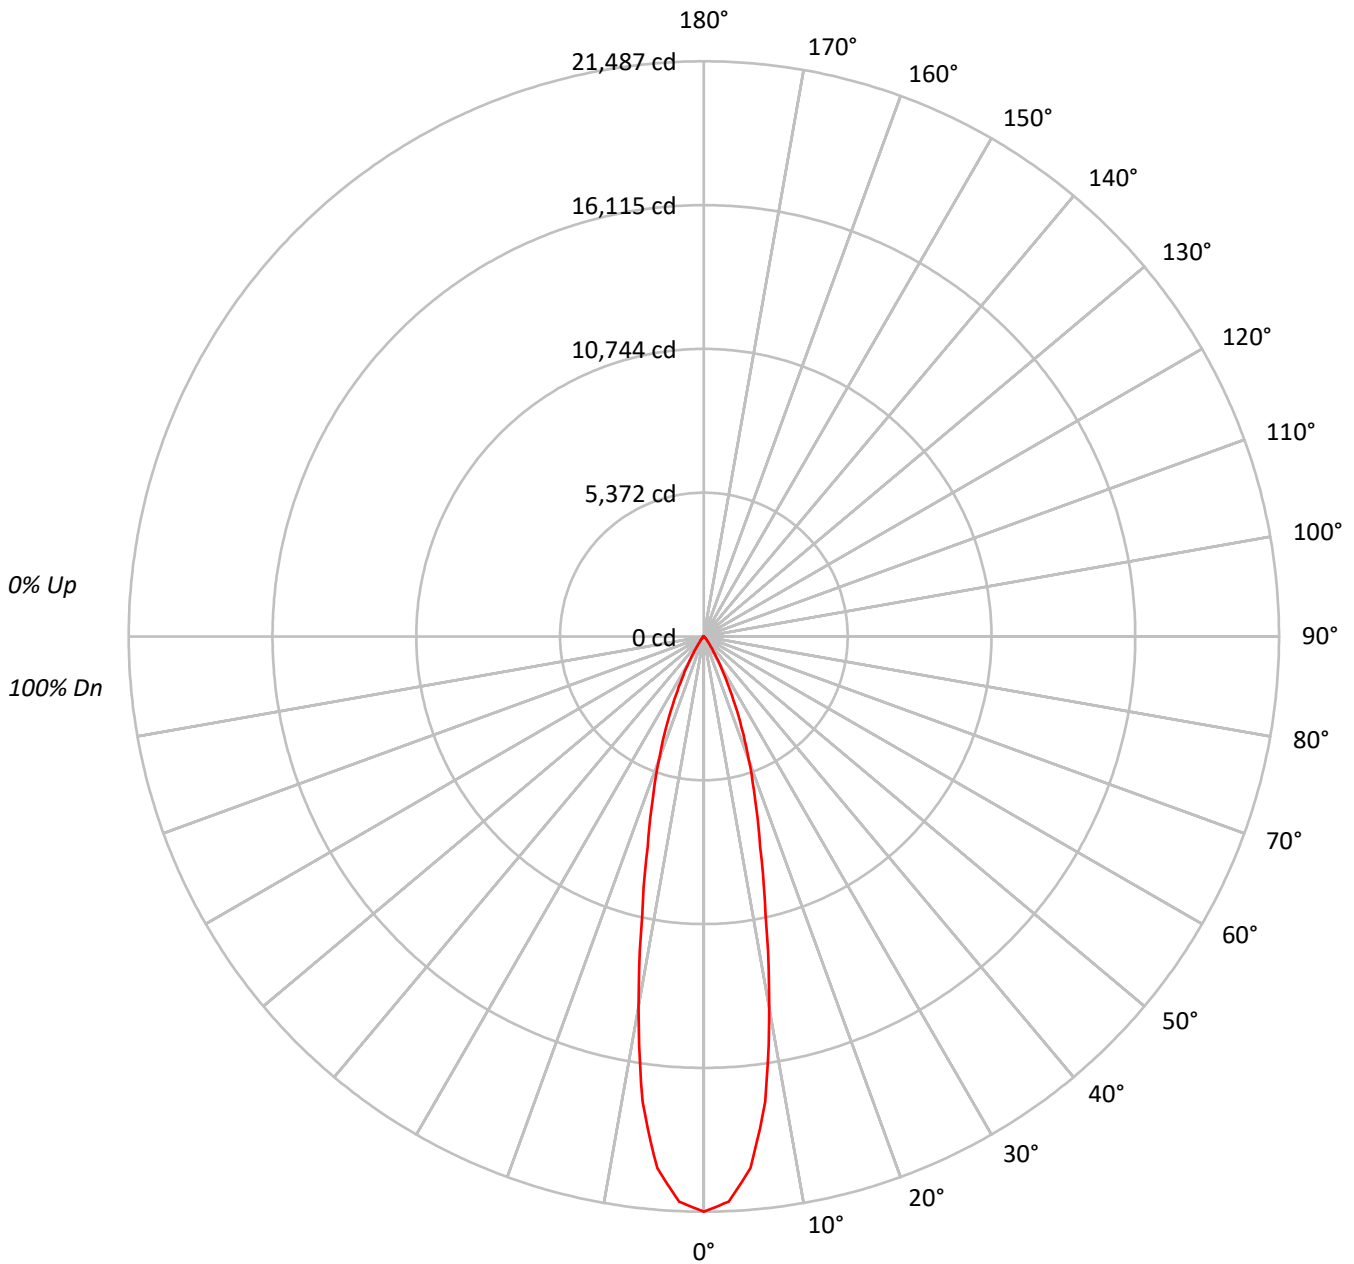



TEST NUMBER: P794178

CATALOG NUMBER: LER6D60D010-EC6DR2555659030-6LBDP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20																	
RC	80									50									30									10									0								
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0															
RCR																																													
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																											
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96																											
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92																											
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89																											
4	103	97	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85																											
5	100	93	89	86	98	93	89	86	91	87	85	89	86	84	88	85	83	82																											
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79																											
7	93	87	82	79	92	86	82	79	85	81	78	84	80	78	83	80	78	77																											
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74																											
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72																											
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69																											

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2347697
5°	2186587
10°	1559749
15°	918630
20°	571586
25°	313686
30°	143460
35°	54327
40°	24604
45°	14787
50°	6136
55°	3962
60°	2753
65°	1861
70°	288
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 14787 cd/sqm



TEST NUMBER: P794178

CATALOG NUMBER: LER6D60D010-EC6DR2555659030-6LBDP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1713.4	30.2
10°-20°	2320.6	41.0
20°-30°	1228.0	21.7
30°-40°	303.1	5.4
40°-50°	74.0	1.3
50°-60°	19.5	0.3
60°-70°	6.5	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5262.1	92.9
0°-40°	5565.2	98.2
0°-60°	5658.6	99.9
0°-90°	5665.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5665.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	21487	
5°	19936	###
15°	8121	2321
25°	2602	1228
35°	407	303
45°	96	74
55°	21	19
65°	7	7
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P794178

CATALOG NUMBER: LER6D60D010-EC6DR2555659030-6LBDP1MW

CANDELA DISTRIBUTION (FULL):

0°	
0°	21487.1
2.5°	21134.0
5°	19936.4
7.5°	17530.4
10°	14058.6
12.5°	10627.5
15°	8121.2
17.5°	6329.4
20°	4915.9
22.5°	3686.7
25°	2602.0
27.5°	1744.9
30°	1137.1
32.5°	691.8
35°	407.3
37.5°	249.3
40°	172.5
42.5°	131.9
45°	95.7
47.5°	57.8
50°	36.1
52.5°	26.2
55°	20.8
57.5°	16.3
60°	12.6
62.5°	9.9
65°	7.2
67.5°	2.7
70°	0.9
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)