

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P794236

Luminaire Tested: LER6D60D010-EC6DR3055659035-6LBS1H

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P794236
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-16)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D60D010-EC6DR3055659035-6LBS1H
Description: 6 INCH ROUND SHALLOW SEMI-SPECULAR CLEAR TRIM, WITH 30° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 7437.3 lumens
Efficiency: N/A
Efficacy: 115.5 lumens/watt
Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.49
Luminous Opening: Rectangular (W 0.38' x L: 0.38' x H: 0')
CIE Type: Direct

Input Watts (W): 64.4
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P794236

CATALOG NUMBER: LER6D60D010-EC6DR3055659035-6LBS1H

Luminous Intensity Polar Plot

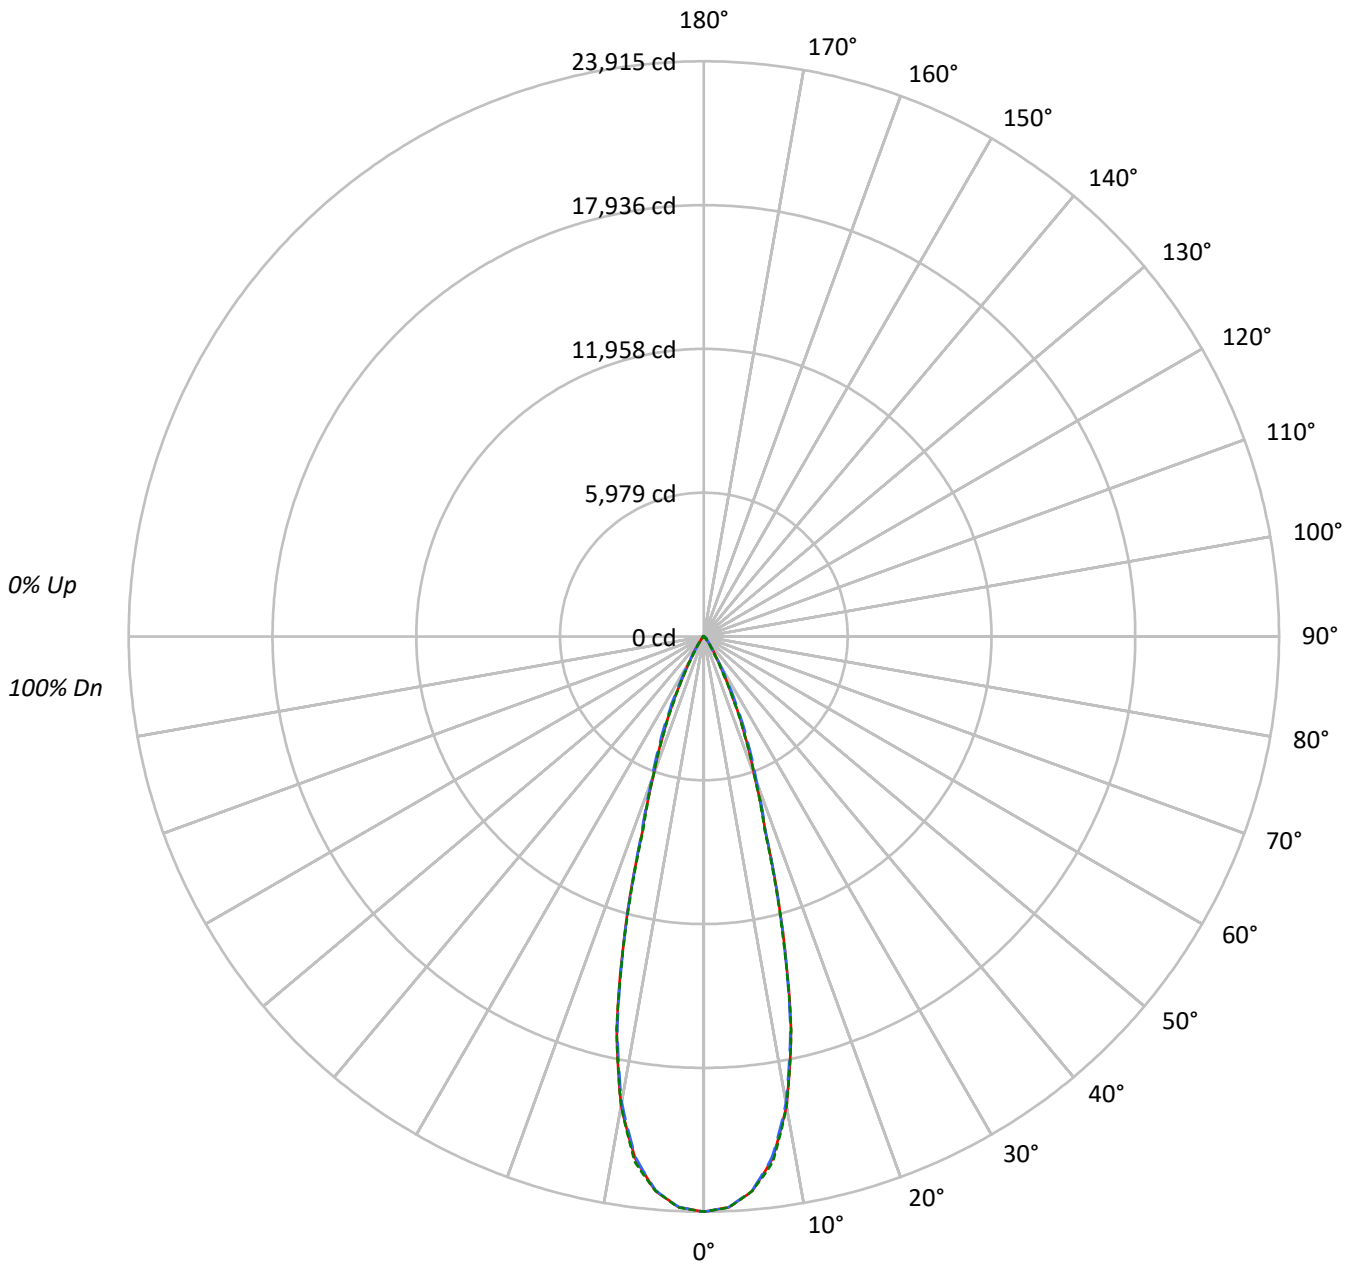



TEST NUMBER: P794236

CATALOG NUMBER: LER6D60D010-EC6DR3055659035-6LBS1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96																			
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92																			
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89																			
4	103	98	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85																			
5	100	94	89	86	98	93	89	86	91	88	85	90	86	84	88	86	83	82																			
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79																			
7	94	87	82	79	92	86	82	79	85	81	78	84	81	78	83	80	78	77																			
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74																			
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72																			
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69																			

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1830512	1830512	1830512
5°	1777965	1775890	1778057
10°	1539988	1529130	1539623
15°	1004769	999372	994348
20°	499625	518368	498957
25°	251671	283807	246519
30°	100767	109791	87793
35°	46740	44759	37526
40°	20184	22412	19005
45°	14235	17666	14365
50°	4894	12861	5168
55°	2816	5325	2976
60°	1975	2342	1975
65°	1268	1268	1268
70°	783	515	783
75°	0	355	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 22.5°

Vertical Angle: 45°

Luminance: 17666 cd/sqm



TEST NUMBER: P794236

CATALOG NUMBER: LER6D60D010-EC6DR3055659035-6LBS1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	2102.9	28.3
10°-20°	3386.8	45.5
20°-30°	1463.5	19.7
30°-40°	333.6	4.5
40°-50°	114.5	1.5
50°-60°	28.0	0.4
60°-70°	7.2	0.1
70°-80°	0.8	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	6953.3	93.5
0°-40°	7286.8	98.0
0°-60°	7429.3	99.9
0°-90°	7437.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7437.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	23915	23915	23915	23915	23915	
5°	23140	23118	23113	23161	23141	2105
15°	12680	12527	12611	12570	12548	3395
25°	2980	3093	3360	3014	2919	1426
35°	500	511	479	476	402	339
45°	132	163	163	163	133	93
55°	21	22	40	24	22	21
65°	7	7	7	7	7	7
75°	0	0	1	0	0	1
85°	0	0	0	0	0	0
90°	0	0	0	0	0	0



TEST NUMBER: P794236

CATALOG NUMBER: LER6D60D010-EC6DR3055659035-6LBS1H

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	23914.7	23914.7	23914.7	23914.7	23914.7
2.5°	23756.2	23739.8	23749.2	23760.9	23765.6
5°	23139.8	23117.5	23112.8	23160.9	23141.0
7.5°	21896.4	21864.7	21816.6	21925.8	22027.9
10°	19813.5	19778.3	19673.8	19725.4	19808.8
12.5°	16738.4	16624.5	16622.2	16786.6	16764.3
15°	12679.5	12526.8	12611.4	12570.3	12548.0
17.5°	8526.6	8467.8	8580.6	8546.5	8399.7
20°	6133.7	6148.9	6363.8	6255.8	6125.5
22.5°	4475.8	4531.0	4785.8	4507.5	4405.3
25°	2979.9	3092.7	3360.4	3014.0	2918.9
27.5°	1832.8	1884.5	2155.7	1809.3	1757.7
30°	1140.1	1114.3	1242.2	1066.1	993.3
32.5°	747.9	715.0	756.1	678.6	619.9
35°	500.2	510.7	479.0	475.5	401.6
37.5°	312.3	359.3	317.0	338.2	258.3
40°	202.0	260.7	224.3	247.7	190.2
42.5°	165.6	200.8	184.3	196.1	169.1
45°	131.5	163.2	163.2	163.2	132.7
47.5°	72.8	109.2	139.7	111.5	77.5
50°	41.1	55.2	108.0	57.5	43.4
52.5°	28.2	31.7	74.0	32.9	29.4
55°	21.1	22.3	39.9	23.5	22.3
57.5°	16.4	17.6	21.1	17.6	16.4
60°	12.9	12.9	15.3	14.1	12.9
62.5°	9.4	9.4	10.6	9.4	9.4
65°	7.0	7.0	7.0	7.0	7.0
67.5°	3.5	4.7	4.7	4.7	4.7
70°	3.5	2.3	2.3	2.3	3.5
72.5°	2.3	1.2	1.2	1.2	1.2
75°	0.0	0.0	1.2	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)