

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P794437

Luminaire Tested: LER6D60D010-EC6DR5055659040-6LBS1LI

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P794437  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-44)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D60D010-EC6DR5055659040-6LBS1LI  
Description: 6 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 50° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 8683.5 lumens  
Efficiency: N/A  
Efficacy: 134.8 lumens/watt  
Spacing Criteria (0/90/45): 0.8 / 0.8 / 0.73  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct


Input Watts (W): 64.4  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



Downlight

TEST NUMBER: P794437  
CATALOG NUMBER: LER6D60D010-EC6DR5055659040-6LBS1LI

### Luminous Intensity Polar Plot

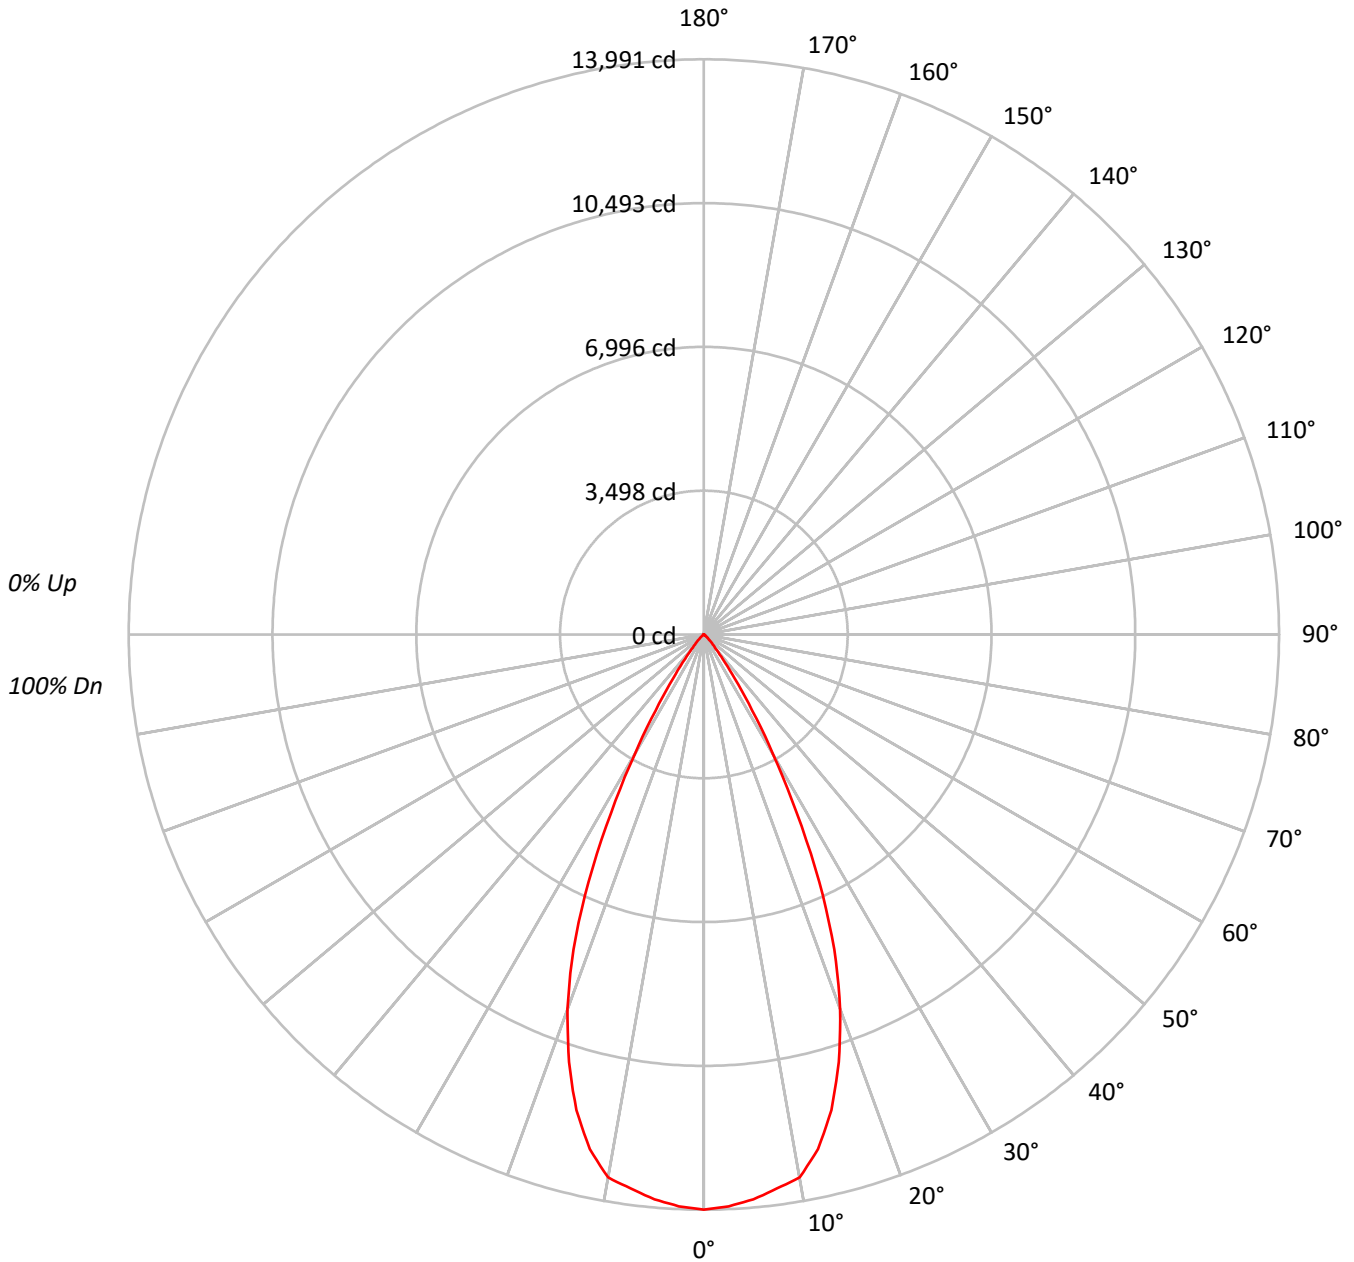



TEST NUMBER: P794437

CATALOG NUMBER: LER6D60D010-EC6DR5055659040-6LBS1LI

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	114	112	109	107	112	110	108	106	106	104	102	102	101	99	98	97	97	95																			
2	109	105	101	98	107	103	100	97	100	98	95	97	95	93	95	93	91	90																			
3	105	99	95	91	103	98	94	90	95	92	89	93	90	88	91	88	86	85																			
4	100	94	89	85	99	93	88	85	90	87	84	89	85	83	87	84	82	80																			
5	96	89	84	80	95	88	83	79	86	82	79	85	81	78	83	80	77	76																			
6	92	84	79	75	91	83	79	75	82	78	74	81	77	74	79	76	74	72																			
7	88	80	75	71	87	79	74	71	78	74	71	77	73	70	76	73	70	69																			
8	85	76	71	67	84	76	71	67	75	70	67	74	70	67	73	69	66	65																			
9	81	73	68	64	80	72	67	64	71	67	64	71	67	64	70	66	63	62																			
10	78	70	64	61	77	69	64	61	68	64	61	68	64	61	67	63	60	59																			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	1528700
5°	1512681
10°	1487767
15°	1354722
20°	1127289
25°	800202
30°	423556
35°	172597
40°	64098
45°	29343
50°	12035
55°	6286
60°	3103
65°	905
70°	0
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 29343 cd/sqm



TEST NUMBER: P794437

CATALOG NUMBER: LER6D60D010-EC6DR5055659040-6LBS1LI

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	1303.6	15.0
10°-20°	3294.5	37.9
20°-30°	2959.3	34.1
30°-40°	926.6	10.7
40°-50°	162.2	1.9
50°-60°	32.3	0.4
60°-70°	4.9	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	7557.5	87.0
0°-40°	8484.0	97.7
0°-60°	8678.6	99.9
0°-90°	8683.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	8683.5	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	13991	
5°	13792	###
15°	11976	3295
25°	6638	2959
35°	1294	927
45°	190	162
55°	33	32
65°	4	5
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P794437

CATALOG NUMBER: LER6D60D010-EC6DR5055659040-6LBS1LI

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	13991.3
2.5°	13921.7
5°	13792.0
7.5°	13593.8
10°	13409.8
12.5°	12820.0
15°	11976.5
17.5°	10905.5
20°	9695.2
22.5°	8295.0
25°	6637.6
27.5°	4880.0
30°	3357.2
32.5°	2185.8
35°	1294.0
37.5°	743.2
40°	449.4
42.5°	292.5
45°	189.9
47.5°	115.6
50°	70.8
52.5°	48.4
55°	33.0
57.5°	22.4
60°	14.2
62.5°	8.3
65°	3.5
67.5°	1.2
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)