

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P794588

Luminaire Tested: LER6D60D010-EC6DR6555659050-6LBS1H

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P794588
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-147)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D60D010-EC6DR6555659050-6LBS1H
Description: 6 INCH ROUND SHALLOW SEMI-SPECULAR CLEAR TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 7035.5 lumens
Efficiency: N/A
Efficacy: 109.2 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.96
Luminous Opening: Circular (Dia: 0.48' x H: 0')
CIE Type: Direct


Input Watts (W): 64.4
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P794588
CATALOG NUMBER: LER6D60D010-EC6DR6555659050-6LBS1H

Luminous Intensity Polar Plot

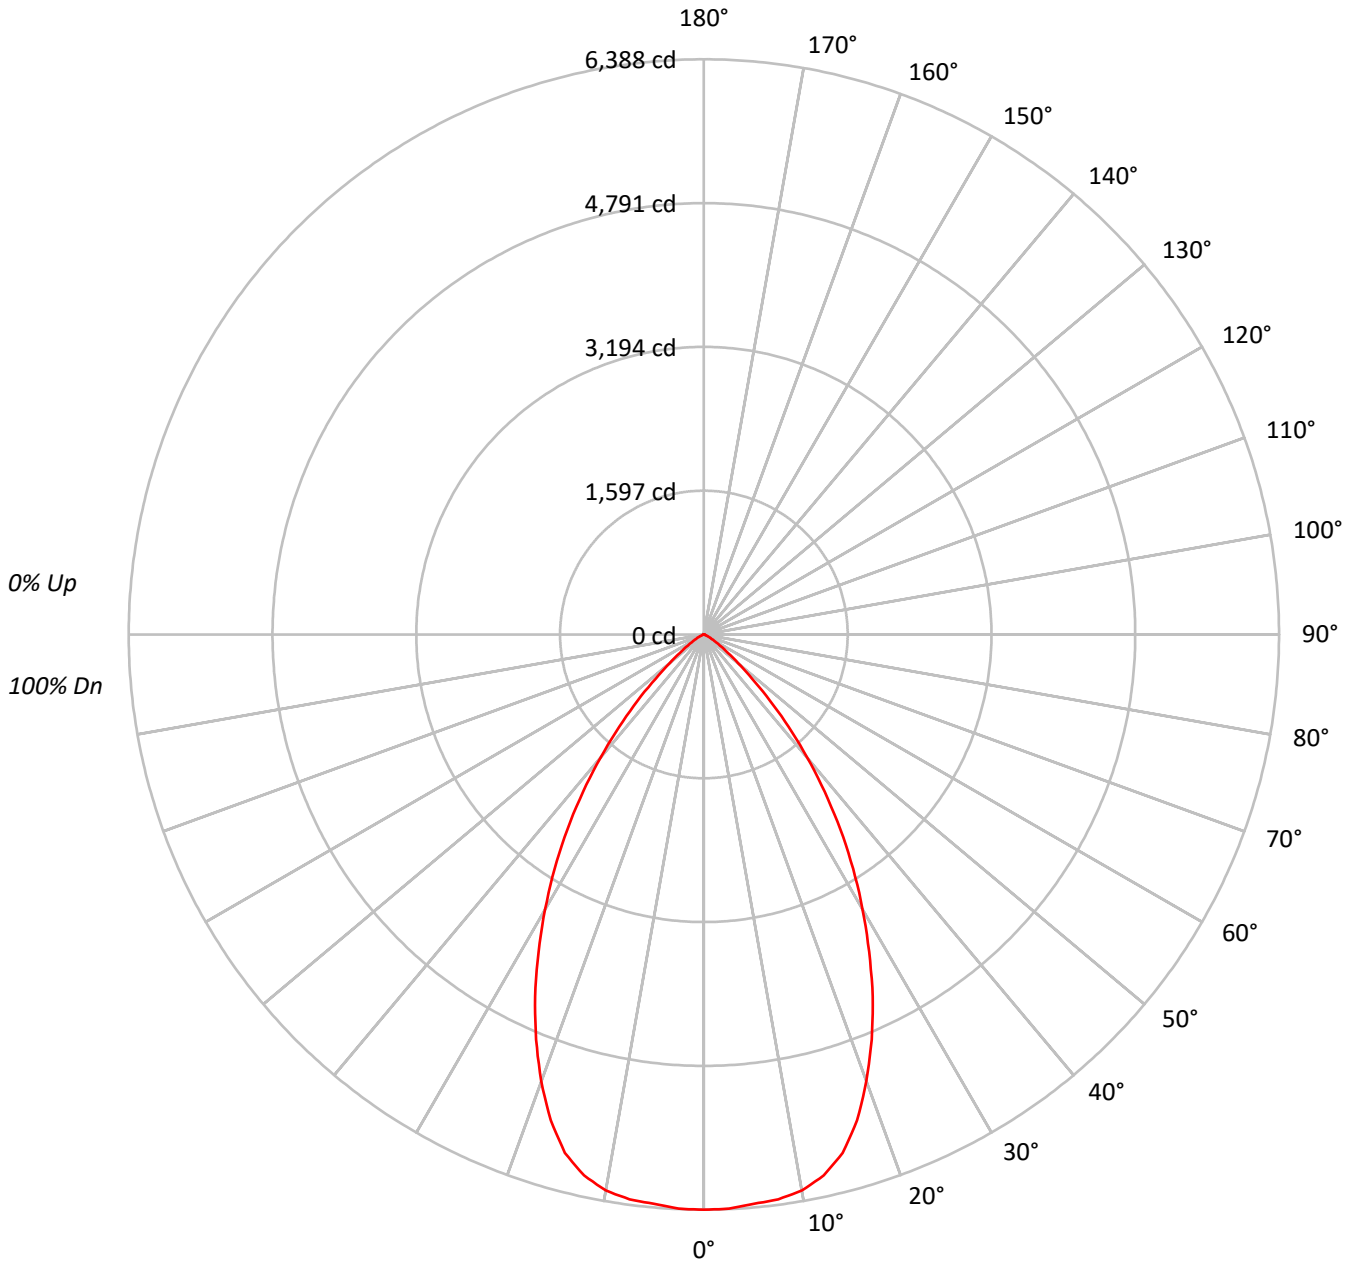



TEST NUMBER: P794588

CATALOG NUMBER: LER6D60D010-EC6DR6555659050-6LBS1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	93
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78
4	95	87	81	76	93	86	80	76	84	79	75	82	77	74	80	76	73	72
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	75	71	68	66
6	85	75	69	64	83	74	68	64	73	67	63	71	67	63	70	66	62	61
7	80	70	64	59	79	69	63	59	68	63	59	67	62	58	66	61	58	56
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54	52
9	72	61	55	51	71	61	55	51	60	54	51	59	54	50	58	54	50	49
10	68	58	52	47	67	57	51	47	57	51	47	56	51	47	55	50	47	46

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	373084
5°	372146
10°	371830
15°	360366
20°	328070
25°	285888
30°	237783
35°	188405
40°	135983
45°	85908
50°	44776
55°	23796
60°	12498
65°	6882
70°	2886
75°	3182
80°	2220
85°	1876

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 85908 cd/sqm



TEST NUMBER: P794588

CATALOG NUMBER: LER6D60D010-EC6DR6555659050-6LBS1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	604.1	8.6
10°-20°	1654.3	23.5
20°-30°	2022.1	28.7
30°-40°	1640.7	23.3
40°-50°	817.6	11.6
50°-60°	228.0	3.2
60°-70°	51.8	0.7
70°-80°	13.5	0.2
80°-90°	3.5	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4280.5	60.8
0°-40°	5921.1	84.2
0°-60°	6966.7	99.0
0°-90°	7035.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7035.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	6388	
5°	6348	604
15°	5960	1654
25°	4436	2022
35°	2642	1641
45°	1040	818
55°	234	228
65°	50	52
75°	14	14
85°	3	3
90°	0	



TEST NUMBER: P794588

CATALOG NUMBER: LER6D60D010-EC6DR6555659050-6LBS1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	6388.0
2.5°	6383.3
5°	6347.7
7.5°	6327.0
10°	6269.8
12.5°	6153.4
15°	5960.0
17.5°	5657.7
20°	5278.5
22.5°	4869.2
25°	4436.4
27.5°	3973.6
30°	3525.9
32.5°	3083.7
35°	2642.5
37.5°	2202.3
40°	1783.6
42.5°	1391.2
45°	1040.1
47.5°	724.7
50°	492.8
52.5°	339.8
55°	233.7
57.5°	157.7
60°	107.0
62.5°	74.2
65°	49.8
67.5°	25.3
70°	16.9
72.5°	16.0
75°	14.1
77.5°	9.4
80°	6.6
82.5°	4.7
85°	2.8
87.5°	1.9
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)