

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P794627

Luminaire Tested: LER6D60D010-EC6DR7055659040-6LBS1B

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P794627  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-76)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D60D010-EC6DR7055659040-6LBS1B  
Description: 6 INCH ROUND SHALLOW SPECULAR BLACK TRIM, WITH 70° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 7490.5 lumens  
Efficiency: N/A  
Efficacy: 116.3 lumens/watt  
Spacing Criteria (0/90/45): 1.1 / 1.1 / 1.04  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 64.4  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight

TEST NUMBER: P794627

CATALOG NUMBER: LER6D60D010-EC6DR7055659040-6LBS1B

### Luminous Intensity Polar Plot

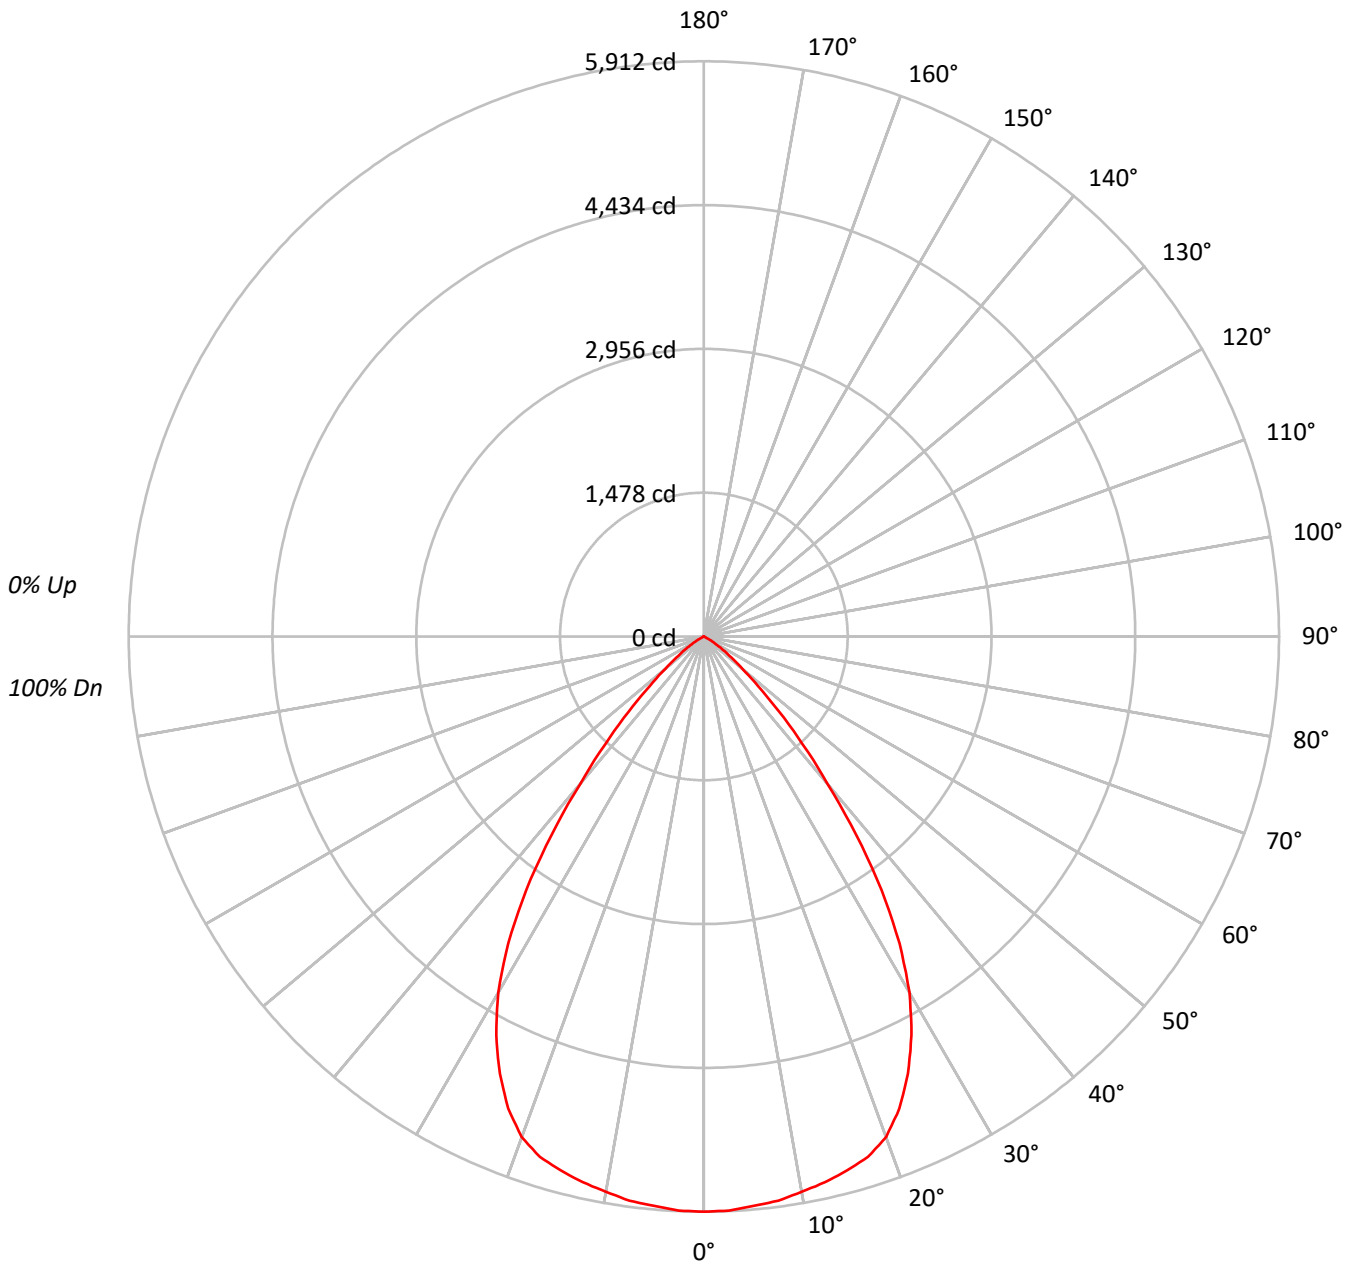



TEST NUMBER: P794627

CATALOG NUMBER: LER6D60D010-EC6DR7055659040-6LBS1B

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	113	110	107	105	111	108	106	103	104	102	100	100	99	97	97	95	94	93			93																
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85			85																
3	101	94	88	84	99	92	87	83	90	85	82	87	84	81	85	82	79	78			78																
4	95	87	81	76	93	86	80	76	83	78	75	81	77	74	79	76	73	71			71																
5	89	80	74	69	88	79	73	69	78	72	68	76	71	68	74	70	67	65			65																
6	84	75	68	63	83	74	68	63	72	67	63	71	66	62	69	65	62	60			60																
7	80	69	63	58	78	69	62	58	67	62	58	66	61	57	65	61	57	56			56																
8	75	65	58	54	74	64	58	54	63	57	53	62	57	53	61	56	53	51			51																
9	71	61	54	50	70	60	54	50	59	53	50	58	53	49	57	53	49	48			48																
10	67	57	50	46	66	56	50	46	55	50	46	55	50	46	54	49	46	44			44																

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	645961
5°	644348
10°	642956
15°	642776
20°	636489
25°	597909
30°	533028
35°	424984
40°	282193
45°	168703
50°	87471
55°	45965
60°	16258
65°	284
70°	0
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 168703 cd/sqm



TEST NUMBER: P794627

CATALOG NUMBER: LER6D60D010-EC6DR7055659040-6LBS1B

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	558.7	7.5
10°-20°	1602.4	21.4
20°-30°	2260.5	30.2
30°-40°	1951.4	26.1
40°-50°	873.9	11.7
50°-60°	228.8	3.1
60°-70°	14.9	0.2
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4421.5	59.0
0°-40°	6372.9	85.1
0°-60°	7475.6	99.8
0°-90°	7490.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7490.5	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	5912	
5°	5875	559
15°	5682	1602
25°	4960	2260
35°	3186	1951
45°	1092	874
55°	241	229
65°	1	15
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P794627

CATALOG NUMBER: LER6D60D010-EC6DR7055659040-6LBS1B

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	5912.1
2.5°	5905.8
5°	5874.9
7.5°	5849.4
10°	5795.2
12.5°	5746.3
15°	5682.5
17.5°	5609.1
20°	5474.1
22.5°	5251.9
25°	4959.6
27.5°	4620.4
30°	4224.9
32.5°	3741.2
35°	3186.2
37.5°	2573.9
40°	1978.5
42.5°	1503.3
45°	1091.8
47.5°	752.7
50°	514.6
52.5°	355.1
55°	241.3
57.5°	145.7
60°	74.4
62.5°	23.4
65°	1.1
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)