

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P794692

Luminaire Tested: LER6D65D010-EC6DR3055659024-6LBS1H

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P794692
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-16)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D65D010-EC6DR3055659024-6LBS1H
Description: 6 INCH ROUND SHALLOW SEMI-SPECULAR CLEAR TRIM, WITH 30° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 6974.9 lumens
Efficiency: N/A
Efficacy: 95.8 lumens/watt
Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.49
Luminous Opening: Rectangular (W 0.38' x L: 0.38' x H: 0')
CIE Type: Direct

Input Watts (W): 72.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P794692

CATALOG NUMBER: LER6D65D010-EC6DR3055659024-6LBS1H

Luminous Intensity Polar Plot

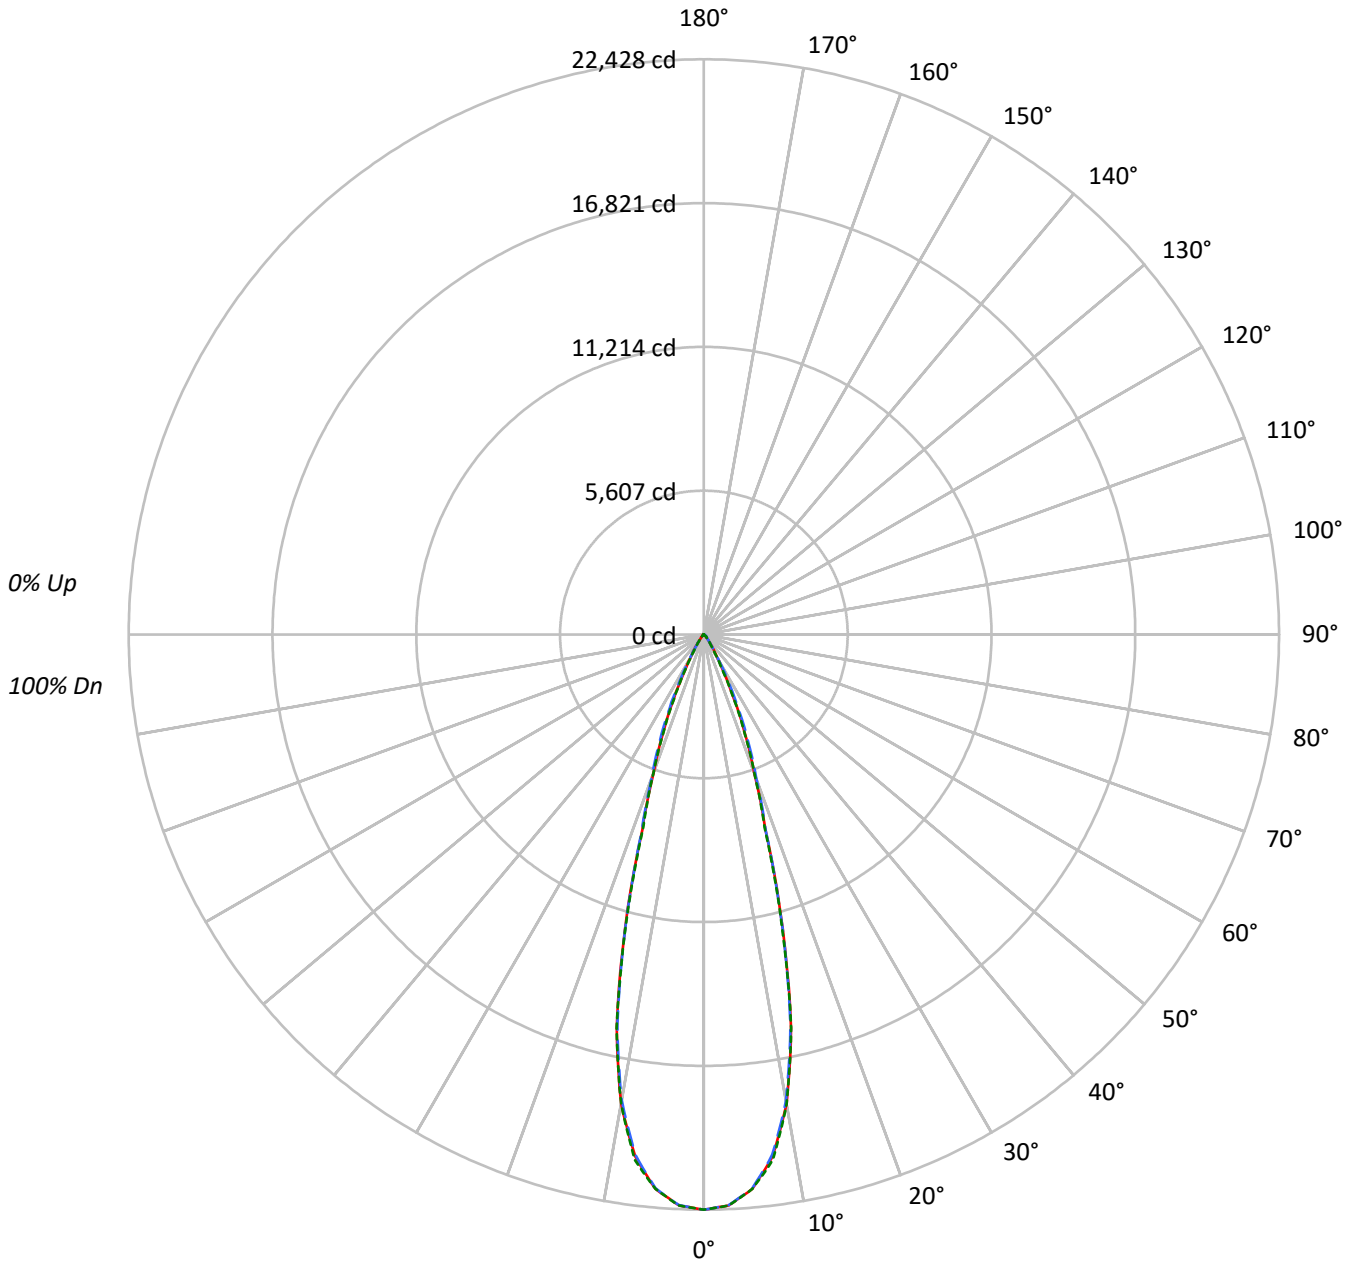



TEST NUMBER: P794692

CATALOG NUMBER: LER6D65D010-EC6DR3055659024-6LBS1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96						96													
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92						92													
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89						89													
4	103	98	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85						85													
5	100	94	89	86	98	93	89	86	91	88	85	90	86	84	88	86	83	82						82													
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79						79													
7	94	87	82	79	92	86	82	79	85	81	78	84	81	78	83	80	78	77						77													
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74						74													
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72						72													
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69						69													

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1716708	1716708	1716708
5°	1667421	1665477	1667505
10°	1444240	1434058	1443898
15°	942293	937237	932522
20°	468558	486136	467931
25°	236030	266156	231191
30°	94501	102968	82339
35°	43834	41984	35190
40°	18925	21013	17826
45°	13347	16573	13466
50°	4585	12063	4847
55°	2642	4991	2789
60°	1852	2189	1852
65°	1195	1195	1195
70°	739	492	739
75°	0	325	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 22.5°
 Vertical Angle: 45°
 Luminance: 16573 cd/sqm



TEST NUMBER: P794692

CATALOG NUMBER: LER6D65D010-EC6DR3055659024-6LBS1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1972.2	28.3
10°-20°	3176.2	45.5
20°-30°	1372.5	19.7
30°-40°	312.8	4.5
40°-50°	107.4	1.5
50°-60°	26.2	0.4
60°-70°	6.8	0.1
70°-80°	0.7	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	6521.0	93.5
0°-40°	6833.8	98.0
0°-60°	6967.4	99.9
0°-90°	6974.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6974.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	22428	22428	22428	22428	22428	
5°	21701	21680	21676	21721	21702	1974
15°	11891	11748	11827	11789	11768	3184
25°	2795	2900	3151	2827	2737	1338
35°	469	479	449	446	377	318
45°	123	153	153	153	124	88
55°	20	21	37	22	21	19
65°	7	7	7	7	7	6
75°	0	0	1	0	0	1
85°	0	0	0	0	0	0
90°	0	0	0	0	0	0



TEST NUMBER: P794692

CATALOG NUMBER: LER6D65D010-EC6DR3055659024-6LBS1H

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	22427.9	22427.9	22427.9	22427.9	22427.9
2.5°	22279.2	22263.8	22272.6	22283.6	22288.0
5°	21701.1	21680.2	21675.8	21720.9	21702.2
7.5°	20535.0	20505.3	20460.1	20562.5	20658.3
10°	18581.6	18548.6	18450.6	18499.0	18577.2
12.5°	15697.7	15590.9	15588.7	15742.9	15722.0
15°	11891.1	11748.0	11827.3	11788.7	11767.8
17.5°	7996.4	7941.4	8047.1	8015.1	7877.5
20°	5752.3	5766.6	5968.1	5866.8	5744.6
22.5°	4197.5	4249.3	4488.2	4227.2	4131.4
25°	2794.7	2900.4	3151.4	2826.6	2737.4
27.5°	1718.9	1767.3	2021.7	1696.8	1648.4
30°	1069.2	1045.0	1165.0	999.8	931.6
32.5°	701.4	670.6	709.1	636.5	581.4
35°	469.1	479.0	449.3	446.0	376.6
37.5°	292.9	336.9	297.3	317.1	242.2
40°	189.4	244.5	210.3	232.3	178.4
42.5°	155.3	188.3	172.9	183.9	158.6
45°	123.3	153.1	153.1	153.1	124.4
47.5°	68.3	102.4	131.0	104.6	72.7
50°	38.5	51.8	101.3	54.0	40.7
52.5°	26.4	29.7	69.4	30.8	27.5
55°	19.8	20.9	37.4	22.0	20.9
57.5°	15.4	16.5	19.8	16.5	15.4
60°	12.1	12.1	14.3	13.2	12.1
62.5°	8.8	8.8	9.9	8.8	8.8
65°	6.6	6.6	6.6	6.6	6.6
67.5°	3.3	4.4	4.4	4.4	4.4
70°	3.3	2.2	2.2	2.2	3.3
72.5°	2.2	1.1	1.1	1.1	1.1
75°	0.0	0.0	1.1	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)