

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P794792

Luminaire Tested: LER6D65D010-EC6DR4055659027-6LBDP1H

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P794792
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-28)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D65D010-EC6DR4055659027-6LBDP1H
Description: 6 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 40° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 8024.1 lumens
Efficiency: N/A
Efficacy: 110.2 lumens/watt
Spacing Criteria (0/90/45): 0.68 / 0.68 / 0.6
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 72.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P794792

CATALOG NUMBER: LER6D65D010-EC6DR4055659027-6LBDP1H

Luminous Intensity Polar Plot

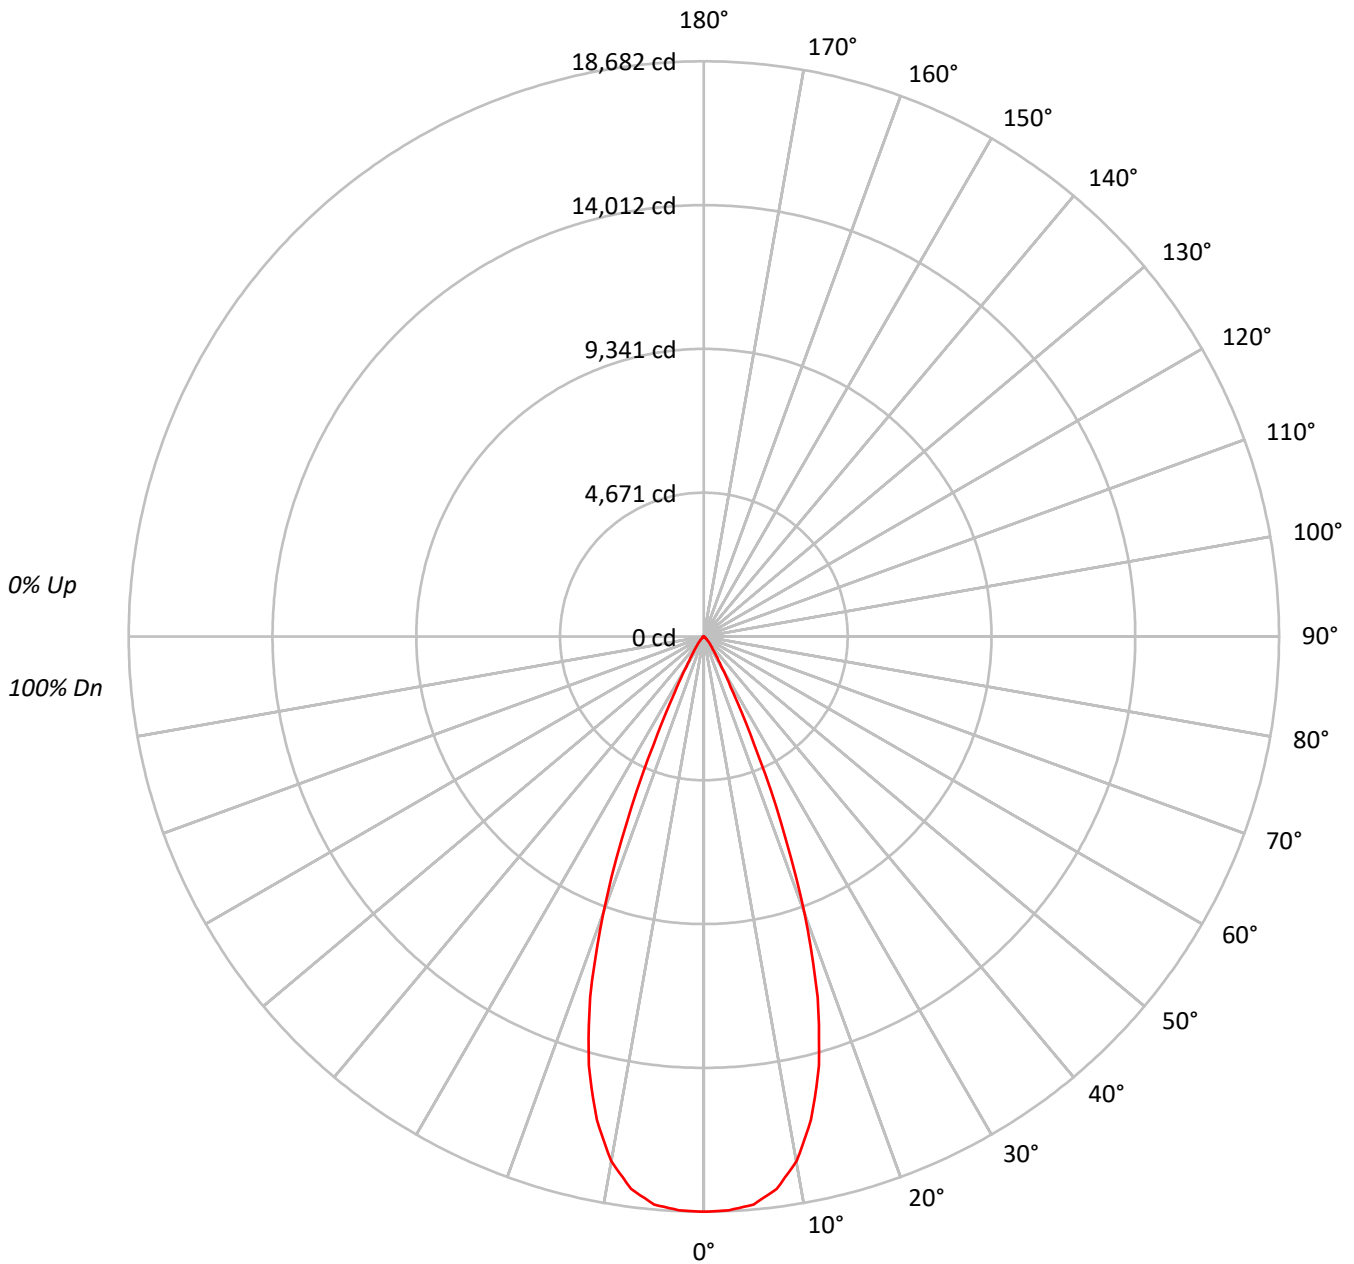



TEST NUMBER: P794792

CATALOG NUMBER: LER6D65D010-EC6DR4055659027-6LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	97	96																			
2	110	106	103	100	108	105	102	99	102	99	97	99	97	95	96	95	93	92																			
3	106	101	97	94	104	100	96	93	97	94	92	95	93	90	93	91	89	88																			
4	102	97	92	89	101	95	91	88	93	90	87	92	89	86	90	87	85	84																			
5	99	92	88	84	97	91	87	84	90	86	83	88	85	83	87	84	82	81																			
6	95	88	84	80	94	88	83	80	86	82	80	85	82	79	84	81	79	77																			
7	92	85	80	77	91	84	80	77	83	79	76	82	79	76	81	78	76	74																			
8	89	82	77	74	88	81	77	74	80	76	73	79	76	73	78	75	73	72																			
9	86	79	74	71	85	78	74	71	77	73	71	76	73	70	76	72	70	69																			
10	83	76	71	68	82	75	71	68	75	71	68	74	70	68	73	70	68	67																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2041242
5°	2031315
10°	1920036
15°	1632273
20°	1112510
25°	464188
30°	145958
35°	67838
40°	37512
45°	17198
50°	8346
55°	4572
60°	2382
65°	853
70°	351
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 17198 cd/sqm



TEST NUMBER: P794792

CATALOG NUMBER: LER6D65D010-EC6DR4055659027-6LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1729.4	21.6
10°-20°	3874.3	48.3
20°-30°	1939.3	24.2
30°-40°	355.5	4.4
40°-50°	98.1	1.2
50°-60°	23.0	0.3
60°-70°	4.4	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	7542.9	94.0
0°-40°	7898.4	98.4
0°-60°	8019.5	99.9
0°-90°	8024.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	8024.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	18682	
5°	18521	###
15°	14430	3874
25°	3850	1939
35°	509	355
45°	111	98
55°	24	23
65°	3	4
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P794792

CATALOG NUMBER: LER6D65D010-EC6DR4055659027-6LBDP1H

CANDELA DISTRIBUTION (FULL):

0°	
0°	18682.3
2.5°	18655.0
5°	18520.7
7.5°	18092.9
10°	17306.0
12.5°	16079.3
15°	14430.2
17.5°	12285.7
20°	9568.1
22.5°	6523.2
25°	3850.4
27.5°	2035.4
30°	1156.9
32.5°	747.6
35°	508.6
37.5°	363.4
40°	263.0
42.5°	180.1
45°	111.3
47.5°	70.9
50°	49.1
52.5°	34.9
55°	24.0
57.5°	15.3
60°	10.9
62.5°	6.5
65°	3.3
67.5°	2.2
70°	1.1
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)