

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P794824

Luminaire Tested: LER6D65D010-EC6DR4055659050-6LBDP1H

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P794824  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-28)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D65D010-EC6DR4055659050-6LBDP1H  
Description: 6 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 40° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 8806.7 lumens  
Efficiency: N/A  
Efficacy: 121.0 lumens/watt  
Spacing Criteria (0/90/45): 0.68 / 0.68 / 0.6  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 72.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



Downlight

TEST NUMBER: P794824  
CATALOG NUMBER: LER6D65D010-EC6DR4055659050-6LBDP1H

### Luminous Intensity Polar Plot

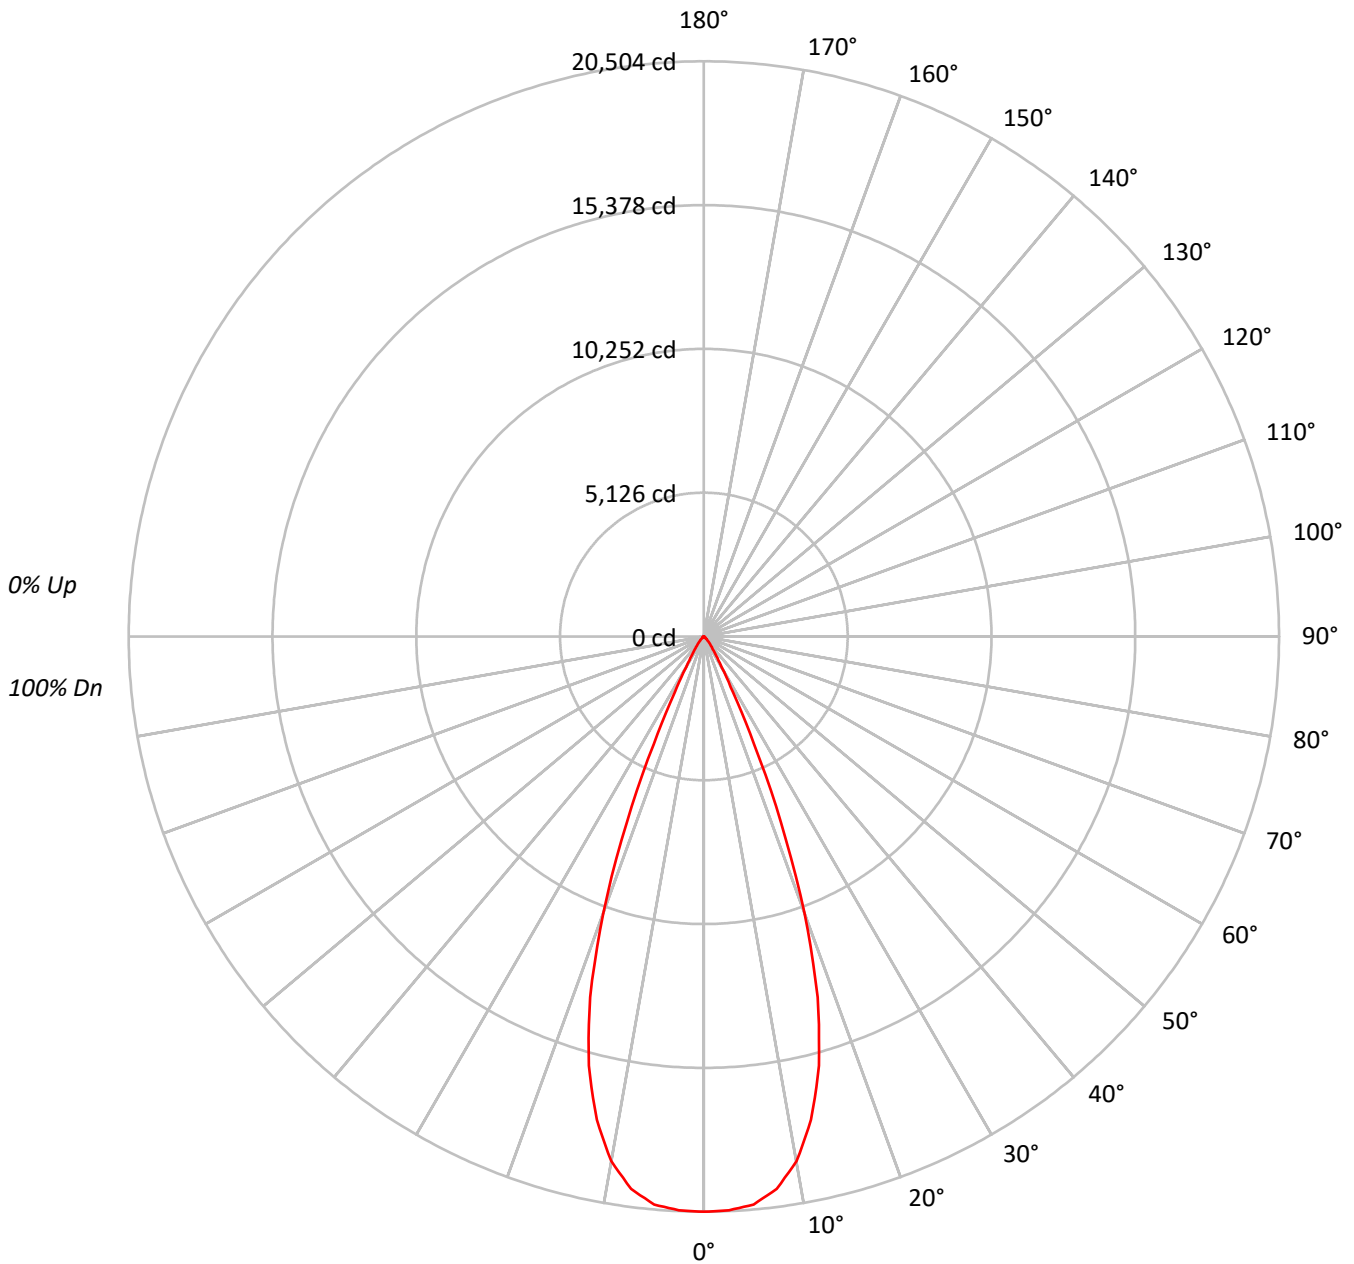



TEST NUMBER: P794824

CATALOG NUMBER: LER6D65D010-EC6DR4055659050-6LBDP1H

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	97	96						96													
2	110	106	103	100	108	105	102	99	102	99	97	99	97	95	96	95	93	92						92													
3	106	101	97	94	104	100	96	93	97	94	92	95	93	90	93	91	89	88						88													
4	102	97	92	89	101	95	91	88	93	90	87	92	89	86	90	87	85	84						84													
5	99	92	88	84	97	91	87	84	90	86	83	88	85	83	87	84	82	81						81													
6	95	88	84	80	94	88	83	80	86	82	80	85	82	79	84	81	79	77						77													
7	92	85	80	77	91	84	80	77	83	79	76	82	79	76	81	78	76	74						74													
8	89	82	77	74	88	81	77	74	80	76	73	79	76	73	78	75	73	72						72													
9	86	79	74	71	85	78	74	71	77	73	71	76	73	70	76	72	70	69						69													
10	83	76	71	68	82	75	71	68	75	71	68	74	70	68	73	70	68	67						67													

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	2240315
5°	2229427
10°	2107303
15°	1791471
20°	1221016
25°	509457
30°	160190
35°	74454
40°	41177
45°	18882
50°	9162
55°	5029
60°	2622
65°	931
70°	383
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 18882 cd/sqm



TEST NUMBER: P794824

CATALOG NUMBER: LER6D65D010-EC6DR4055659050-6LBDP1H

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	1898.0	21.6
10°-20°	4252.1	48.3
20°-30°	2128.5	24.2
30°-40°	390.2	4.4
40°-50°	107.7	1.2
50°-60°	25.3	0.3
60°-70°	4.8	0.1
70°-80°	0.2	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	8278.6	94.0
0°-40°	8668.8	98.4
0°-60°	8801.7	99.9
0°-90°	8806.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	8806.7	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	20504	
5°	20327	###
15°	15838	4252
25°	4226	2128
35°	558	390
45°	122	108
55°	26	25
65°	4	5
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P794824

CATALOG NUMBER: LER6D65D010-EC6DR4055659050-6LBDP1H

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	20504.3
2.5°	20474.4
5°	20327.0
7.5°	19857.5
10°	18993.9
12.5°	17647.5
15°	15837.6
17.5°	13483.9
20°	10501.3
22.5°	7159.4
25°	4225.9
27.5°	2233.9
30°	1269.7
32.5°	820.5
35°	558.2
37.5°	398.9
40°	288.7
42.5°	197.6
45°	122.2
47.5°	77.9
50°	53.9
52.5°	38.3
55°	26.4
57.5°	16.8
60°	12.0
62.5°	7.2
65°	3.6
67.5°	2.4
70°	1.2
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)