

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P794897

Luminaire Tested: LER6D65D010-EC6DR5055659030-6LBDP1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P794897
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-44)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D65D010-EC6DR5055659030-6LBDP1LI
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 50° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 8625.3 lumens
Efficiency: N/A
Efficacy: 118.5 lumens/watt
Spacing Criteria (0/90/45): 0.8 / 0.8 / 0.73
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 72.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P794897

CATALOG NUMBER: LER6D65D010-EC6DR5055659030-6LBDP1LI

Luminous Intensity Polar Plot

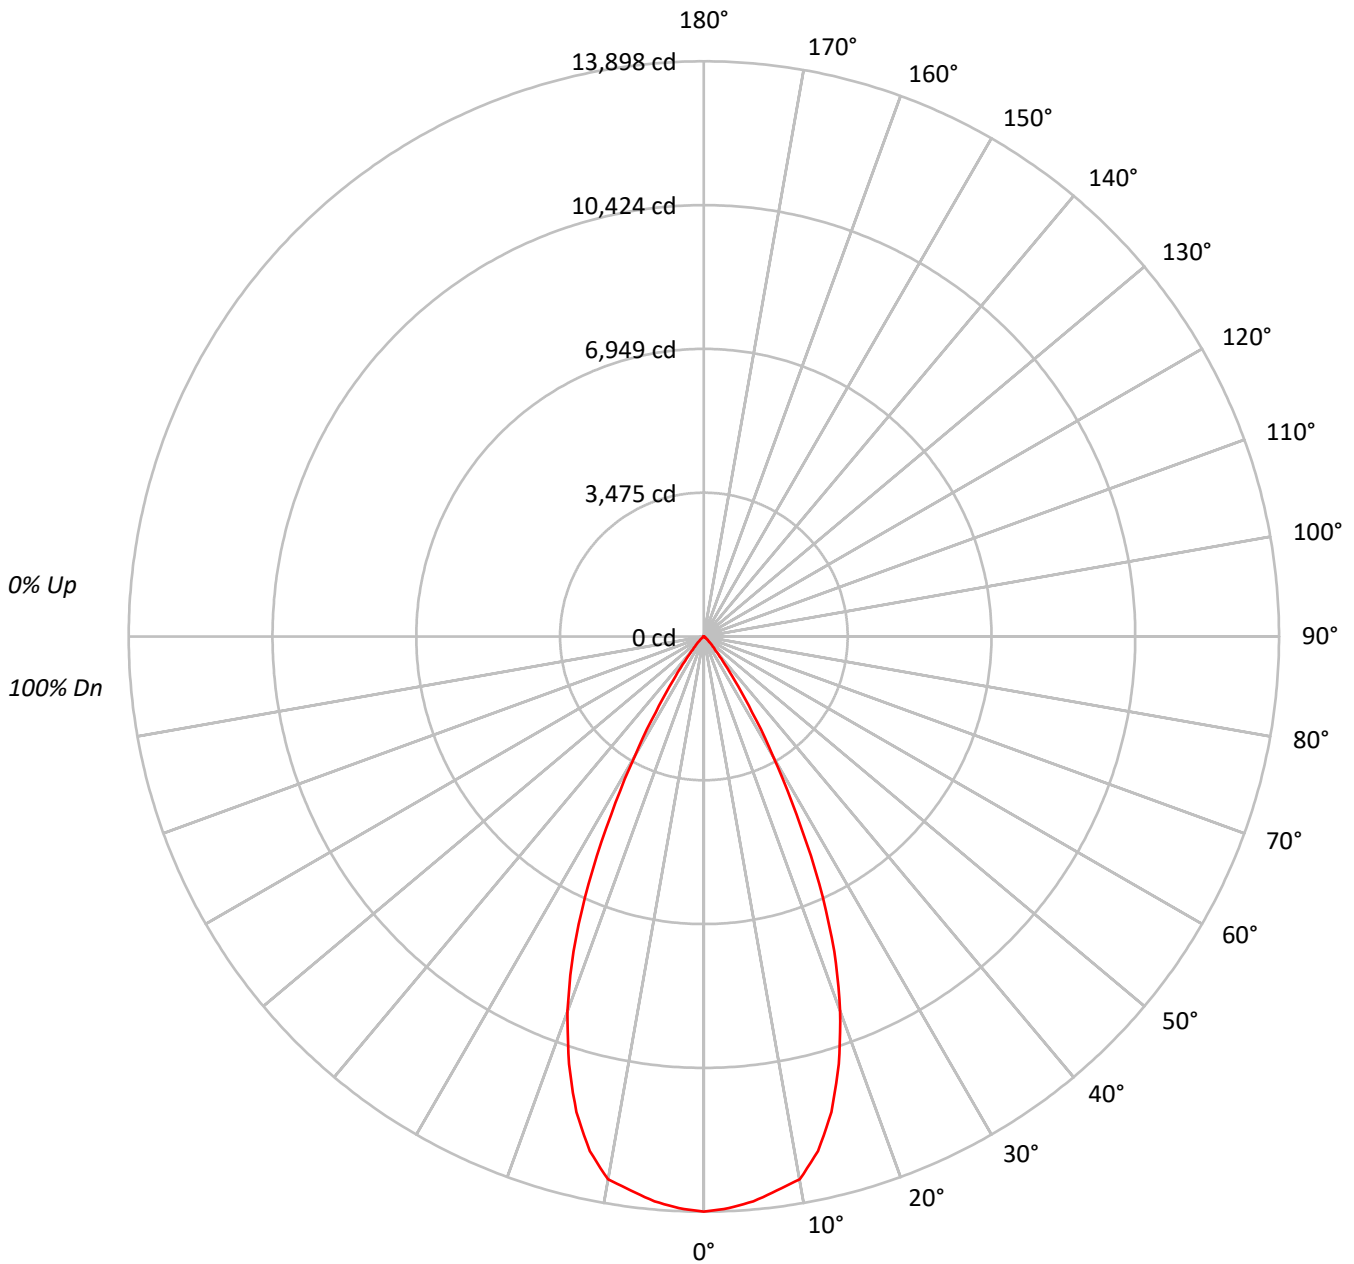



TEST NUMBER: P794897

CATALOG NUMBER: LER6D65D010-EC6DR5055659030-6LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR	0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	102	100	100	100	100	100													
	1	114	112	109	107	112	110	108	106	106	104	102	102	101	99	98	97	97	97	95	95	95	95	95													
	2	109	105	101	98	107	103	100	97	100	98	95	97	95	93	95	93	91	91	90	90	90	90	90													
	3	105	99	95	91	103	98	94	90	95	92	89	93	90	88	91	88	86	85	85	85	85	85	85													
	4	100	94	89	85	99	93	88	85	90	87	84	89	85	83	87	84	82	80	80	80	80	80	80													
	5	96	89	84	80	95	88	83	79	86	82	79	85	81	78	83	80	77	76	76	76	76	76	76													
	6	92	84	79	75	91	83	79	75	82	78	74	81	77	74	79	76	74	72	72	72	72	72	72													
	7	88	80	75	71	87	79	74	71	78	74	71	77	73	70	76	73	70	69	69	69	69	69	69													
	8	85	76	71	67	84	76	71	67	75	70	67	74	70	67	73	69	66	65	65	65	65	65	65													
	9	81	73	68	64	80	72	67	64	71	67	64	71	67	64	70	66	63	62	62	62	62	62	62													
	10	78	70	64	61	77	69	64	61	68	64	61	68	64	61	67	63	60	59	59	59	59	59	59													

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1518451
5°	1502535
10°	1477782
15°	1345639
20°	1119731
25°	794837
30°	420705
35°	171437
40°	63670
45°	29142
50°	11950
55°	6248
60°	3081
65°	905
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 29142 cd/sqm



TEST NUMBER: P794897

CATALOG NUMBER: LER6D65D010-EC6DR5055659030-6LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1294.9	15.0
10°-20°	3272.4	37.9
20°-30°	2939.5	34.1
30°-40°	920.3	10.7
40°-50°	161.1	1.9
50°-60°	32.1	0.4
60°-70°	4.9	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	7506.8	87.0
0°-40°	8427.1	97.7
0°-60°	8620.4	99.9
0°-90°	8625.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	8625.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	13898	
5°	13700	###
15°	11896	3272
25°	6593	2940
35°	1285	920
45°	189	161
55°	33	32
65°	4	5
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P794897

CATALOG NUMBER: LER6D65D010-EC6DR5055659030-6LBDP1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	13897.5
2.5°	13828.3
5°	13699.5
7.5°	13502.6
10°	13319.8
12.5°	12734.0
15°	11896.2
17.5°	10832.3
20°	9630.2
22.5°	8239.4
25°	6593.1
27.5°	4847.3
30°	3334.6
32.5°	2171.2
35°	1285.3
37.5°	738.2
40°	446.4
42.5°	290.6
45°	188.6
47.5°	114.8
50°	70.3
52.5°	48.0
55°	32.8
57.5°	22.3
60°	14.1
62.5°	8.2
65°	3.5
67.5°	1.2
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)