

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P795036

Luminaire Tested: LER6D65D010-EC6DR6555659027-6LBS1H

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P795036
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-147)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D65D010-EC6DR6555659027-6LBS1H
Description: 6 INCH ROUND SHALLOW SEMI-SPECULAR CLEAR TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 7089.6 lumens
Efficiency: N/A
Efficacy: 97.4 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.96
Luminous Opening: Circular (Dia: 0.48' x H: 0')
CIE Type: Direct


Input Watts (W): 72.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P795036
CATALOG NUMBER: LER6D65D010-EC6DR6555659027-6LBS1H

Luminous Intensity Polar Plot

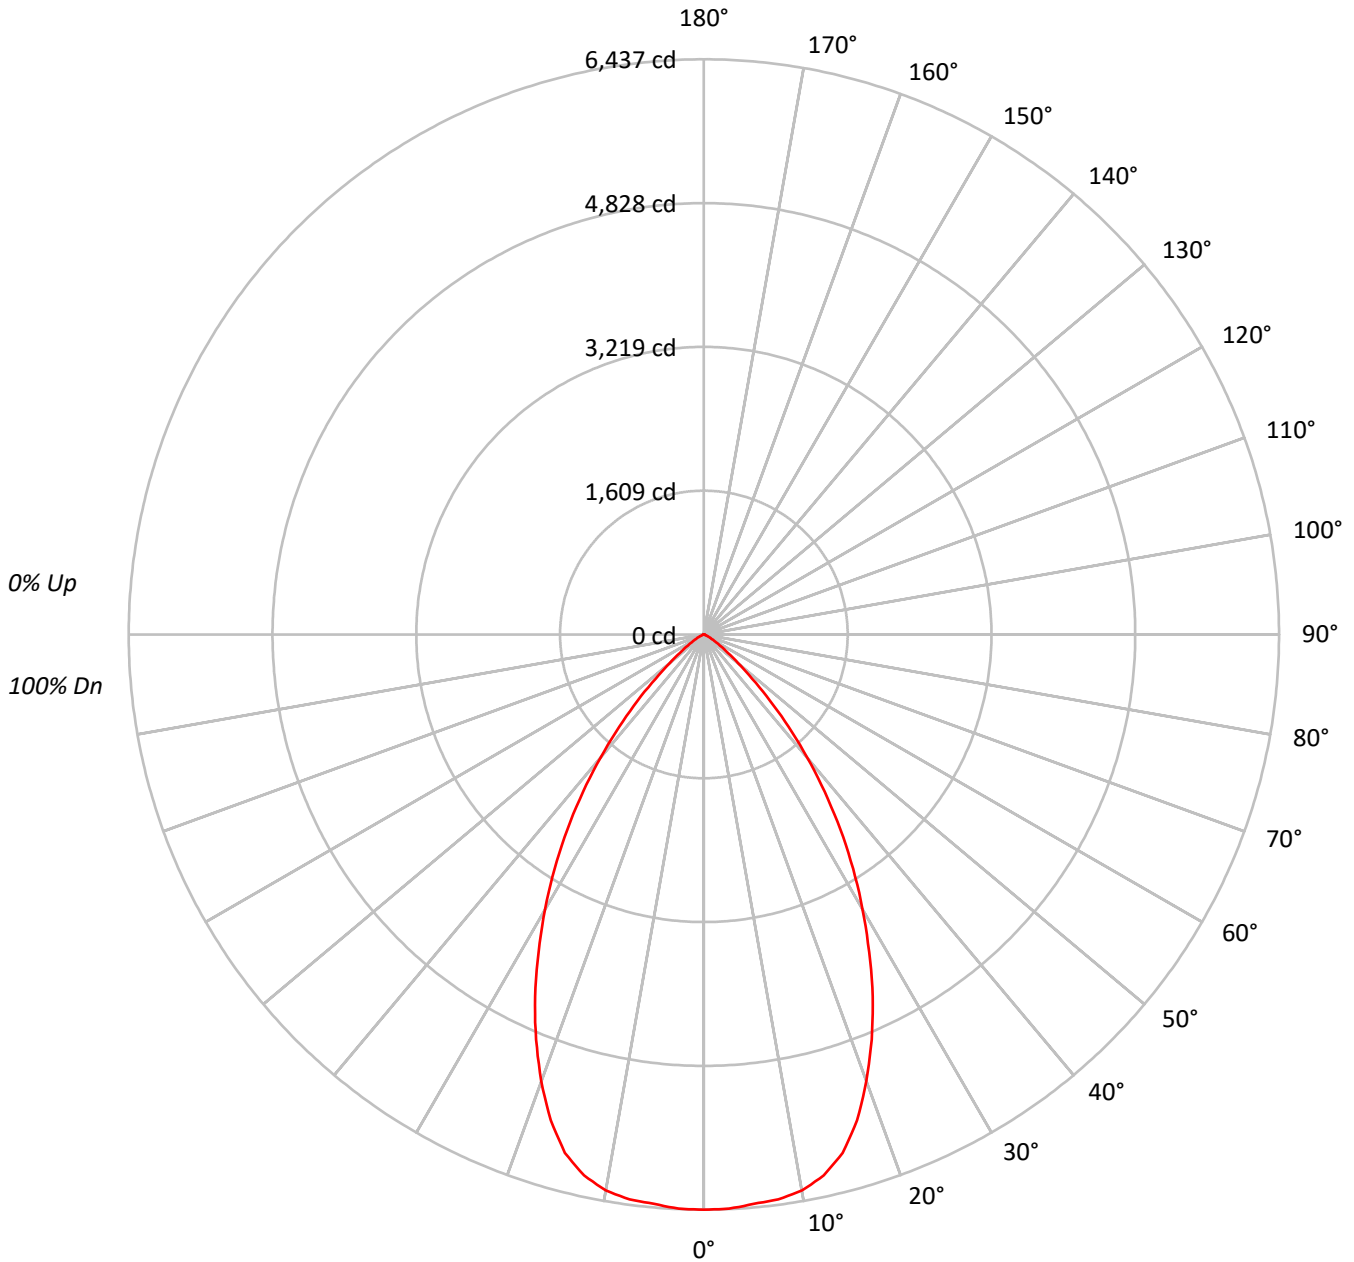



TEST NUMBER: P795036

CATALOG NUMBER: LER6D65D010-EC6DR6555659027-6LBS1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	93			93
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85			85
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78			78
4	95	87	81	76	93	86	80	76	84	79	75	82	77	74	80	76	73	72			72
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	75	71	68	66			66
6	85	75	69	64	83	74	68	64	73	67	63	71	67	63	70	66	62	61			61
7	80	70	64	59	79	69	63	59	68	63	59	67	62	58	66	61	58	56			56
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54	52			52
9	72	61	55	51	71	61	55	51	60	54	51	59	54	50	58	54	50	49			49
10	68	58	52	47	67	57	51	47	57	51	47	56	51	47	55	50	47	46			46

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	375957
5°	375013
10°	374694
15°	363142
20°	330593
25°	288092
30°	239611
35°	189859
40°	137028
45°	86568
50°	45121
55°	23980
60°	12592
65°	6924
70°	2903
75°	3204
80°	2220
85°	1876

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 86568 cd/sqm



TEST NUMBER: P795036

CATALOG NUMBER: LER6D65D010-EC6DR6555659027-6LBS1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	608.8	8.6
10°-20°	1667.0	23.5
20°-30°	2037.7	28.7
30°-40°	1653.3	23.3
40°-50°	823.9	11.6
50°-60°	229.8	3.2
60°-70°	52.2	0.7
70°-80°	13.6	0.2
80°-90°	3.5	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4313.4	60.8
0°-40°	5966.7	84.2
0°-60°	7020.4	99.0
0°-90°	7089.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7089.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	6437	
5°	6397	609
15°	6006	1667
25°	4471	2038
35°	2663	1653
45°	1048	824
55°	236	230
65°	50	52
75°	14	14
85°	3	3
90°	0	



TEST NUMBER: P795036

CATALOG NUMBER: LER6D65D010-EC6DR6555659027-6LBS1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	6437.2
2.5°	6432.5
5°	6396.6
7.5°	6375.8
10°	6318.1
12.5°	6200.8
15°	6005.9
17.5°	5701.3
20°	5319.1
22.5°	4906.7
25°	4470.6
27.5°	4004.2
30°	3553.0
32.5°	3107.5
35°	2662.9
37.5°	2219.2
40°	1797.3
42.5°	1401.9
45°	1048.1
47.5°	730.3
50°	496.6
52.5°	342.4
55°	235.5
57.5°	158.9
60°	107.8
62.5°	74.7
65°	50.1
67.5°	25.5
70°	17.0
72.5°	16.1
75°	14.2
77.5°	9.5
80°	6.6
82.5°	4.7
85°	2.8
87.5°	1.9
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)