

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P795113

Luminaire Tested: LER6D65D010-EC6DR7055659050-6LBDP1LI

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P795113
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-73)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D65D010-EC6DR7055659050-6LBDDP1LI
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 70° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 8941.2 lumens
Efficiency: N/A
Efficacy: 122.8 lumens/watt
Spacing Criteria (0/90/45): 0.88 / 0.88 / 0.82
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 72.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P795113
CATALOG NUMBER: LER6D65D010-EC6DR7055659050-6LBDP1LI

Luminous Intensity Polar Plot

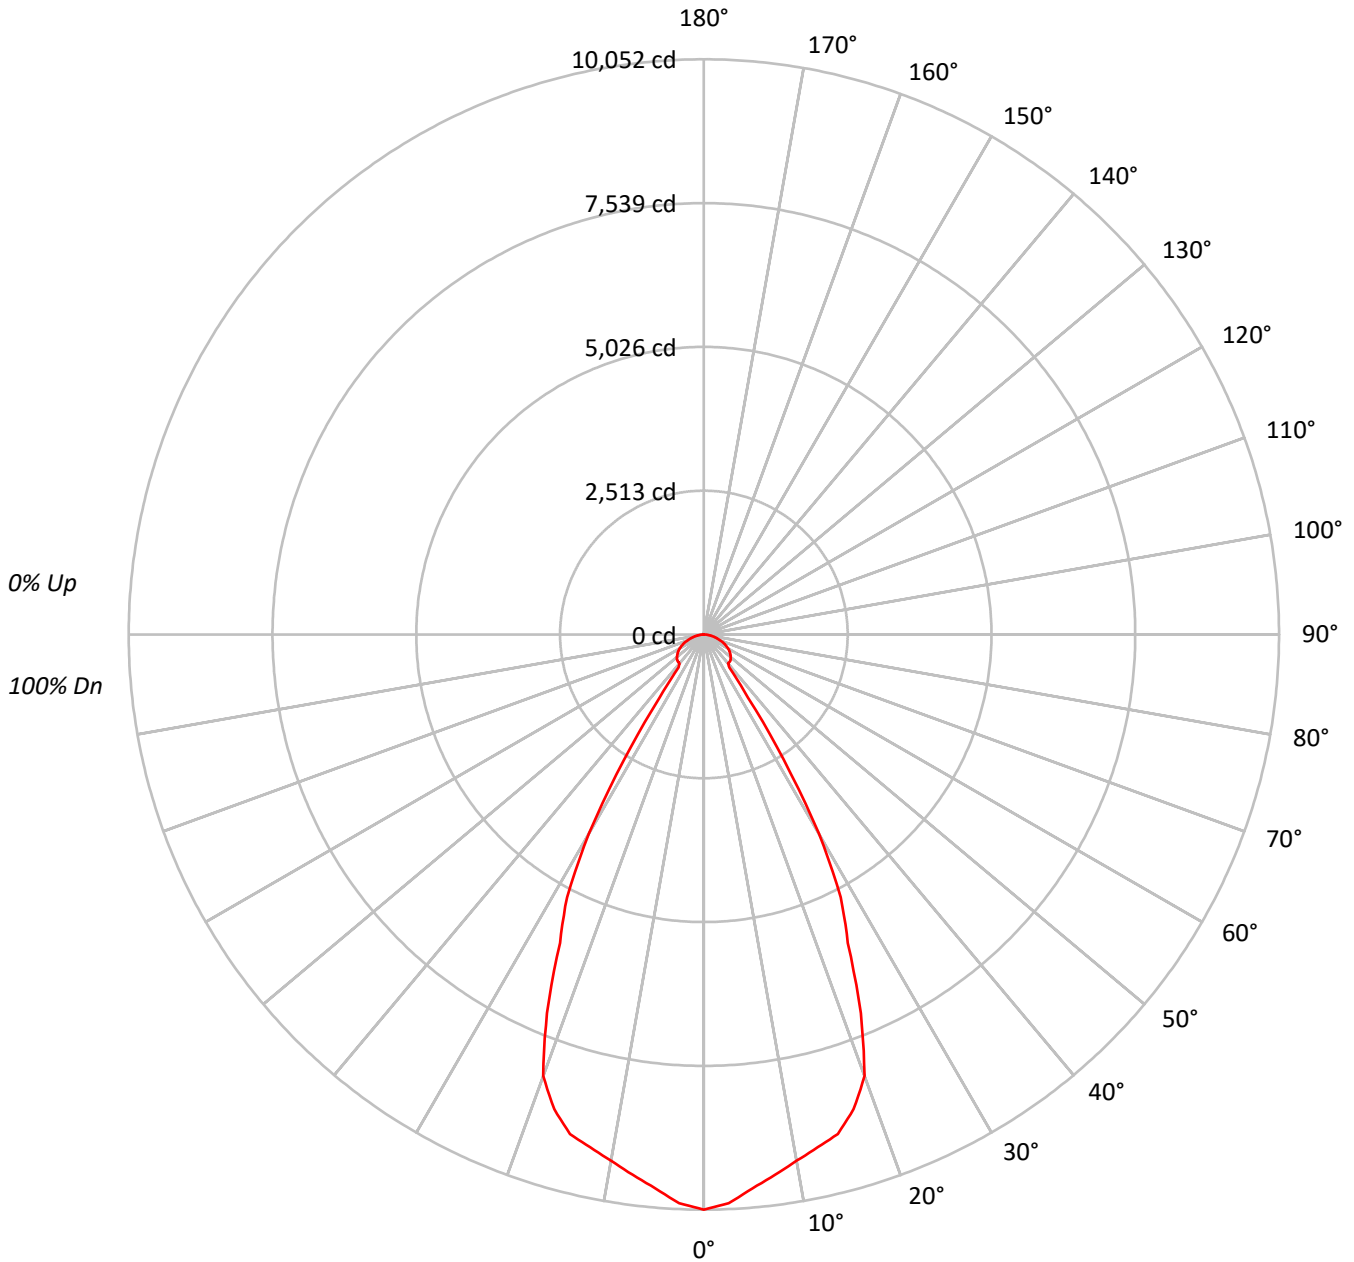



TEST NUMBER: P795113
 CATALOG NUMBER: LER6D65D010-EC6DR7055659050-6LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20	
RC	80					70					50					30					10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				
1	112	109	106	103	110	107	104	102	103	101	99	99	97	96	95	94	93	91				
2	106	100	95	91	103	98	94	90	95	91	88	92	89	86	89	87	85	83				
3	100	92	87	82	98	91	86	81	88	84	80	86	82	79	83	80	78	76				
4	94	86	80	75	92	85	79	74	82	77	73	80	76	73	78	75	72	70				
5	89	80	74	69	87	79	73	69	77	72	68	75	71	67	74	70	67	65				
6	85	75	68	64	83	74	68	64	73	67	63	71	66	63	70	66	62	61				
7	80	70	64	59	79	70	64	59	68	63	59	67	62	59	66	62	58	57				
8	77	66	60	56	75	66	60	56	65	59	55	64	59	55	63	58	55	53				
9	73	63	57	52	72	62	56	52	61	56	52	60	55	52	60	55	52	50				
10	70	59	53	49	69	59	53	49	58	53	49	57	52	49	57	52	49	48				

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1098344
5°	1065709
10°	1036005
15°	1022413
20°	954717
25°	717235
30°	507026
35°	179600
40°	94435
45°	100591
50°	104163
55°	106122
60°	106770
65°	104525
70°	98648
75°	91396
80°	81105
85°	65815

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 57.5°
 Luminance: 106800 cd/sqm



TEST NUMBER: P795113

CATALOG NUMBER: LER6D65D010-EC6DR7055659050-6LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	916.5	10.3
10°-20°	2513.9	28.1
20°-30°	2768.7	31.0
30°-40°	1057.9	11.8
40°-50°	499.5	5.6
50°-60°	496.6	5.6
60°-70°	397.6	4.4
70°-80°	228.5	2.6
80°-90°	62.1	0.7
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	6199.1	69.3
0°-40°	7257.0	81.2
0°-60°	8253.0	92.3
0°-90°	8941.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	8941.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	10052	
5°	9717	916
15°	9039	2514
25°	5949	2769
35°	1346	1058
45°	651	499
55°	557	497
65°	404	398
75°	216	229
85°	52	62
90°	0	



TEST NUMBER: P795113

CATALOG NUMBER: LER6D65D010-EC6DR7055659050-6LBDP1LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	10052.5
2.5°	9947.5
5°	9716.7
7.5°	9524.1
10°	9337.9
12.5°	9180.3
15°	9038.7
17.5°	8696.5
20°	8211.0
22.5°	7163.8
25°	5949.4
27.5°	5179.1
30°	4018.8
32.5°	2595.9
35°	1346.5
37.5°	727.4
40°	662.1
42.5°	657.3
45°	651.0
47.5°	636.6
50°	612.8
52.5°	585.7
55°	557.1
57.5°	525.2
60°	488.6
62.5°	447.2
65°	404.3
67.5°	356.5
70°	308.8
72.5°	261.0
75°	216.5
77.5°	170.3
80°	128.9
82.5°	90.7
85°	52.5
87.5°	20.7
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)