

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P175434

Luminaire Tested: **LDA6A30840D010TE LARL20NF 6LFC1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P175434
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P26263)
Test Lab: INNOVATION CENTER-P2
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LDA6A30840D010TE LARL20NF 6LFC1
Description: PORTFOLIO 6" Flat Cone, Self-flange Trim Ring, 20° Narrow Flood Optic, at 0° tilt
Light Source: (1) HIGH LUMEN LED 80CRI / 4000K CCT
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2764.0 lumens
Efficiency: N/A
Efficacy: 62.1 lumens/watt
Spacing Criteria (0/90/45): 0.35 / 0.35 / 0.34
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct


Input Watts (W): 44.49
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P175434

CATALOG NUMBER: LDA6A30840D010TE LARL20NF 6LFC1

Luminous Intensity Polar Plot

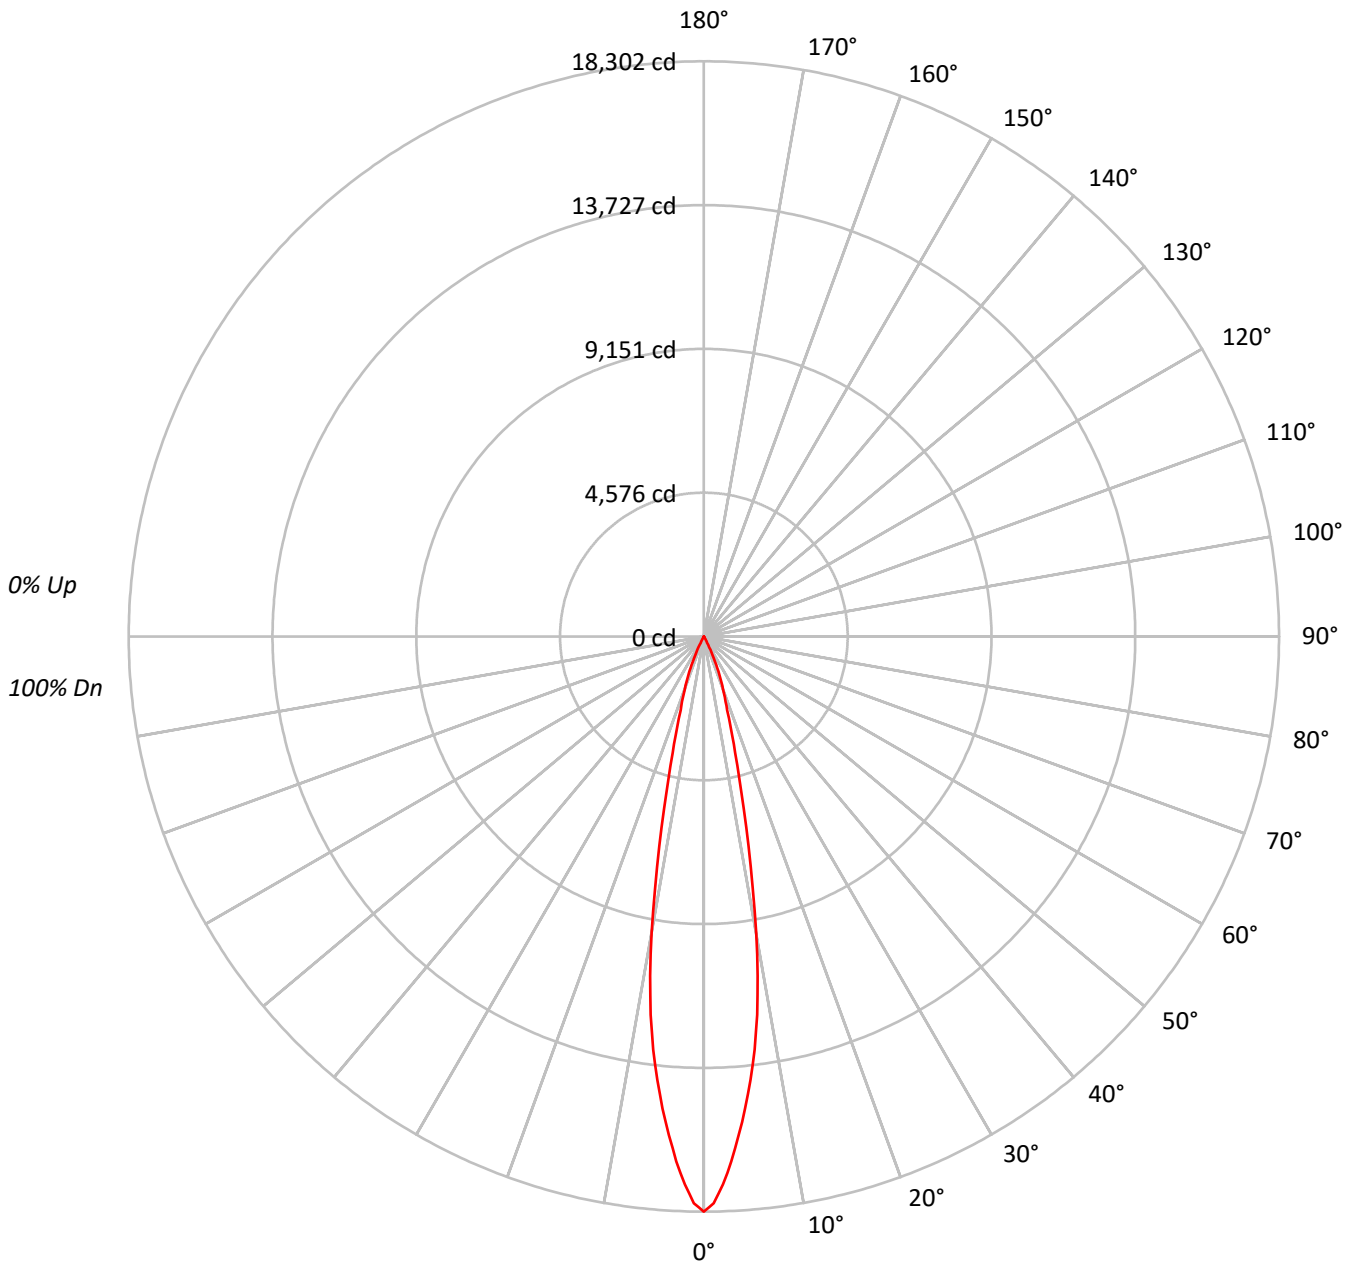



TEST NUMBER: P175434

CATALOG NUMBER: LDA6A30840D010TE LARL20NF 6LFC1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	99	97
1	115	114	112	110	113	111	110	108	107	106	105	104	103	102	100	100	99	97	97	96	95
2	112	109	106	104	110	107	105	103	104	102	101	101	100	98	99	98	96	95	95	94	93
3	109	105	102	99	107	104	101	98	101	99	97	99	97	95	97	95	94	93	93	92	91
4	106	102	98	95	105	101	97	95	99	96	94	97	95	93	95	93	92	91	91	90	89
5	104	99	95	92	102	98	94	92	96	93	91	95	92	90	93	91	90	89	89	88	87
6	101	96	92	90	100	95	92	89	94	91	89	93	90	88	92	89	88	87	87	86	85
7	99	93	90	87	98	93	89	87	92	89	87	91	88	86	90	87	86	85	85	84	83
8	97	91	87	85	96	91	87	85	90	87	85	89	86	84	88	86	84	83	83	82	81
9	95	89	85	83	94	89	85	83	88	85	83	87	84	82	86	84	82	81	81	80	80
10	93	87	84	81	92	87	83	81	86	83	81	85	83	81	85	82	81	80	80	79	78

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1003346
5°	829560
10°	533474
15°	217470
20°	103813
25°	38899
30°	2792
35°	549
40°	222
45°	78
50°	85
55°	0
60°	0
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P175434

CATALOG NUMBER: LDA6A30840D010TE LARL20NF 6LFC1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1271.3	46.0
10°-20°	1164.5	42.1
20°-30°	319.2	11.5
30°-40°	7.8	0.3
40°-50°	1.2	0.0
50°-60°	0.1	0.0
60°-70°	0.0	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2755.0	99.7
0°-40°	2762.8	100.0
0°-60°	2764.0	100.0
0°-90°	2764.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2764.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	18302	
5°	15075	###
15°	3832	1164
25°	643	319
35°	8	8
45°	1	1
55°	0	0
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P175434

CATALOG NUMBER: LDA6A30840D010TE LARL20NF 6LFC1

CANDELA DISTRIBUTION (FULL):

	0°
0°	18302.5
1°	18035.8
2°	17444.0
3°	16720.9
4°	15909.7
5°	15074.8
6°	14194.8
7°	13243.0
8°	12155.8
9°	10934.3
10°	9583.5
11°	8155.9
12°	6825.6
13°	5624.6
14°	4650.2
15°	3831.8
17.5°	2455.4
20°	1779.5
22.5°	1203.1
25°	643.1
27.5°	215.4
30°	44.1
32.5°	15.4
35°	8.2
37.5°	5.1
40°	3.1
42.5°	2.1
45°	1.0
47.5°	1.0
50°	1.0
52.5°	0.0
55°	0.0
57.5°	0.0
60°	0.0
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P175434

CATALOG NUMBER: LDA6A30840D010TE LARL20NF 6LFC1

CANDELA DISTRIBUTION (continued):

0°
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)