

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P175406

Luminaire Tested: **LDA6A30940D010TE LARL15SP 6LFC1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P175406
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P26262)
Test Lab: INNOVATION CENTER-P2
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LDA6A30940D010TE LARL15SP 6LFC1
Description: PORTFOLIO 6" Flat Cone, Self-flange Trim Ring, 15° Spot Optic, at 0° tilt
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2078.9 lumens
Efficiency: N/A
Efficacy: 46.7 lumens/watt
Spacing Criteria (0/90/45): 0.21 / 0.21 / 0.26
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct


Input Watts (W): 44.49
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P175406

CATALOG NUMBER: LDA6A30940D010TE LARL15SP 6LFC1

Luminous Intensity Polar Plot

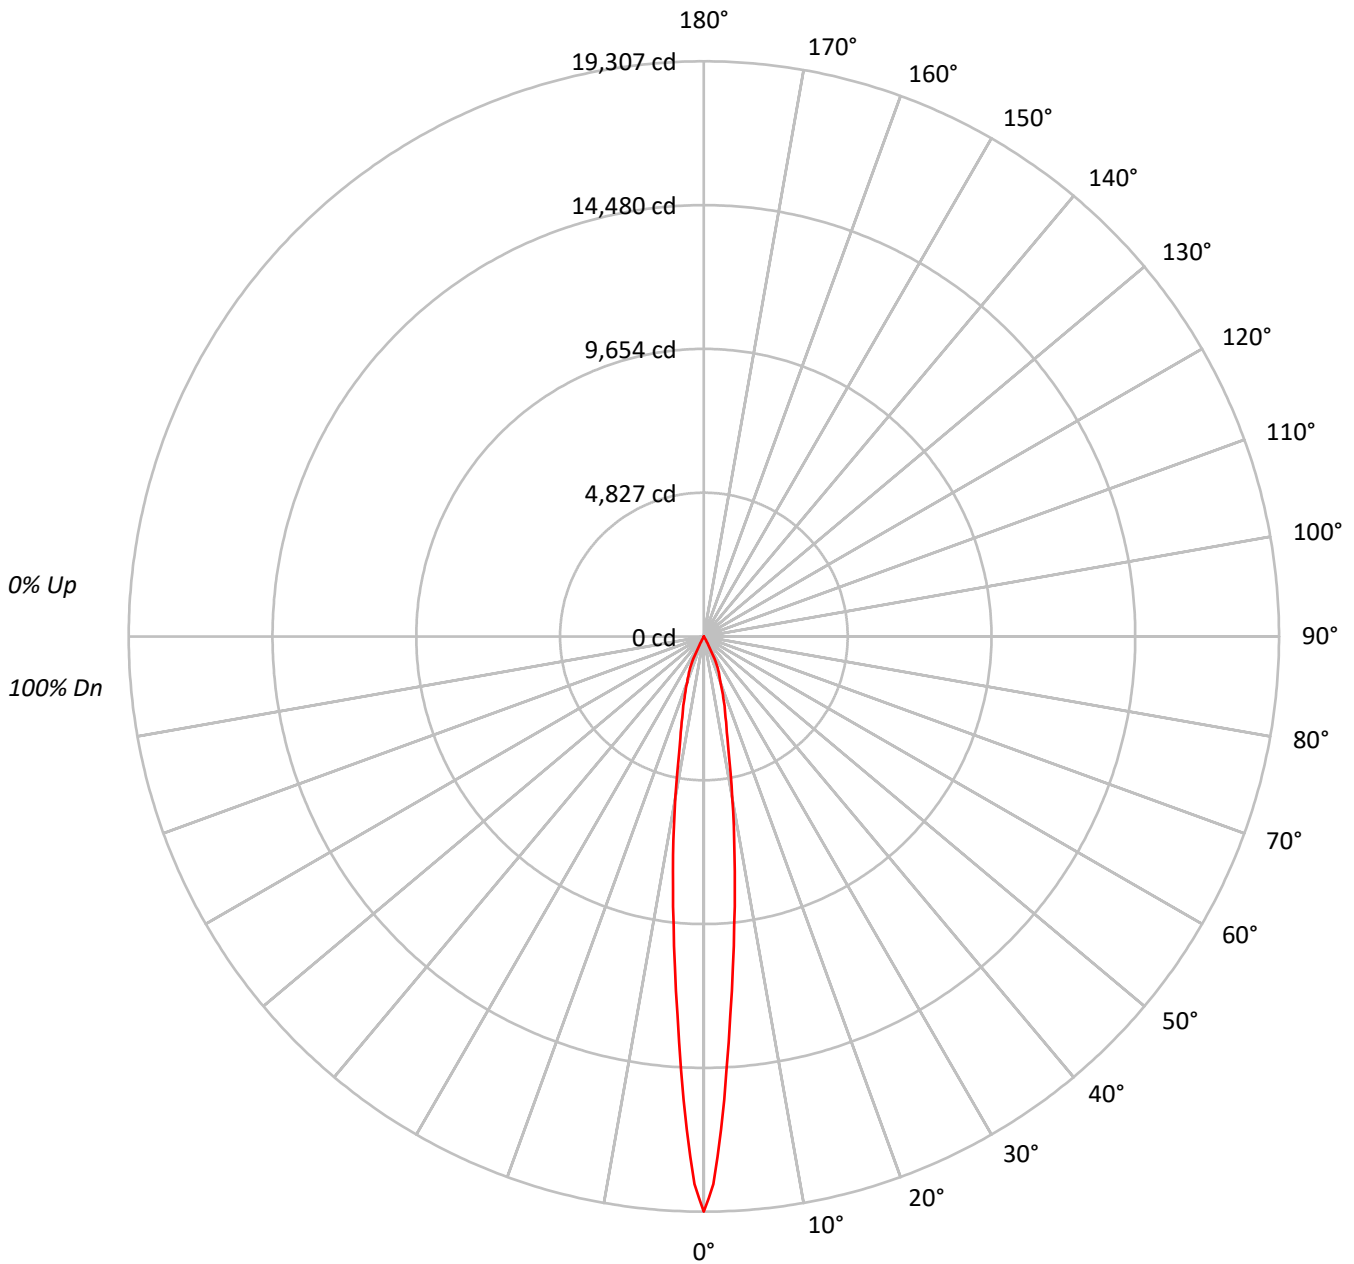



TEST NUMBER: P175406

CATALOG NUMBER: LDA6A30940D010TE LARL15SP 6LFC1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	115	113	112	110	113	111	110	108	107	106	105	104	103	102	100	100	99	97	97	97	97
2	112	108	106	103	110	107	104	102	104	102	100	101	99	98	98	97	96	95	95	95	95
3	109	104	101	98	107	103	100	98	101	98	96	98	96	95	96	95	93	92	92	92	92
4	106	101	97	94	104	100	96	94	98	95	93	96	94	92	94	92	91	90	90	90	90
5	103	97	94	91	102	97	93	90	95	92	90	94	91	89	92	90	88	87	87	87	87
6	100	95	91	88	99	94	90	88	93	89	87	91	89	87	90	88	86	85	85	85	85
7	98	92	88	85	97	91	88	85	90	87	85	89	86	84	88	86	84	83	83	83	83
8	95	89	86	83	95	89	85	83	88	85	83	87	84	82	86	84	82	81	81	81	81
9	93	87	83	81	92	87	83	81	86	83	81	85	82	80	85	82	80	79	79	79	79
10	91	85	81	79	90	85	81	79	84	81	79	83	81	79	83	80	78	78	78	78	78

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1058402
5°	612798
10°	306368
15°	159825
20°	95027
25°	57965
30°	1171
35°	294
40°	186
45°	140
50°	77
55°	0
60°	0
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P175406

CATALOG NUMBER: LDA6A30940D010TE LARL15SP 6LFC1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	893.5	43.0
10°-20°	810.7	39.0
20°-30°	369.5	17.8
30°-40°	3.8	0.2
40°-50°	1.2	0.1
50°-60°	0.1	0.0
60°-70°	0.0	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2073.8	99.8
0°-40°	2077.6	99.9
0°-60°	2078.9	100.0
0°-90°	2078.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2078.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	19307	
5°	11136	894
15°	2816	811
25°	958	370
35°	4	4
45°	2	1
55°	0	0
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P175406

CATALOG NUMBER: LDA6A30940D010TE LARL15SP 6LFC1

CANDELA DISTRIBUTION (FULL):

	0°
0°	19306.8
1°	18384.6
2°	16567.3
3°	14568.8
4°	12733.9
5°	11135.8
6°	9741.9
7°	8506.3
8°	7401.0
9°	6421.5
10°	5503.7
11°	4689.6
12°	4005.0
13°	3499.0
14°	3123.2
15°	2816.1
17.5°	2168.4
20°	1628.9
22.5°	1297.2
25°	958.3
27.5°	318.6
30°	18.5
32.5°	7.0
35°	4.4
37.5°	3.5
40°	2.6
42.5°	1.8
45°	1.8
47.5°	0.9
50°	0.9
52.5°	0.0
55°	0.0
57.5°	0.0
60°	0.0
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P175406

CATALOG NUMBER: LDA6A30940D010TE LARL15SP 6LFC1

CANDELA DISTRIBUTION (continued):

0°
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)