

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P204757

Luminaire Tested: **LSR6B10D010BZ EC6B10208027 6LBCSMW1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P204757  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LSR6B10D010BZ EC6B10208027 6LBCSMW1  
Description: PORTFOLIO 6IN CYLINDER  
SHALLOW DISTRIBUTION WITH CAST MATTE WHITE TRIM  
WATTAGE D010TR-10.05 W DE010-10.58 W D5LT-10.2 W DMX-10.6 W DL2-11.8 W  
DL3-11.1 W DLE-11.39 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1116.8 lumens  
Efficiency: N/A  
Efficacy: 112.8 lumens/watt  
Spacing Criteria (0/90/45): 1.23 / 1.23 / 1.33  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 9.9  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P204757

CATALOG NUMBER: LSR6B10D010BZ EC6B10208027 6LBCSMW1

### Luminous Intensity Polar Plot

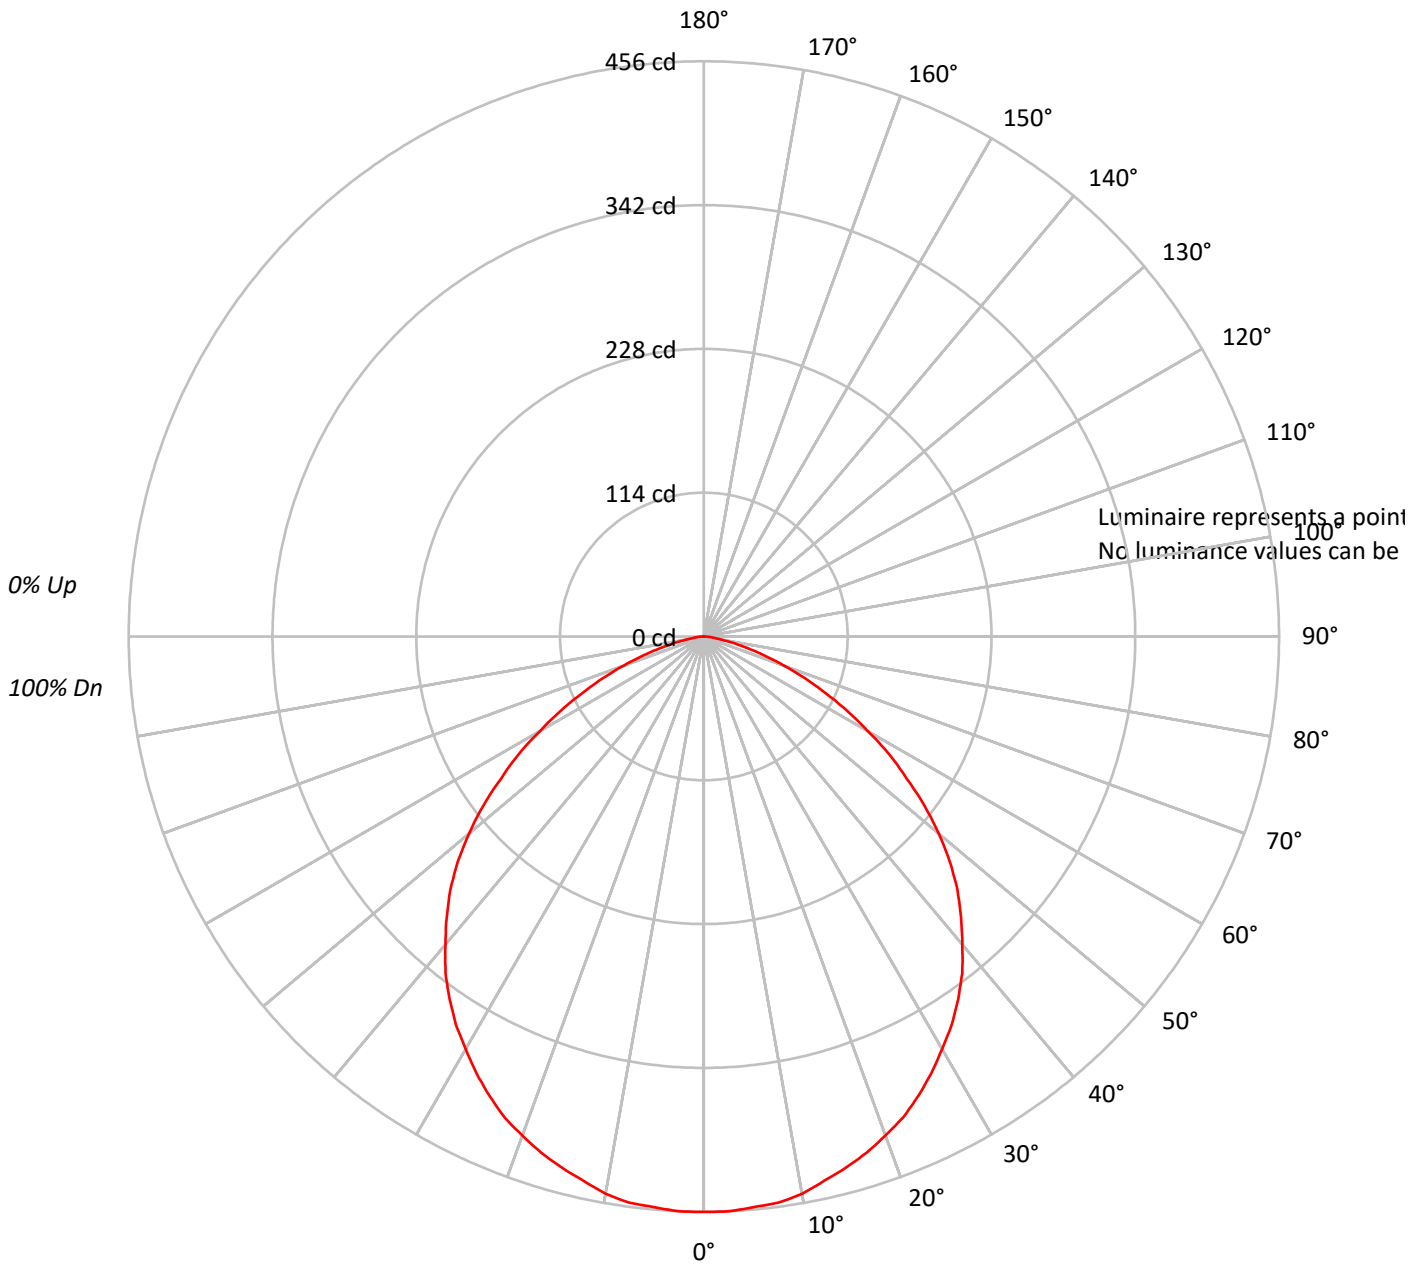



TEST NUMBER: P204757

CATALOG NUMBER: LSR6B10D010BZ EC6B10208027 6LBCSMW1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	110	106	102	99	108	104	100	97	100	97	94	96	93	91	92	90	89	87																			
2	101	94	87	82	99	92	86	81	88	84	79	85	81	78	82	79	76	74																			
3	93	83	75	70	90	81	74	69	79	73	68	76	71	67	73	69	65	63																			
4	85	74	66	60	83	73	65	59	70	64	58	68	62	58	66	61	57	55																			
5	79	66	58	52	77	65	57	51	63	56	51	61	55	50	60	54	50	48																			
6	73	60	52	45	71	59	51	45	57	50	45	56	49	44	54	49	44	42																			
7	68	55	46	40	66	54	46	40	52	45	40	51	44	40	50	44	39	37																			
8	63	50	42	36	61	49	41	36	48	41	36	47	40	36	46	40	35	33																			
9	59	46	38	33	57	45	38	32	44	37	32	43	37	32	42	36	32	30																			
10	55	42	35	30	54	42	34	30	41	34	29	40	34	29	39	33	29	27																			

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P204757

CATALOG NUMBER: LSR6B10D010BZ EC6B10208027 6LBCSMW1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	43.2	3.9
10°-20°	123.0	11.0
20°-30°	185.1	16.6
30°-40°	219.4	19.6
40°-50°	218.3	19.5
50°-60°	176.0	15.8
60°-70°	106.4	9.5
70°-80°	39.5	3.5
80°-90°	5.9	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	351.3	31.5
0°-40°	570.7	51.1
0°-60°	965.0	86.4
0°-90°	1116.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1116.8	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	456	
5°	454	43
15°	436	123
25°	402	185
35°	351	219
45°	284	218
55°	196	176
65°	107	106
75°	36	40
85°	5	6
90°	0	



TEST NUMBER: P204757

CATALOG NUMBER: LSR6B10D010BZ EC6B10208027 6LBCSMW1

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	456.2
2.5°	456.2
5°	454.1
7.5°	452.8
10°	448.7
12.5°	441.9
15°	435.9
17.5°	429.1
20°	421.0
22.5°	412.8
25°	402.0
27.5°	390.5
30°	377.6
32.5°	365.5
35°	351.3
37.5°	336.4
40°	318.8
42.5°	301.8
45°	284.3
47.5°	264.6
50°	243.0
52.5°	220.6
55°	196.3
57.5°	174.6
60°	150.2
62.5°	128.6
65°	106.9
67.5°	86.6
70°	67.7
72.5°	50.8
75°	35.9
77.5°	23.0
80°	13.5
82.5°	8.1
85°	4.7
87.5°	2.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)