

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P204660

Luminaire Tested: **LSR6B10D010BZ EC6B10209030 6LBPSMW1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P204660  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LSR6B10D010BZ EC6B10209030 6LBPSMW1  
Description: PORTFOLIO 6IN CYLINDER  
SHALLOW DISTRIBUTION WITH PLASTIC MATTE WHITE TRIM  
WATTAGE D010TR-10.05 W DE010-10.58 W D5LT-10.2 W DMX-10.6 W DL2-11.8 W  
DL3-11.1 W DLE-11.39 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 986.0 lumens  
Efficiency: N/A  
Efficacy: 99.6 lumens/watt  
Spacing Criteria (0/90/45): 1.24 / 1.24 / 1.34  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 9.9  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P204660

CATALOG NUMBER: LSR6B10D010BZ EC6B10209030 6LBPSMW1

### Luminous Intensity Polar Plot

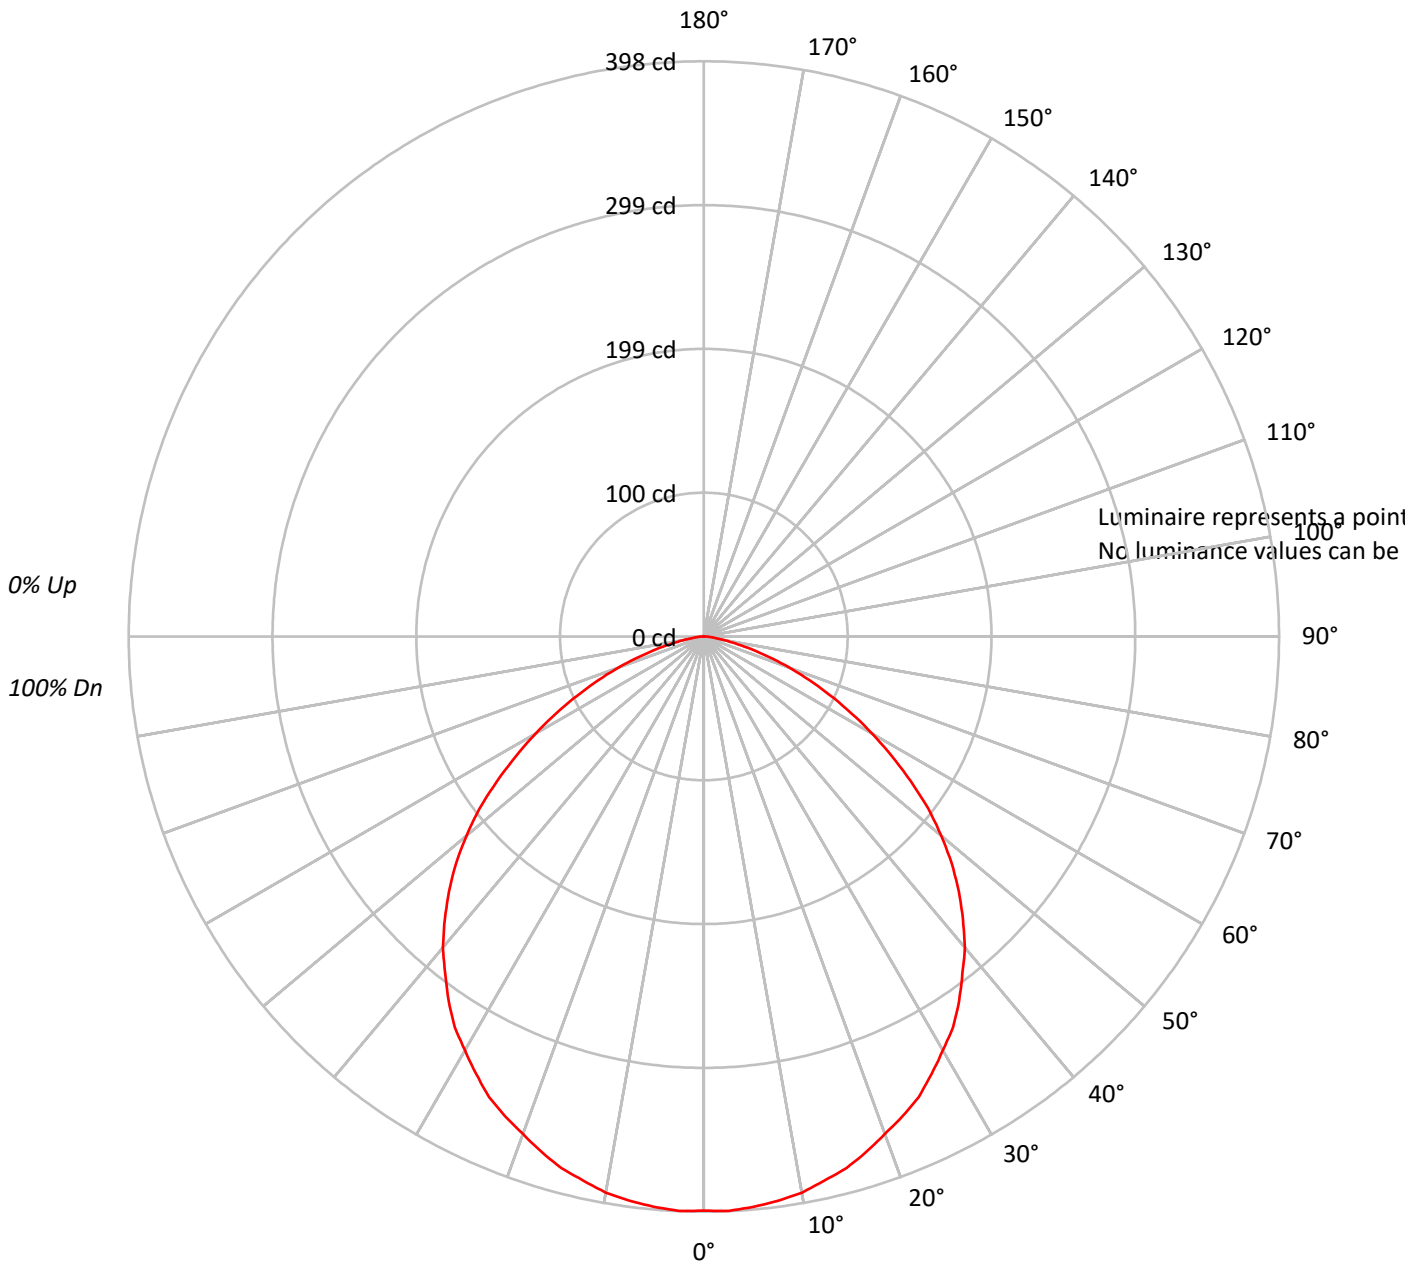



TEST NUMBER: P204660

CATALOG NUMBER: LSR6B10D010BZ EC6B10209030 6LBPSMW1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	110	106	102	99	107	104	100	97	99	97	94	96	93	91	92	90	88	86																			
2	101	93	87	82	98	92	86	81	88	83	79	85	81	77	82	79	76	74																			
3	93	83	75	69	90	81	74	69	78	72	67	76	70	66	73	69	65	63																			
4	85	74	66	59	83	72	65	59	70	63	58	68	62	57	66	61	56	54																			
5	78	66	58	51	76	65	57	51	63	56	51	61	55	50	59	54	49	47																			
6	73	60	51	45	71	59	51	45	57	50	44	55	49	44	54	48	44	42																			
7	67	54	46	40	66	54	46	40	52	45	40	51	44	39	49	43	39	37																			
8	63	50	41	36	61	49	41	36	48	41	35	46	40	35	45	39	35	33																			
9	59	46	38	32	57	45	37	32	44	37	32	43	36	32	42	36	32	30																			
10	55	42	34	29	54	42	34	29	41	34	29	40	33	29	39	33	29	27																			

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P204660

CATALOG NUMBER: LSR6B10D010BZ EC6B10209030 6LBPSMW1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	37.6	3.8
10°-20°	107.3	10.9
20°-30°	161.6	16.4
30°-40°	192.3	19.5
40°-50°	191.9	19.5
50°-60°	156.1	15.8
60°-70°	96.0	9.7
70°-80°	37.2	3.8
80°-90°	6.0	0.6
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	306.5	31.1
0°-40°	498.8	50.6
0°-60°	846.8	85.9
0°-90°	986.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	986.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	397	
5°	396	38
15°	381	107
25°	352	162
35°	308	192
45°	250	192
55°	175	156
65°	96	96
75°	34	37
85°	5	6
90°	0	



TEST NUMBER: P204660

CATALOG NUMBER: LSR6B10D010BZ EC6B10209030 6LBPSMW1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	397.3
2.5°	397.8
5°	396.1
7.5°	393.8
10°	390.8
12.5°	385.6
15°	380.9
17.5°	373.9
20°	366.3
22.5°	359.3
25°	351.7
27.5°	341.2
30°	330.7
32.5°	320.7
35°	307.9
37.5°	293.9
40°	281.0
42.5°	265.2
45°	249.5
47.5°	232.5
50°	214.4
52.5°	195.7
55°	174.7
57.5°	154.2
60°	134.4
62.5°	115.1
65°	96.4
67.5°	78.9
70°	62.5
72.5°	47.3
75°	33.9
77.5°	22.2
80°	13.4
82.5°	8.2
85°	4.7
87.5°	2.3
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)