

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P204862

Luminaire Tested: **LSR6B10D010BZ EC6B10208035 6LBCSMB1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P204862  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LSR6B10D010BZ EC6B10208035 6LBCSMB1  
Description: PORTFOLIO 6IN CYLINDER  
SHALLOW DISTRIBUTION WITH CAST MATTE BLACK TRIM  
WATTAGE D010TR-10.05 W DE010-10.58 W D5LT-10.2 W DMX-10.6 W DL2-11.8 W  
DL3-11.1 W DLE-11.39 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1010.9 lumens  
Efficiency: N/A  
Efficacy: 102.1 lumens/watt  
Spacing Criteria (0/90/45): 1.23 / 1.23 / 1.33  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 9.9  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P204862

CATALOG NUMBER: LSR6B10D010BZ EC6B10208035 6LBCSMB1

### Luminous Intensity Polar Plot

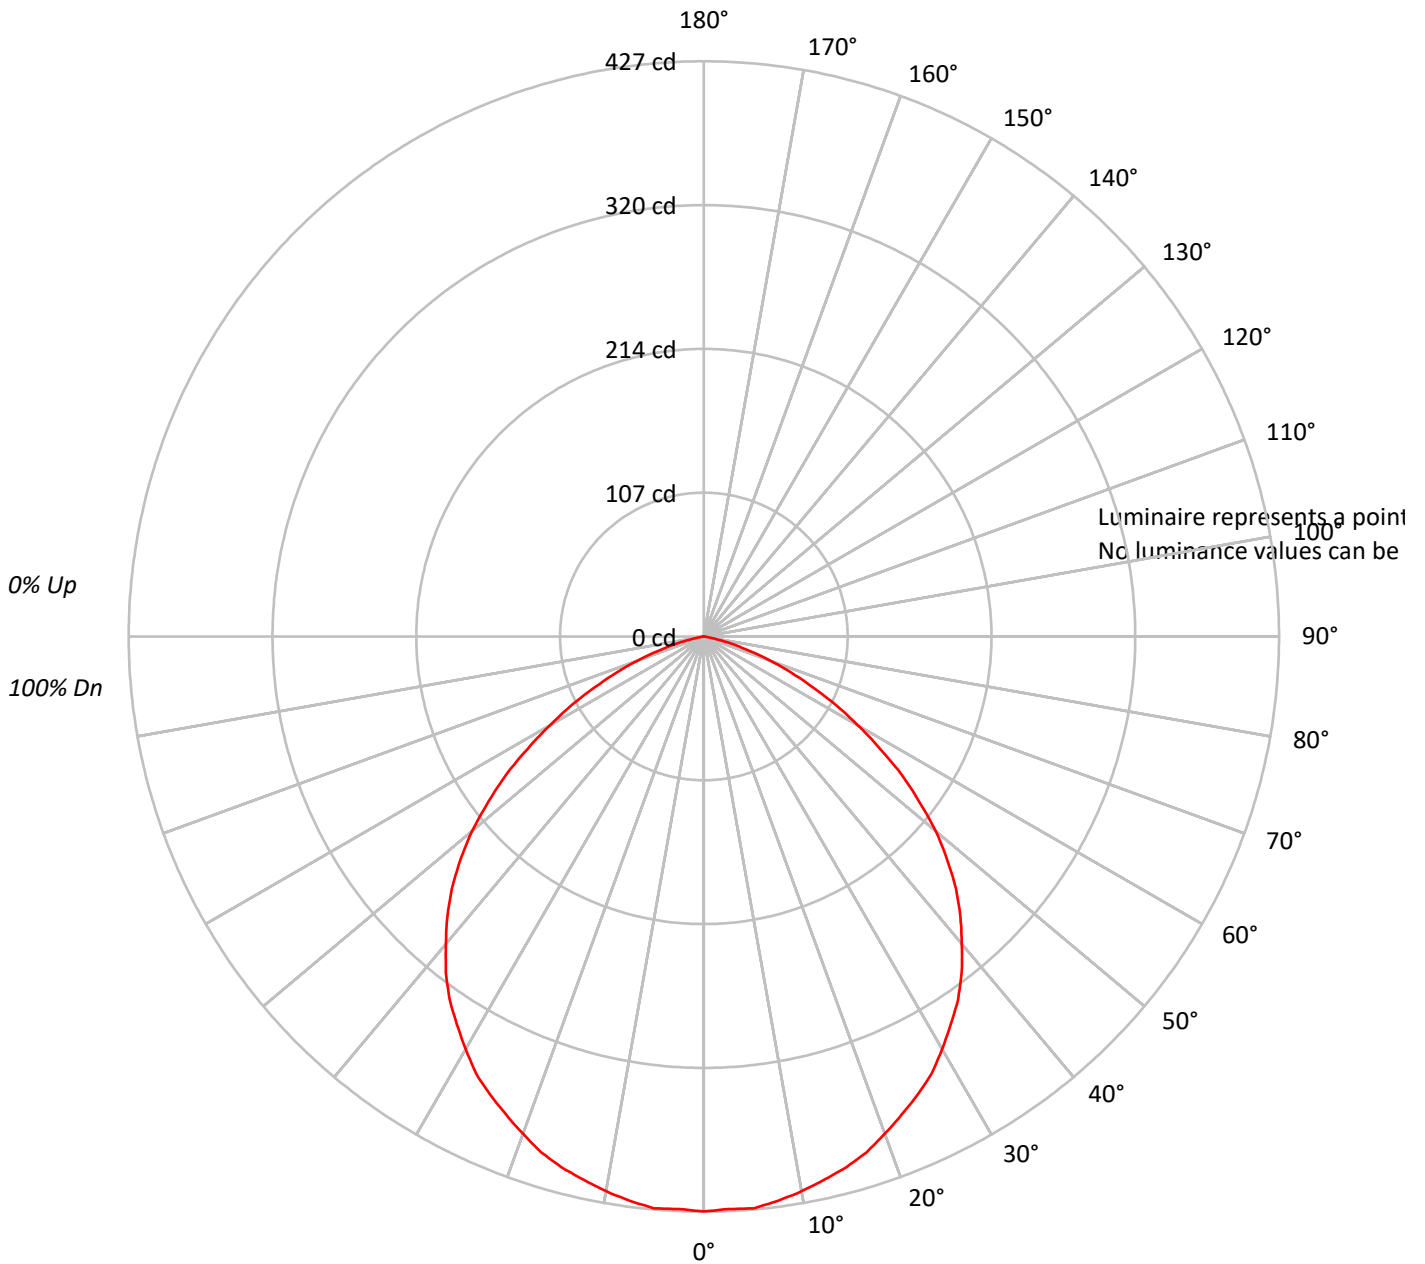



TEST NUMBER: P204862

CATALOG NUMBER: LSR6B10D010BZ EC6B10208035 6LBCSMB1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	111	107	103	100	108	104	101	98	100	98	95	96	94	92	93	91	90	88																			
2	102	95	89	84	99	93	87	83	89	85	81	86	82	79	83	80	77	75																			
3	93	84	77	71	91	83	76	70	80	74	69	77	72	68	74	70	67	65																			
4	86	75	67	61	84	74	66	61	71	65	60	69	63	59	67	62	58	56																			
5	79	67	59	53	77	66	59	53	64	57	52	62	56	52	61	55	51	49																			
6	74	61	53	47	72	60	52	46	58	51	46	57	50	46	55	50	45	43																			
7	68	55	47	41	67	55	47	41	53	46	41	52	45	41	50	45	40	39																			
8	64	51	43	37	62	50	42	37	49	42	37	48	41	37	46	41	36	35																			
9	60	47	39	33	58	46	39	33	45	38	33	44	38	33	43	37	33	31																			
10	56	43	35	30	55	43	35	30	42	35	30	41	34	30	40	34	30	28																			

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P204862

CATALOG NUMBER: LSR6B10D010BZ EC6B10208035 6LBCSMB1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	40.4	4.0
10°-20°	115.0	11.4
20°-30°	172.9	17.1
30°-40°	205.2	20.3
40°-50°	203.0	20.1
50°-60°	159.5	15.8
60°-70°	89.4	8.8
70°-80°	25.1	2.5
80°-90°	0.4	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	328.3	32.5
0°-40°	533.5	52.8
0°-60°	896.0	88.6
0°-90°	1010.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1010.9	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	427	
5°	426	40
15°	408	115
25°	375	173
35°	329	205
45°	264	203
55°	180	159
65°	89	89
75°	22	25
85°	0	0
90°	0	



TEST NUMBER: P204862

CATALOG NUMBER: LSR6B10D010BZ EC6B10208035 6LBCSMB1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	426.8
2.5°	425.4
5°	426.1
7.5°	422.5
10°	418.2
12.5°	413.1
15°	408.0
17.5°	401.5
20°	392.8
22.5°	384.1
25°	375.4
27.5°	366.0
30°	353.7
32.5°	341.3
35°	329.0
37.5°	314.5
40°	297.9
42.5°	281.9
45°	264.5
47.5°	244.9
50°	224.7
52.5°	201.5
55°	179.7
57.5°	155.1
60°	131.9
62.5°	110.9
65°	89.1
67.5°	70.3
70°	52.2
72.5°	35.5
75°	21.7
77.5°	10.9
80°	2.9
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)