Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P203940

Luminaire Tested: **LSR6B10D010BZ EC6B10209050 6LBNB1**

Issue Date: 3/3/2020

Test Information

Test Method:	LM-41-14
Report Number:	P203940
	TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab:	INNOVATION CENTER-P3
Issue Date:	3/3/2020
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	io LED
Catalog Number:	LSR6B10D010BZ EC6B10209050 6LBNB1
Description:	PORTFOLIO 6IN CYLINDER
	NARROW DISTRIBUTION WITH SPECULAR BLACK TRIM
	WATTAGE D010TR-10.05 W DE010-10.58 W D5LT-10.2 W DMX-10.6 W DL2-11.8 W DL3-11.1 W DLE-11.39 W
Light Source:	HIGH LUMEN LED
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	404.3 lumens
Efficiency:	N/A
Efficacy:	40.8 lumens/watt
Spacing Criteria (0/90/45):	0.68 / 0.68 / 0.83
Luminous Opening:	Point Source (0' x 0' x 0')
CIE Type:	Direct

Input Watts (W):	9.9
Input Voltage (V):	NR
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	NR
Total Harmonic Distortion (THDi):	NR
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	25 FT

TEST NUMBER: P203940
CATALOG NUMBER: LSR6B10D010BZ EC6B10209050 6LBNB1

Luminous Intensity Polar Plot

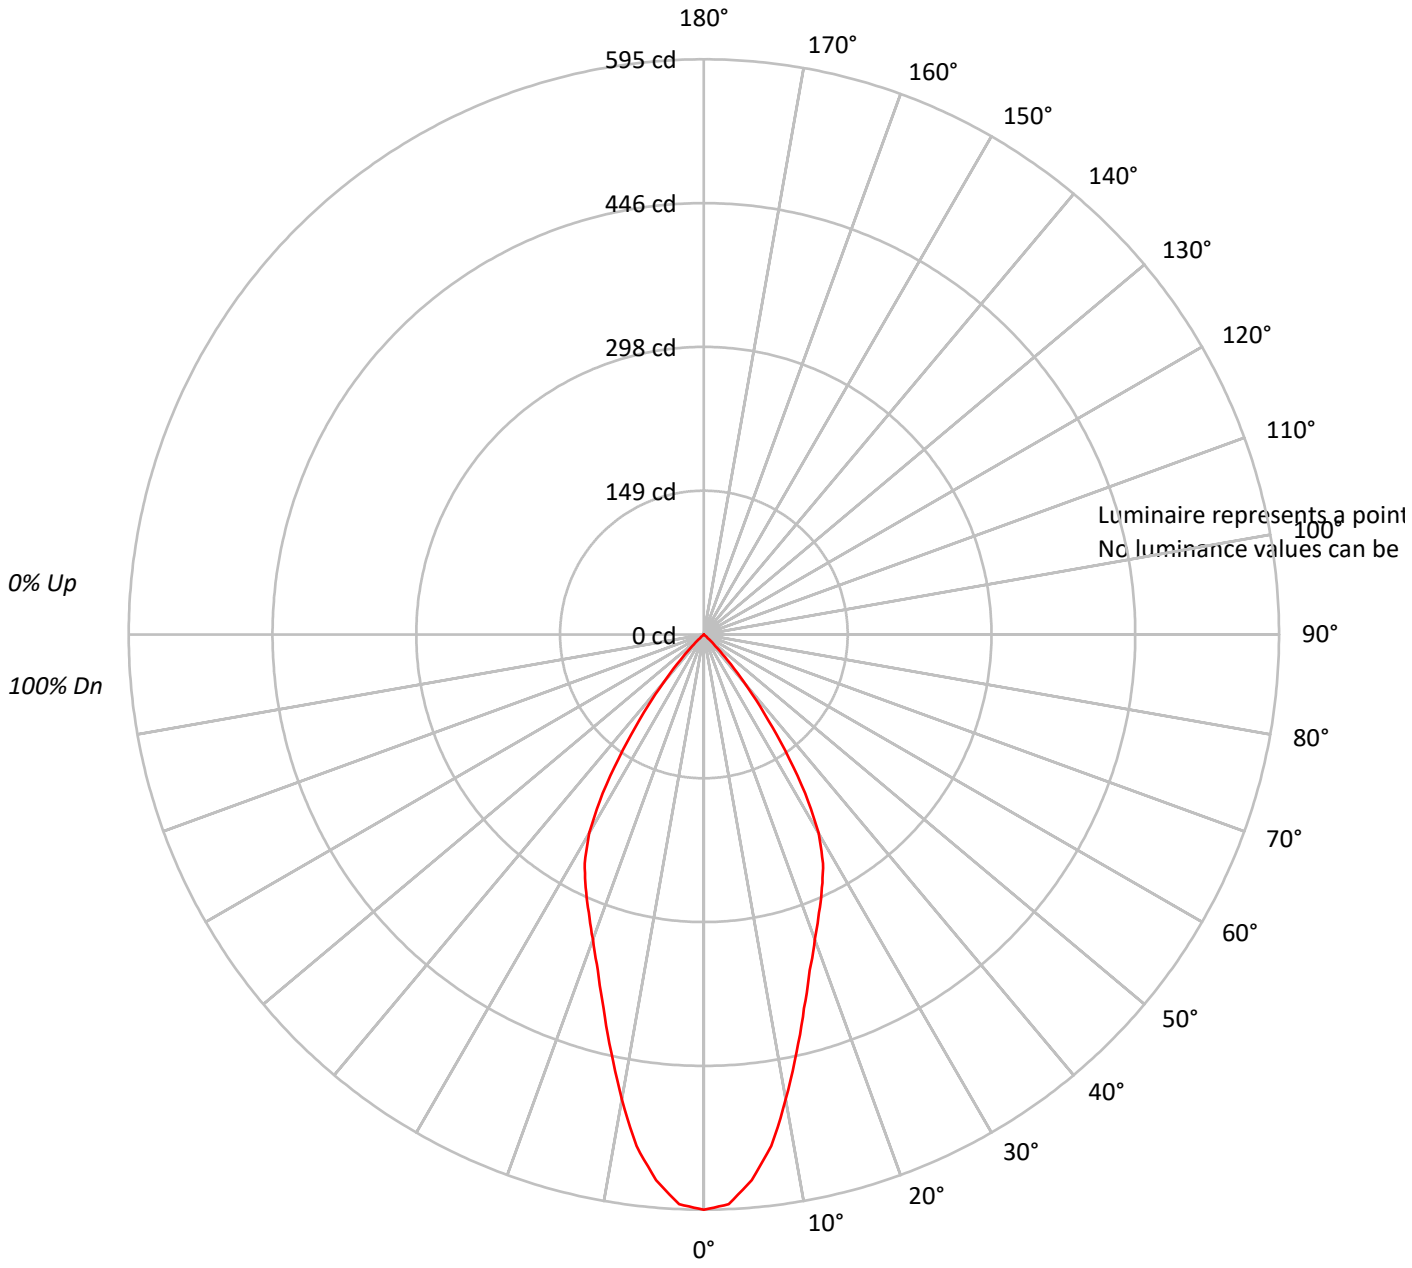

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

TEST NUMBER: P203940
CATALOG NUMBER: LSR6B10D010BZ EC6B10209050 6LBNB1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20			20			20			20
RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	111	109	107	111	109	107	105	105	103	102	101	100	99	98	97	96	94
2	108	104	100	97	106	102	99	96	99	96	93	96	94	91	93	91	90	88
3	103	97	92	88	101	96	91	88	93	89	86	91	88	85	88	86	84	82
4	98	91	86	82	96	90	85	81	88	84	80	86	82	79	84	81	78	77
5	93	85	80	76	92	85	79	75	83	78	75	81	77	74	80	76	73	72
6	89	80	75	71	88	80	74	70	78	73	70	77	73	69	75	72	69	67
7	85	76	70	66	83	75	70	66	74	69	65	73	68	65	72	68	65	63
8	81	72	66	62	80	71	66	62	70	65	61	69	64	61	68	64	61	60
9	77	68	62	58	76	67	62	58	66	61	58	65	61	58	65	61	58	56
10	74	64	59	55	73	64	58	55	63	58	55	62	58	55	62	57	54	53

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	
5°	
10°	
15°	
20°	
25°	
30°	
35°	
40°	
45°	
50°	
55°	
60°	
65°	
70°	
75°	
80°	
85°	

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P203940
CATALOG NUMBER: LSR6B10D010BZ EC6B10209050 6LBNB1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	51.6	12.8
10°-20°	112.5	27.8
20°-30°	132.2	32.7
30°-40°	91.0	22.5
40°-50°	16.8	4.2
50°-60°	0.0	0.0
60°-70°	0.0	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	296.4	73.3
0°-40°	387.4	95.8
0°-60°	404.3	100.0
0°-90°	404.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	404.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	595	
5°	566	52
15°	400	113
25°	289	132
35°	146	91
45°	17	17
55°	0	0
65°	0	0
75°	0	0
85°	0	0
90°	0	

TEST NUMBER: P203940
CATALOG NUMBER: LSR6B10D010BZ EC6B10209050 6LBNB1

CANDELA DISTRIBUTION (FULL):

	0°
0°	595.1
2.5°	589.8
5°	566.5
7.5°	533.7
10°	488.2
12.5°	442.6
15°	400.3
17.5°	364.3
20°	335.7
22.5°	311.3
25°	289.1
27.5°	266.9
30°	237.2
32.5°	194.8
35°	146.1
37.5°	101.7
40°	64.6
42.5°	36.0
45°	16.9
47.5°	5.3
50°	0.0
52.5°	0.0
55°	0.0
57.5°	0.0
60°	0.0
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Report Generated By E9808895 / USPTCWHP6082093

0°-180°

(END OF REPORT)