

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P205183

Luminaire Tested: **LSR6B15D010BZ EC6B10209027 6LBWLI1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P205183  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LSR6B15D010BZ EC6B10209027 6LBWL1  
Description: PORTFOLIO 6IN CYLINDER  
WIDE DISTRIBUTION WITH SPECULAR CLEAR TRIM  
WATTAGE D010TR-14.39 W DE010-14.29 W D5LT-14.34 W DMX-14.46 W DL2-15.8 W  
DL3-15.28 W DLE-15.432 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1217.1 lumens  
Efficiency: N/A  
Efficacy: 85.1 lumens/watt  
Spacing Criteria (0/90/45): 1.24 / 1.24 / 1.18  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 14.3  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P205183

CATALOG NUMBER: LSR6B15D010BZ EC6B10209027 6LBWLI1

### Luminous Intensity Polar Plot

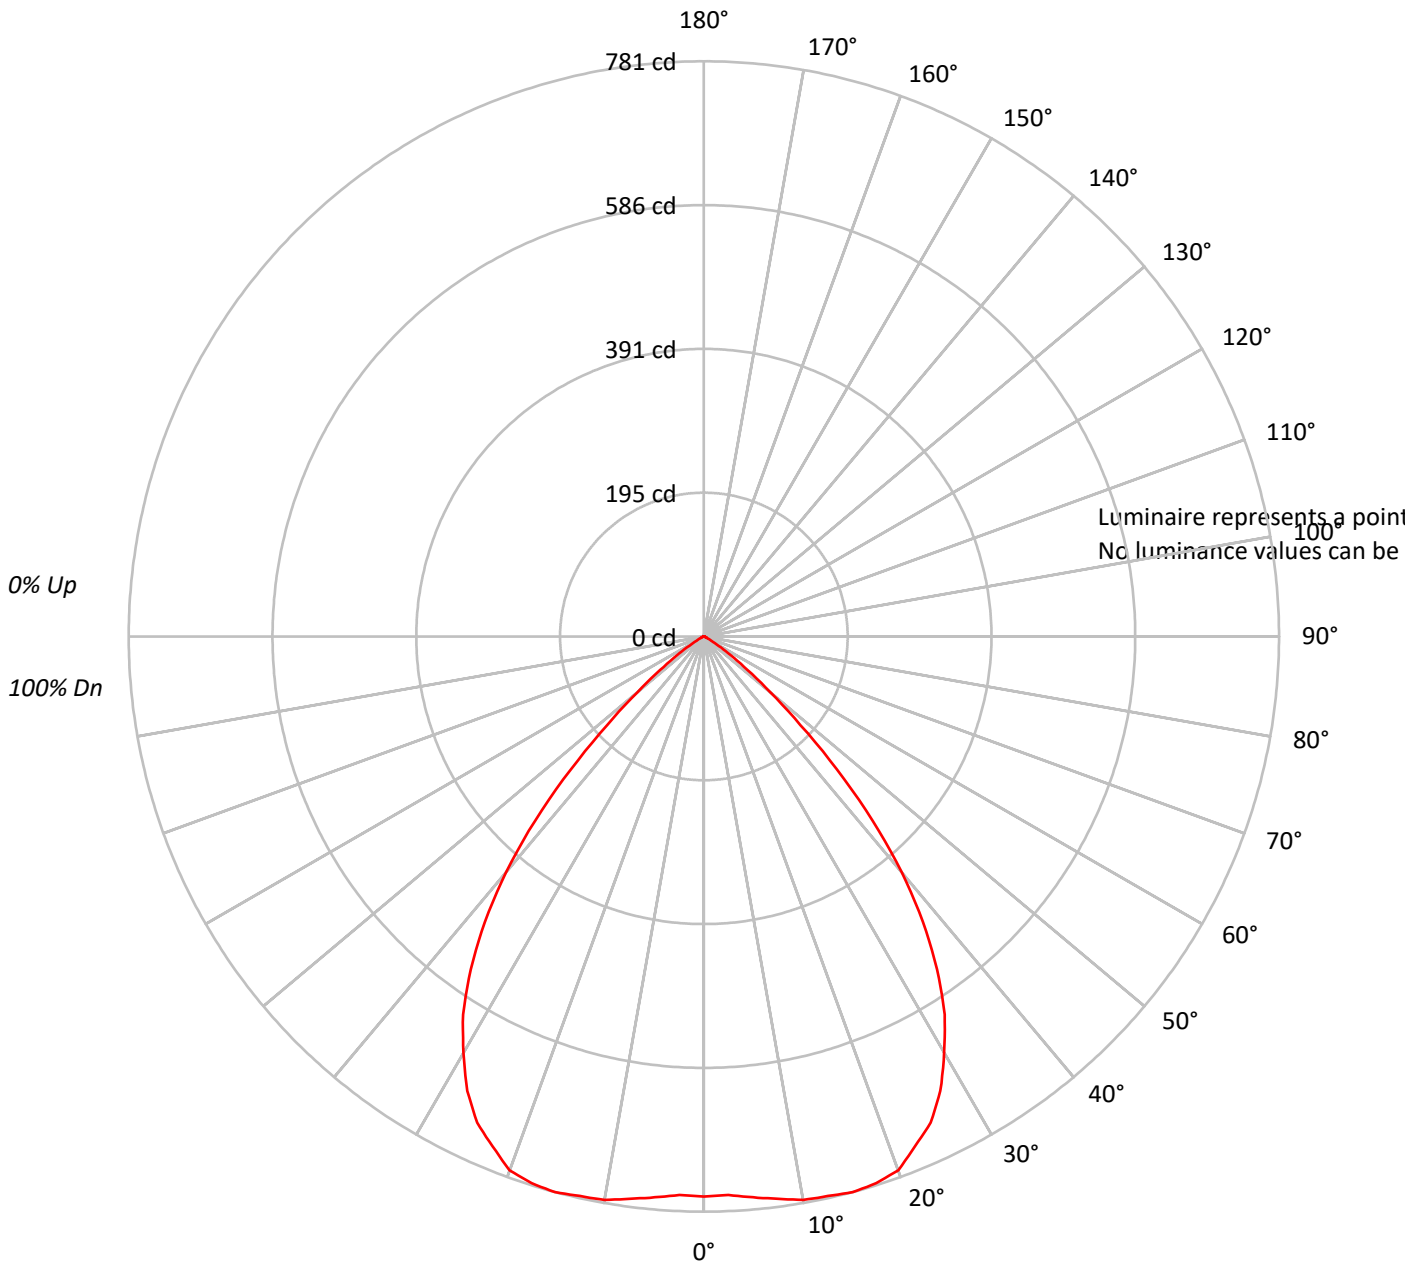



TEST NUMBER: P205183

CATALOG NUMBER: LSR6B15D010BZ EC6B10209027 6LBWLI1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	113	110	107	104	110	107	105	103	103	101	99	100	98	97	96	95	94	92			92																
2	106	101	96	92	104	99	95	91	95	92	89	92	90	87	90	87	85	83			83																
3	100	92	87	82	97	91	86	81	88	84	80	86	82	79	83	80	77	76			76																
4	93	85	78	73	92	84	78	73	81	76	72	79	75	71	77	74	70	69			69																
5	88	78	71	66	86	77	71	66	75	70	65	73	69	65	72	68	64	63			63																
6	82	72	65	60	81	71	65	60	70	64	59	68	63	59	67	62	59	57			57																
7	77	67	60	55	76	66	59	55	65	59	54	63	58	54	62	57	54	52			52																
8	73	62	55	50	71	61	55	50	60	54	50	59	54	50	58	53	49	48			48																
9	69	57	51	46	67	57	50	46	56	50	46	55	50	46	54	49	46	44			44																
10	65	54	47	43	64	53	47	42	52	46	42	51	46	42	51	46	42	41			41																

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P205183

CATALOG NUMBER: LSR6B15D010BZ EC6B10209027 6LBWLI1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	73.4	6.0
10°-20°	220.5	18.1
20°-30°	332.3	27.3
30°-40°	340.2	27.9
40°-50°	198.2	16.3
50°-60°	45.5	3.7
60°-70°	5.6	0.5
70°-80°	1.5	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	626.2	51.4
0°-40°	966.4	79.4
0°-60°	1210.1	99.4
0°-90°	1217.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1217.1	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	760	
5°	764	73
15°	781	220
25°	729	332
35°	552	340
45°	255	198
55°	44	46
65°	4	6
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P205183

CATALOG NUMBER: LSR6B15D010BZ EC6B10209027 6LBWLI1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	760.4
2.5°	759.0
5°	764.5
7.5°	770.0
10°	776.9
12.5°	778.3
15°	781.1
17.5°	778.3
20°	771.4
22.5°	749.3
25°	728.6
27.5°	695.5
30°	652.7
32.5°	608.6
35°	552.0
37.5°	488.5
40°	418.1
42.5°	339.5
45°	255.3
47.5°	178.0
50°	117.3
52.5°	74.5
55°	44.2
57.5°	23.5
60°	12.4
62.5°	6.9
65°	4.1
67.5°	4.1
70°	2.8
72.5°	1.4
75°	1.4
77.5°	1.4
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)