

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P205285

Luminaire Tested: **LSR6B15D010BZ EC6B10209030 6LBNI1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P205285
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LSR6B15D010BZ EC6B10209030 6LBNLI1
Description: PORTFOLIO 6IN CYLINDER
NARROW DISTRIBUTION WITH SPECULAR CLEAR TRIM
WATTAGE D010TR-14.39 W DE010-14.29 W D5LT-14.34 W DMX-14.46 W DL2-15.8 W
DL3-15.28 W DLE-15.432 W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 995.9 lumens
Efficiency: N/A
Efficacy: 69.6 lumens/watt
Spacing Criteria (0/90/45): 0.53 / 0.53 / 0.58
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 14.3
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P205285

CATALOG NUMBER: LSR6B15D010BZ EC6B10209030 6LBNLI1

Luminous Intensity Polar Plot

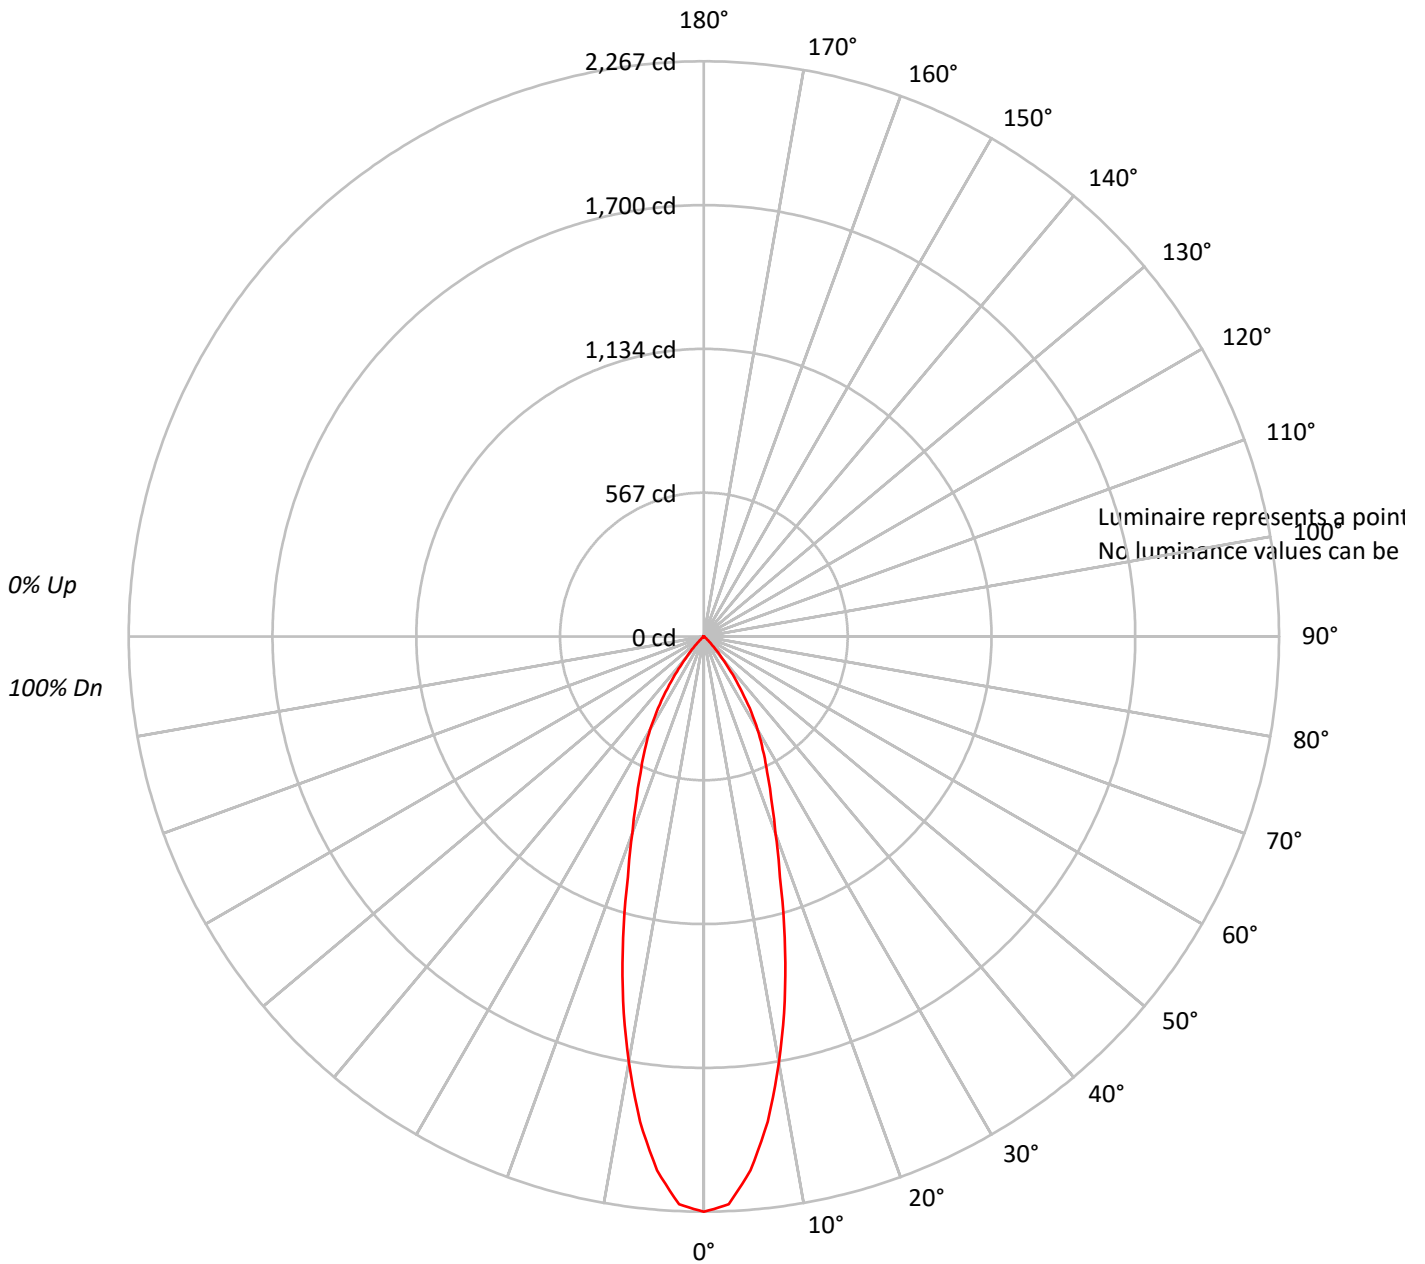



TEST NUMBER: P205285

CATALOG NUMBER: LSR6B15D010BZ EC6B10209030 6LBNLI1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|---|
| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | | | | |
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | | | 0 | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 |
| RCR | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | |
| 1 | 114 | 112 | 109 | 107 | 112 | 109 | 107 | 106 | 105 | 104 | 102 | 102 | 101 | 99 | 98 | 97 | 96 | 95 | | | |
| 2 | 109 | 105 | 101 | 98 | 107 | 103 | 100 | 97 | 100 | 97 | 95 | 97 | 95 | 93 | 94 | 93 | 91 | 89 | | | |
| 3 | 105 | 99 | 94 | 91 | 103 | 97 | 93 | 90 | 95 | 91 | 89 | 93 | 90 | 87 | 90 | 88 | 86 | 85 | | | |
| 4 | 100 | 93 | 88 | 85 | 98 | 92 | 88 | 84 | 90 | 86 | 83 | 88 | 85 | 82 | 86 | 84 | 81 | 80 | | | |
| 5 | 96 | 88 | 83 | 79 | 94 | 87 | 83 | 79 | 86 | 82 | 78 | 84 | 81 | 78 | 83 | 80 | 77 | 76 | | | |
| 6 | 92 | 84 | 79 | 75 | 90 | 83 | 78 | 75 | 82 | 77 | 74 | 80 | 76 | 74 | 79 | 76 | 73 | 72 | | | |
| 7 | 88 | 80 | 74 | 71 | 87 | 79 | 74 | 71 | 78 | 73 | 70 | 77 | 73 | 70 | 76 | 72 | 69 | 68 | | | |
| 8 | 84 | 76 | 71 | 67 | 83 | 75 | 70 | 67 | 74 | 70 | 67 | 73 | 69 | 66 | 73 | 69 | 66 | 65 | | | |
| 9 | 81 | 73 | 67 | 64 | 80 | 72 | 67 | 64 | 71 | 67 | 63 | 70 | 66 | 63 | 70 | 66 | 63 | 62 | | | |
| 10 | 78 | 69 | 64 | 61 | 77 | 69 | 64 | 61 | 68 | 64 | 61 | 67 | 63 | 60 | 67 | 63 | 60 | 59 | | | |

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P205285

CATALOG NUMBER: LSR6B15D010BZ EC6B10209030 6LBNLI1

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 188.5 | 18.9 |
| 10°-20° | 338.4 | 34.0 |
| 20°-30° | 273.6 | 27.5 |
| 30°-40° | 157.6 | 15.8 |
| 40°-50° | 33.3 | 3.3 |
| 50°-60° | 2.9 | 0.3 |
| 60°-70° | 1.4 | 0.1 |
| 70°-80° | 0.2 | 0.0 |
| 80°-90° | 0.0 | 0.0 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 800.5 | 80.4 |
| 0°-40° | 958.1 | 96.2 |
| 0°-60° | 994.3 | 99.8 |
| 0°-90° | 995.9 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 995.9 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 2267 | |
| 5° | 2112 | 189 |
| 15° | 1229 | 338 |
| 25° | 590 | 274 |
| 35° | 250 | 158 |
| 45° | 36 | 33 |
| 55° | 3 | 3 |
| 65° | 1 | 1 |
| 75° | 0 | 0 |
| 85° | 0 | 0 |
| 90° | 0 | |



TEST NUMBER: P205285

CATALOG NUMBER: LSR6B15D010BZ EC6B10209030 6LBNLI1

CANDELA DISTRIBUTION (FULL):

| 0° | |
|-------|--------|
| 0° | 2267.4 |
| 2.5° | 2240.1 |
| 5° | 2112.3 |
| 7.5° | 1928.5 |
| 10° | 1703.1 |
| 12.5° | 1471.9 |
| 15° | 1229.2 |
| 17.5° | 995.1 |
| 20° | 824.3 |
| 22.5° | 693.6 |
| 25° | 590.2 |
| 27.5° | 502.6 |
| 30° | 423.6 |
| 32.5° | 336.0 |
| 35° | 249.9 |
| 37.5° | 173.8 |
| 40° | 113.4 |
| 42.5° | 68.9 |
| 45° | 35.9 |
| 47.5° | 14.4 |
| 50° | 4.3 |
| 52.5° | 4.3 |
| 55° | 2.9 |
| 57.5° | 2.9 |
| 60° | 1.4 |
| 62.5° | 1.4 |
| 65° | 1.4 |
| 67.5° | 1.4 |
| 70° | 1.4 |
| 72.5° | 0.0 |
| 75° | 0.0 |
| 77.5° | 0.0 |
| 80° | 0.0 |
| 82.5° | 0.0 |
| 85° | 0.0 |
| 87.5° | 0.0 |
| 90° | 0.0 |



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)