

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P202619

Luminaire Tested: **LSR6B20D010BZ EC6B10208035 6LBMWMH1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P202619  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LSR6B20D010BZ EC6B10208035 6LBMWMH1  
Description: PORTFOLIO 6IN CYLINDER  
MEDIUM DISTRIBUTION WITH WARM HAZE TRIM  
WATTAGE D010TR-21.86 W DE010-20.46 W D5LT-21.24 W DMX-20.89 W DL2-22.5 W  
DL3-21.8 6 W DLE-22.46 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1638.5 lumens  
Efficiency: N/A  
Efficacy: 78.8 lumens/watt  
Spacing Criteria (0/90/45): 0.9 / 0.9 / 0.89  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 20.8  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P202619

CATALOG NUMBER: LSR6B20D010BZ EC6B10208035 6LBMWMH1

### Luminous Intensity Polar Plot

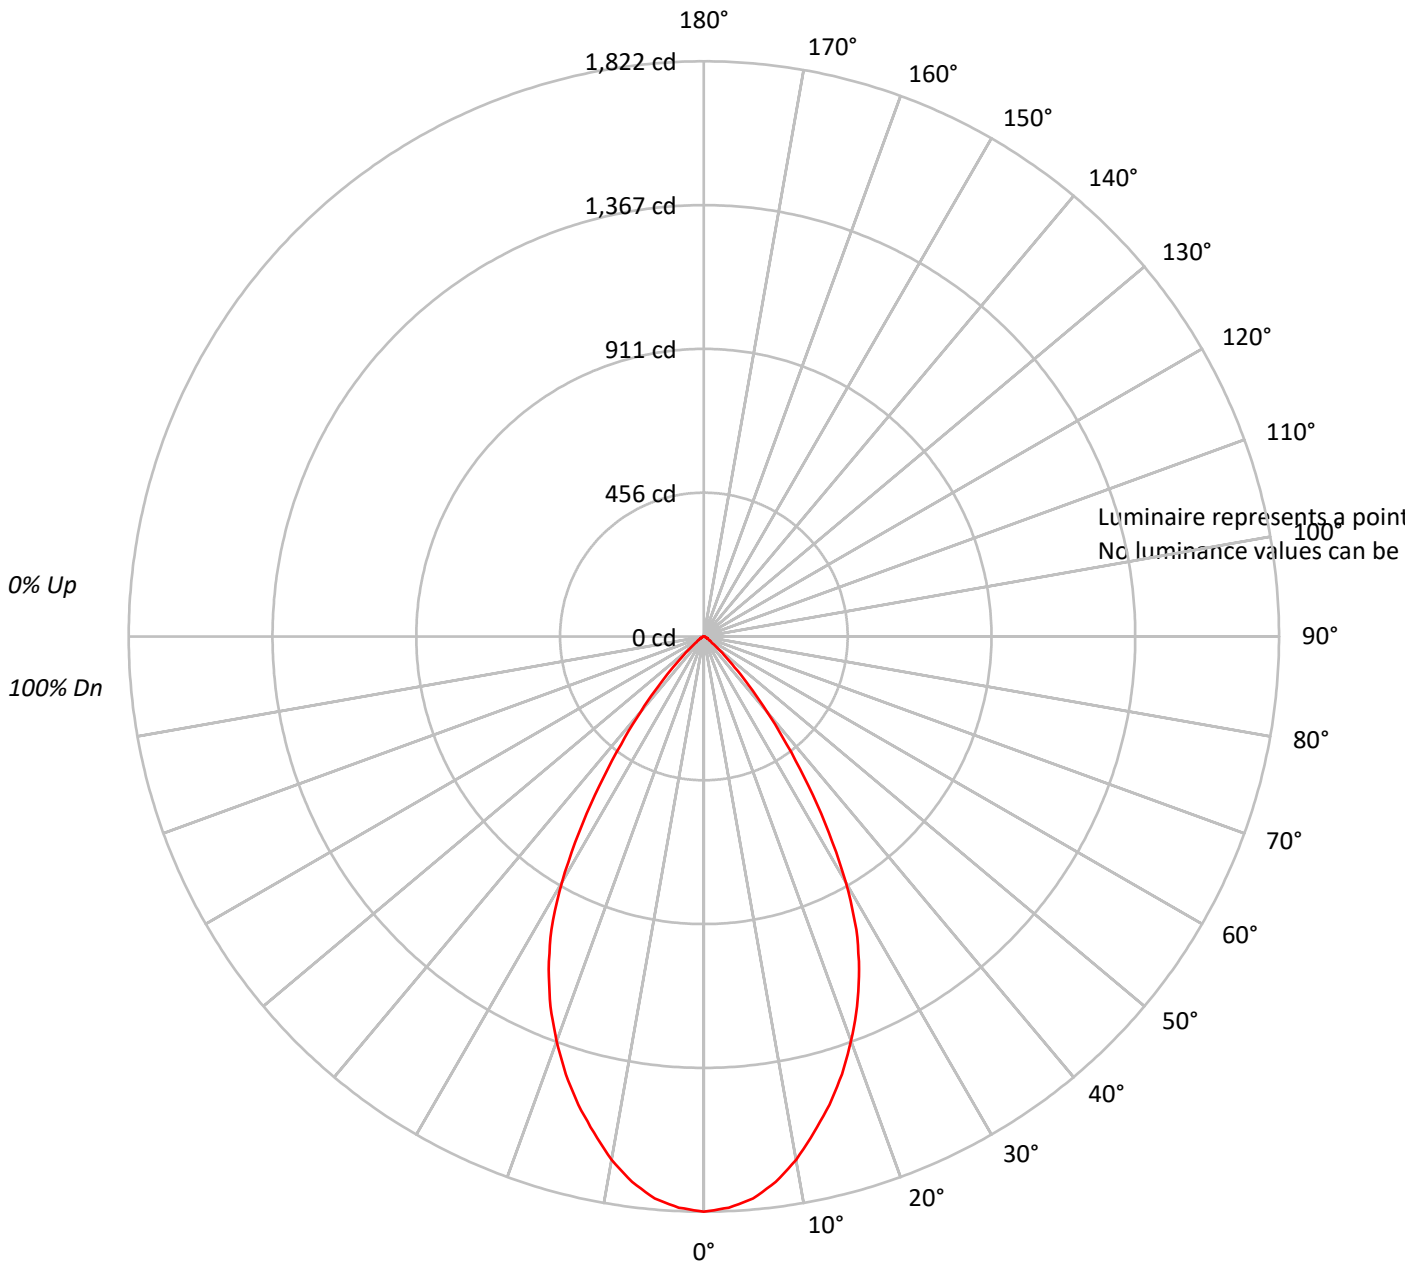



TEST NUMBER: P202619

CATALOG NUMBER: LSR6B20D010BZ EC6B10208035 6LBMWMH1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93																			
2	108	103	99	95	105	101	97	94	98	95	92	95	92	90	92	90	88	86																			
3	102	95	90	86	100	94	89	86	91	88	84	89	86	83	87	84	82	80																			
4	97	89	83	79	95	88	83	79	86	81	78	84	80	77	82	79	76	74																			
5	92	83	77	73	90	82	77	73	80	76	72	79	75	71	77	74	71	69																			
6	87	78	72	67	85	77	71	67	76	71	67	74	70	66	73	69	66	64																			
7	83	73	67	63	81	72	67	63	71	66	62	70	65	62	69	65	61	60																			
8	78	69	63	58	77	68	62	58	67	62	58	66	61	58	65	61	58	56																			
9	75	65	59	55	73	64	59	55	63	58	54	62	58	54	62	57	54	53																			
10	71	61	55	51	70	61	55	51	60	55	51	59	54	51	58	54	51	50																			

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P202619

CATALOG NUMBER: LSR6B20D010BZ EC6B10208035 6LBMWMH1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	167.2	10.2
10°-20°	429.3	26.2
20°-30°	527.3	32.2
30°-40°	361.6	22.1
40°-50°	116.2	7.1
50°-60°	23.6	1.4
60°-70°	9.2	0.6
70°-80°	3.5	0.2
80°-90°	0.6	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1123.8	68.6
0°-40°	1485.4	90.7
0°-60°	1625.2	99.2
0°-90°	1638.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1638.5	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1822	
5°	1787	167
15°	1536	429
25°	1163	527
35°	577	362
45°	138	116
55°	24	24
65°	10	9
75°	3	4
85°	0	1
90°	0	



TEST NUMBER: P202619

CATALOG NUMBER: LSR6B20D010BZ EC6B10208035 6LBMWMH1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1822.1
2.5°	1811.0
5°	1787.4
7.5°	1742.9
10°	1683.1
12.5°	1609.5
15°	1535.8
17.5°	1453.8
20°	1363.5
22.5°	1268.9
25°	1163.3
27.5°	1046.6
30°	899.2
32.5°	736.6
35°	576.8
37.5°	430.9
40°	309.9
42.5°	211.3
45°	137.6
47.5°	84.8
50°	51.4
52.5°	32.0
55°	23.6
57.5°	18.1
60°	13.9
62.5°	11.1
65°	9.7
67.5°	6.9
70°	5.6
72.5°	4.2
75°	2.8
77.5°	2.8
80°	1.4
82.5°	1.4
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)