

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P203547

Luminaire Tested: **LSR6B20D010BZ EC6B10208040 6LBMMW1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P203547  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LSR6B20D010BZ EC6B10208040 6LBMMW1  
Description: PORTFOLIO 6IN CYLINDER  
MEDIUM DISTRIBUTION WITH MATTE WHITE TRIM  
WATTAGE D010TR-21.86 W DE010-20.46 W D5LT-21.24 W DMX-20.89 W DL2-22.5 W  
DL3-21.8 6 W DLE-22.46 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1693.0 lumens  
Efficiency: N/A  
Efficacy: 81.4 lumens/watt  
Spacing Criteria (0/90/45): 1 / 1 / 0.97  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 20.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P203547

CATALOG NUMBER: LSR6B20D010BZ EC6B10208040 6LBMMW1

### Luminous Intensity Polar Plot

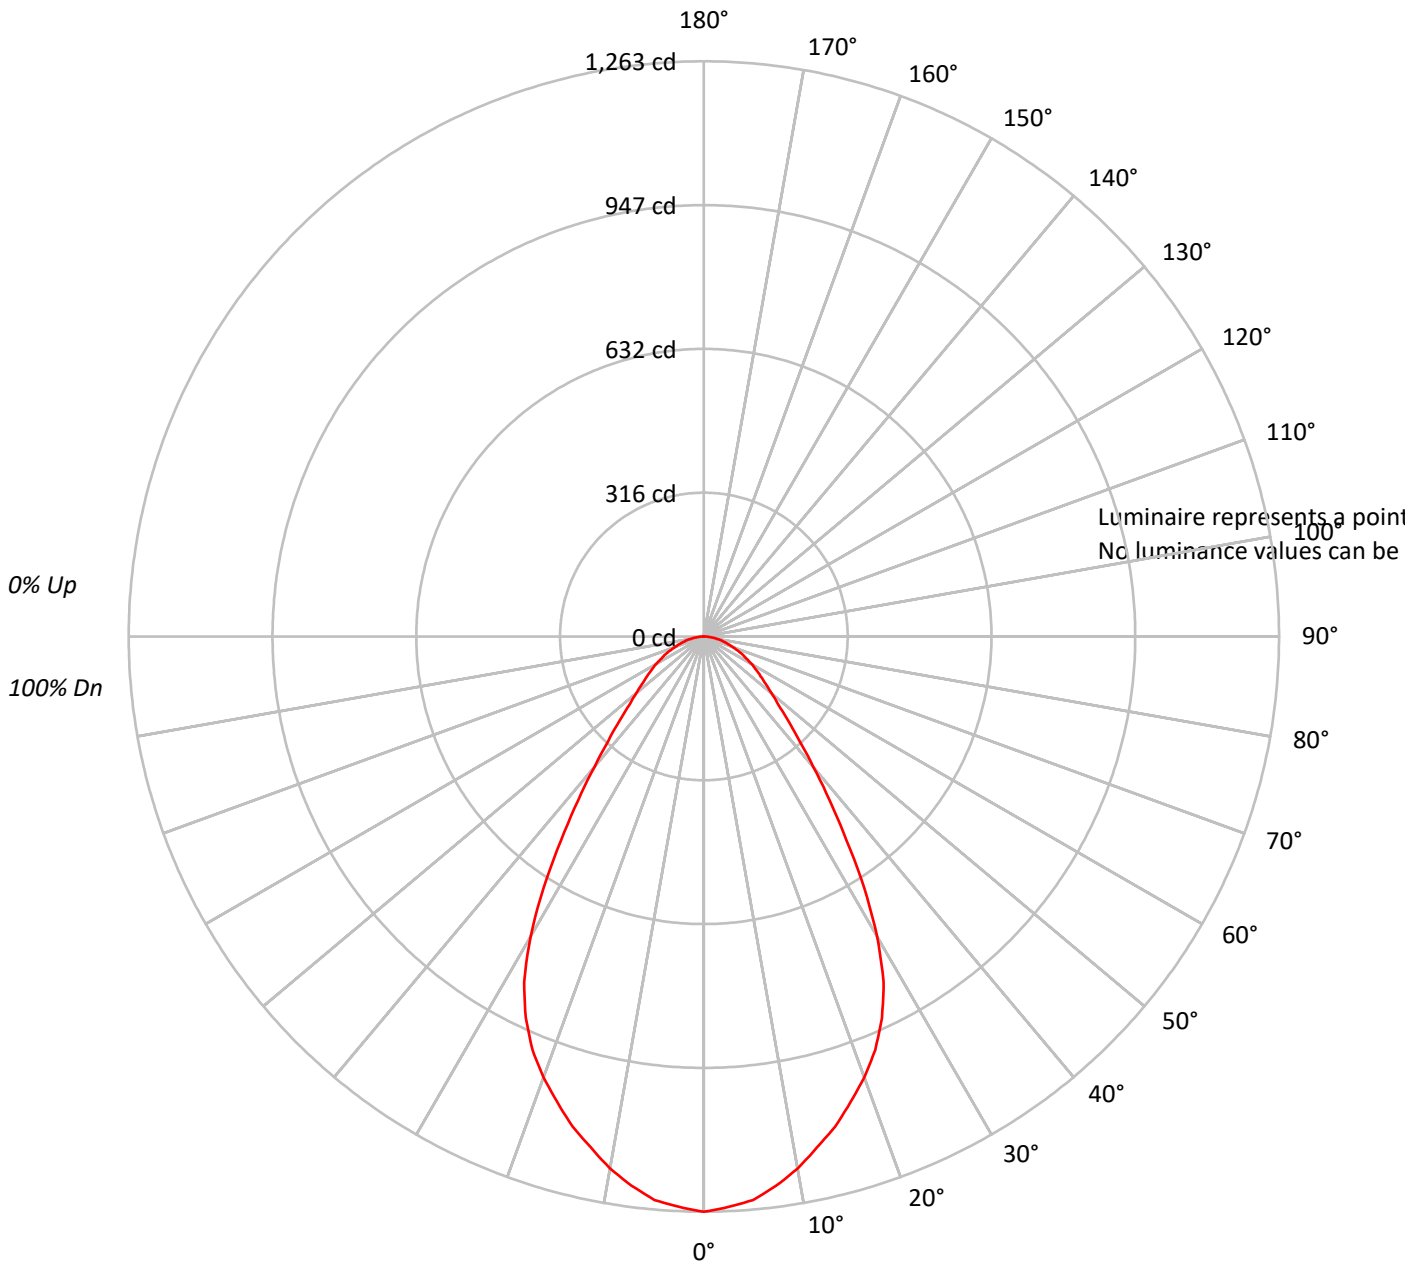



TEST NUMBER: P203547

CATALOG NUMBER: LSR6B20D010BZ EC6B10208040 6LBMMW1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	111	108	104	101	109	105	103	100	101	99	97	98	96	94	94	92	91	89																			
2	104	97	92	88	101	96	91	87	92	88	85	89	86	83	86	83	81	79																			
3	97	88	82	77	95	87	81	76	84	79	75	82	77	74	79	76	73	71																			
4	90	81	74	68	88	80	73	68	77	72	67	75	70	66	73	69	65	64																			
5	85	74	67	61	83	73	66	61	71	65	61	69	64	60	68	63	59	58																			
6	79	68	61	56	78	68	61	56	66	60	55	64	59	55	63	58	54	53																			
7	75	63	56	51	73	63	56	51	61	55	50	60	54	50	59	54	50	48																			
8	70	59	52	47	69	58	51	47	57	51	46	56	50	46	55	50	46	44																			
9	66	55	48	43	65	54	48	43	53	47	43	52	47	43	51	46	43	41																			
10	63	51	45	40	62	51	44	40	50	44	40	49	44	40	48	43	40	38																			

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P203547

CATALOG NUMBER: LSR6B20D010BZ EC6B10208040 6LBMMW1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	116.7	6.9
10°-20°	312.6	18.5
20°-30°	419.7	24.8
30°-40°	344.3	20.3
40°-50°	206.7	12.2
50°-60°	137.4	8.1
60°-70°	92.1	5.4
70°-80°	49.6	2.9
80°-90°	14.0	0.8
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	849.0	50.1
0°-40°	1193.2	70.5
0°-60°	1537.4	90.8
0°-90°	1693.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1693.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1263	
5°	1242	117
15°	1114	313
25°	925	420
35°	546	344
45°	262	207
55°	152	137
65°	93	92
75°	47	50
85°	12	14
90°	0	



TEST NUMBER: P203547

CATALOG NUMBER: LSR6B20D010BZ EC6B10208040 6LBMMW1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1263.2
2.5°	1253.9
5°	1242.2
7.5°	1216.5
10°	1186.2
12.5°	1148.8
15°	1113.8
17.5°	1071.8
20°	1029.7
22.5°	983.0
25°	924.7
27.5°	854.6
30°	761.2
32.5°	656.1
35°	546.4
37.5°	453.0
40°	373.6
42.5°	310.6
45°	261.5
47.5°	221.8
50°	193.8
52.5°	170.5
55°	151.8
57.5°	135.4
60°	121.4
62.5°	105.1
65°	93.4
67.5°	79.4
70°	67.7
72.5°	56.0
75°	46.7
77.5°	37.4
80°	28.0
82.5°	21.0
85°	11.7
87.5°	4.7
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)