

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P205193

Luminaire Tested: **LSR6B20D010BZ EC6B10208040 6LBWLI1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P205193
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LSR6B20D010BZ EC6B10208040 6LBWLI1
Description: PORTFOLIO 6IN CYLINDER
WIDE DISTRIBUTION WITH SPECULAR CLEAR TRIM
WATTAGE D010TR-21.86 W DE010-20.46 W D5LT-21.24 W DMX-20.89 W DL2-22.5 W
DL3-21.8 6 W DLE-22.46 W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2133.2 lumens
Efficiency: N/A
Efficacy: 102.6 lumens/watt
Spacing Criteria (0/90/45): 1.24 / 1.24 / 1.18
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 20.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P205193

CATALOG NUMBER: LSR6B20D010BZ EC6B10208040 6LBWLI1

Luminous Intensity Polar Plot

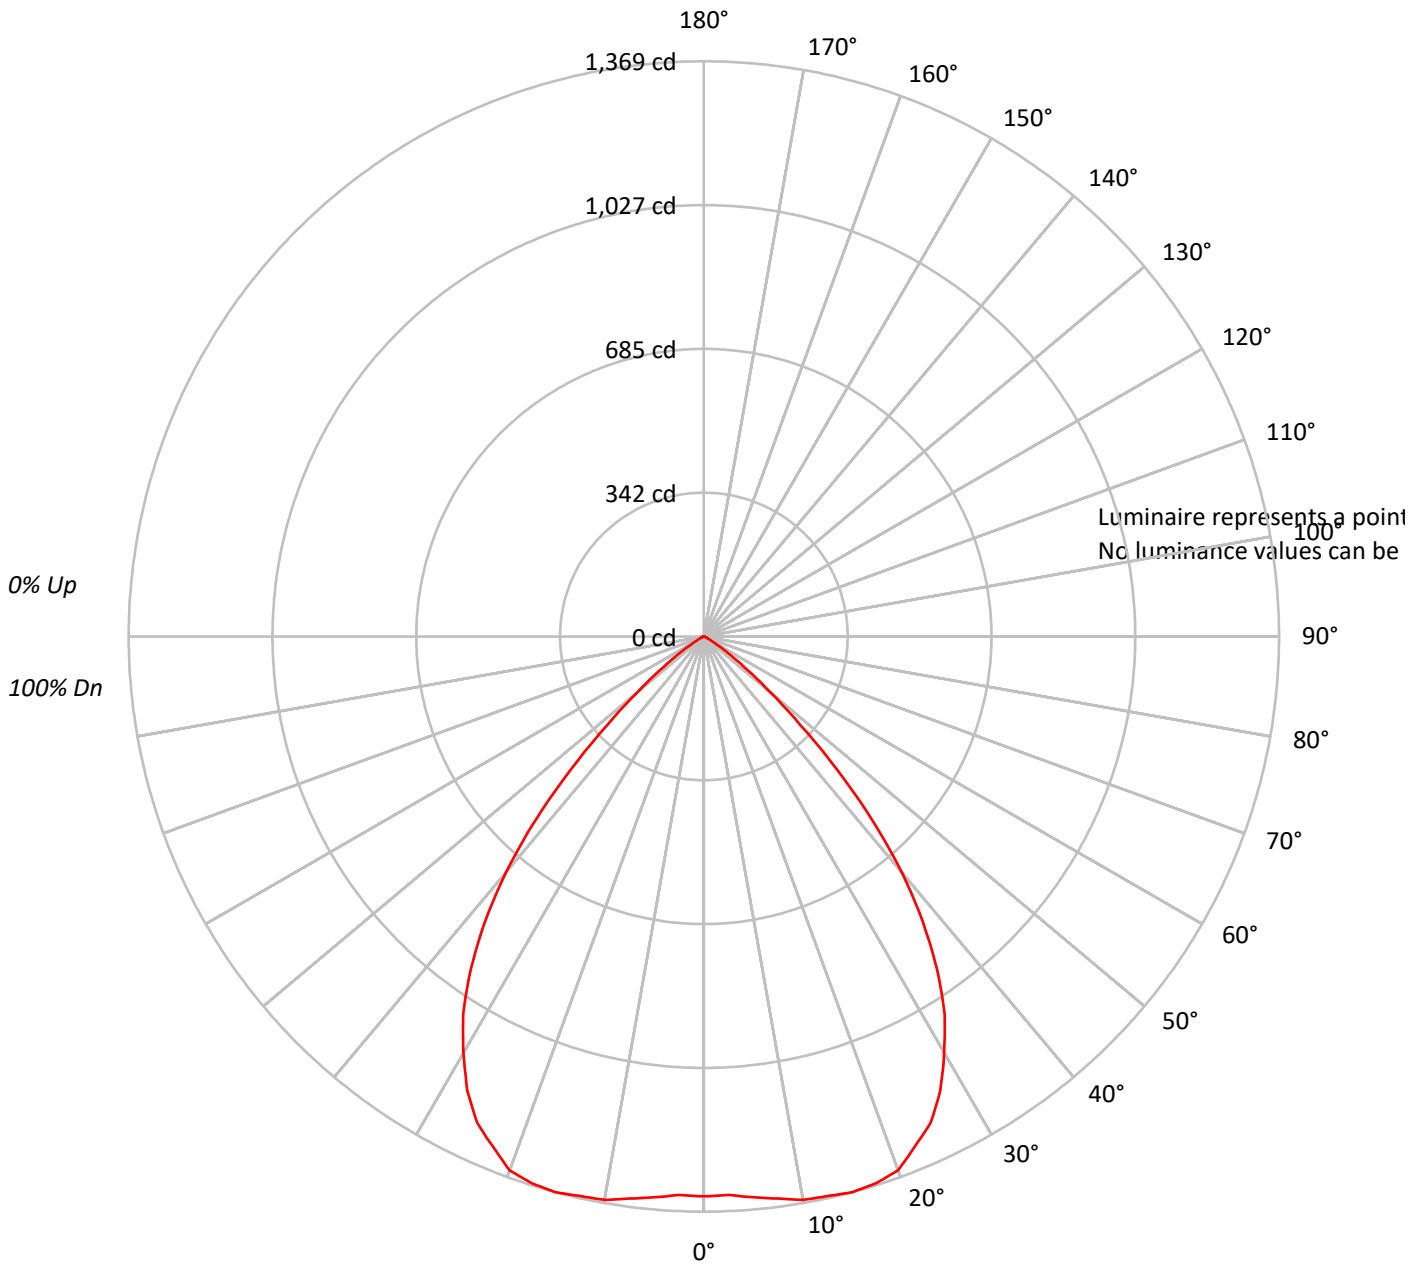



TEST NUMBER: P205193

CATALOG NUMBER: LSR6B20D010BZ EC6B10208040 6LBWLI1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|----|----|----|----|----|----|----|----|----|---|--|--|--|--|--|--|----|--|--|--|--|--|--|--|--|---|--|--|--|--|--|--|--|--|
| RF | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | | | | | | | | | |
| RC | 80 | | | | | | | | | 70 | | | | | | | | | 50 | | | | | | | | | 30 | | | | | | | | | 10 | | | | | | | | | 0 | | | | | | | | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 | | | | | | | | | | | | | | | | | | | | | | | | |
| RCR | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 1 | 113 | 110 | 107 | 104 | 110 | 107 | 105 | 103 | 103 | 101 | 99 | 100 | 98 | 97 | 96 | 95 | 94 | 92 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 2 | 106 | 101 | 96 | 92 | 104 | 99 | 95 | 91 | 95 | 92 | 89 | 92 | 90 | 87 | 90 | 87 | 85 | 83 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 3 | 100 | 92 | 87 | 82 | 97 | 91 | 86 | 81 | 88 | 84 | 80 | 86 | 82 | 79 | 83 | 80 | 77 | 76 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 4 | 93 | 85 | 78 | 73 | 92 | 84 | 78 | 73 | 81 | 76 | 72 | 79 | 75 | 71 | 77 | 74 | 70 | 69 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 5 | 88 | 78 | 71 | 66 | 86 | 77 | 71 | 66 | 75 | 70 | 65 | 73 | 69 | 65 | 72 | 68 | 64 | 63 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 6 | 82 | 72 | 65 | 60 | 81 | 71 | 65 | 60 | 70 | 64 | 59 | 68 | 63 | 59 | 67 | 62 | 59 | 57 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 7 | 77 | 67 | 60 | 55 | 76 | 66 | 59 | 55 | 65 | 59 | 54 | 63 | 58 | 54 | 62 | 57 | 54 | 52 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8 | 73 | 62 | 55 | 50 | 71 | 61 | 55 | 50 | 60 | 54 | 50 | 59 | 54 | 50 | 58 | 53 | 49 | 48 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 9 | 69 | 57 | 51 | 46 | 67 | 57 | 50 | 46 | 56 | 50 | 46 | 55 | 50 | 46 | 54 | 49 | 46 | 44 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 10 | 65 | 54 | 47 | 43 | 64 | 53 | 47 | 42 | 52 | 46 | 42 | 51 | 46 | 42 | 51 | 46 | 42 | 41 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P205193

CATALOG NUMBER: LSR6B20D010BZ EC6B10208040 6LBWLI1

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 128.6 | 6.0 |
| 10°-20° | 386.4 | 18.1 |
| 20°-30° | 582.5 | 27.3 |
| 30°-40° | 596.2 | 27.9 |
| 40°-50° | 347.3 | 16.3 |
| 50°-60° | 79.8 | 3.7 |
| 60°-70° | 9.8 | 0.5 |
| 70°-80° | 2.5 | 0.1 |
| 80°-90° | 0.0 | 0.0 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 1097.5 | 51.4 |
| 0°-40° | 1693.7 | 79.4 |
| 0°-60° | 2120.8 | 99.4 |
| 0°-90° | 2133.2 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 2133.2 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 1333 | |
| 5° | 1340 | 129 |
| 15° | 1369 | 386 |
| 25° | 1277 | 582 |
| 35° | 967 | 596 |
| 45° | 447 | 347 |
| 55° | 77 | 80 |
| 65° | 7 | 10 |
| 75° | 2 | 3 |
| 85° | 0 | 0 |
| 90° | 0 | |



TEST NUMBER: P205193

CATALOG NUMBER: LSR6B20D010BZ EC6B10208040 6LBWLI1

CANDELA DISTRIBUTION (FULL):

| | 0° |
|-------|--------|
| 0° | 1332.6 |
| 2.5° | 1330.2 |
| 5° | 1339.9 |
| 7.5° | 1349.5 |
| 10° | 1361.6 |
| 12.5° | 1364.1 |
| 15° | 1368.9 |
| 17.5° | 1364.1 |
| 20° | 1352.0 |
| 22.5° | 1313.3 |
| 25° | 1277.0 |
| 27.5° | 1218.9 |
| 30° | 1144.0 |
| 32.5° | 1066.6 |
| 35° | 967.4 |
| 37.5° | 856.2 |
| 40° | 732.8 |
| 42.5° | 595.0 |
| 45° | 447.4 |
| 47.5° | 312.0 |
| 50° | 205.6 |
| 52.5° | 130.6 |
| 55° | 77.4 |
| 57.5° | 41.1 |
| 60° | 21.8 |
| 62.5° | 12.1 |
| 65° | 7.3 |
| 67.5° | 7.3 |
| 70° | 4.8 |
| 72.5° | 2.4 |
| 75° | 2.4 |
| 77.5° | 2.4 |
| 80° | 0.0 |
| 82.5° | 0.0 |
| 85° | 0.0 |
| 87.5° | 0.0 |
| 90° | 0.0 |



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)