

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P202742

Luminaire Tested: **LSR6B30D010BZ EC6B30509040 6LBWH1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P202742  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LSR6B30D010BZ EC6B30509040 6LBWH1  
Description: PORTFOLIO 6IN CYLINDER  
WIDE DISTRIBUTION WITH SEMI-SPECULAR CLEAR TRIM  
WATTAGE D010TR-27.4 W DE010-27.95 W D5LT-27.65 W DMX-27.73 W DL2-29.56 W  
DL3-29.67 W DLE-29.73 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 2267.9 lumens  
Efficiency: N/A  
Efficacy: 81.0 lumens/watt  
Spacing Criteria (0/90/45): 1.16 / 1.16 / 1.16  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 28  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P202742

CATALOG NUMBER: LSR6B30D010BZ EC6B30509040 6LBWH1

### Luminous Intensity Polar Plot

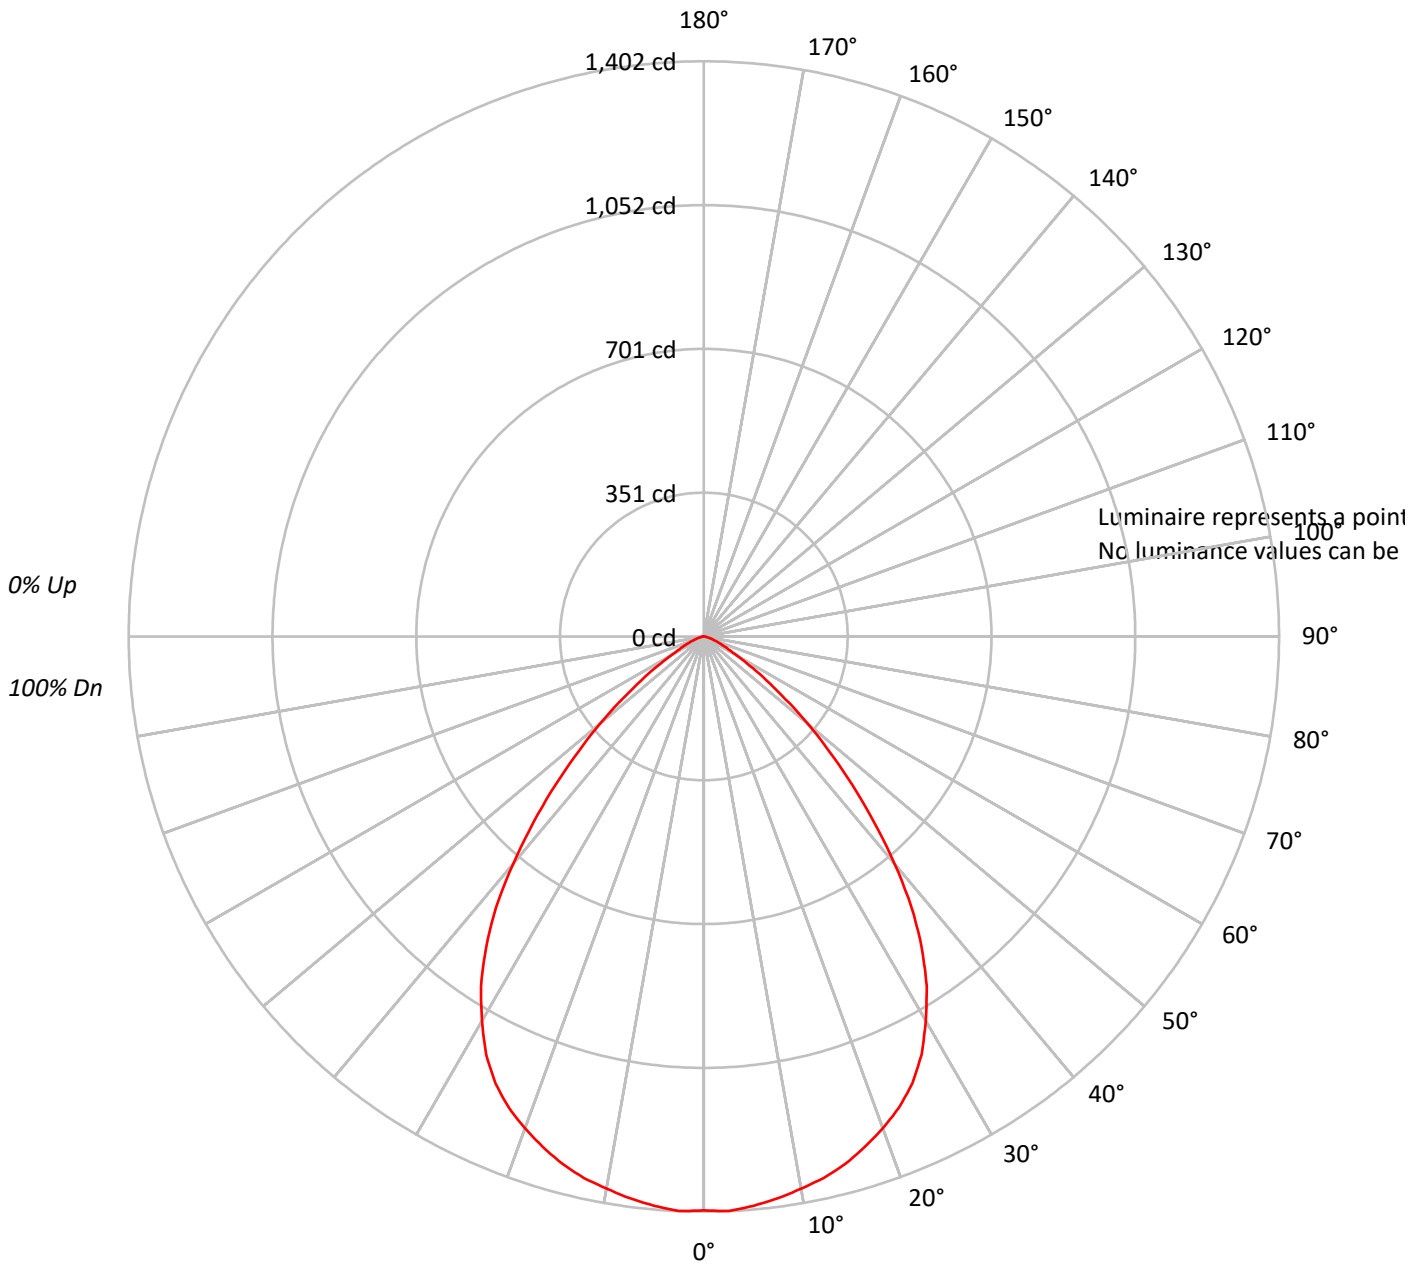



TEST NUMBER: P202742

CATALOG NUMBER: LSR6B30D010BZ EC6B30509040 6LBWH1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	112	109	106	103	110	107	104	101	103	100	98	99	97	95	95	94	93	91																			
2	105	99	94	90	103	97	93	89	94	90	87	91	88	85	88	85	83	81																			
3	98	90	84	79	96	89	83	78	86	81	77	83	79	76	81	78	75	73																			
4	92	82	75	70	90	81	75	70	79	73	69	77	72	68	75	71	67	65																			
5	86	75	68	63	84	74	68	63	72	66	62	71	65	61	69	64	61	59																			
6	80	69	62	57	78	68	61	56	67	61	56	65	60	56	64	59	55	53																			
7	75	64	56	51	73	63	56	51	62	55	51	60	55	51	59	54	50	49																			
8	70	59	52	47	69	58	51	47	57	51	46	56	50	46	55	50	46	44																			
9	66	55	48	43	65	54	47	43	53	47	43	52	47	42	51	46	42	41																			
10	62	51	44	40	61	50	44	39	50	43	39	49	43	39	48	43	39	38																			

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P202742

CATALOG NUMBER: LSR6B30D010BZ EC6B30509040 6LBWH1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	132.1	5.8
10°-20°	374.9	16.5
20°-30°	549.7	24.2
30°-40°	572.1	25.2
40°-50°	395.8	17.5
50°-60°	172.3	7.6
60°-70°	52.8	2.3
70°-80°	15.9	0.7
80°-90°	2.4	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1056.7	46.6
0°-40°	1628.7	71.8
0°-60°	2196.8	96.9
0°-90°	2267.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2267.9	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1399	
5°	1393	132
15°	1331	375
25°	1202	550
35°	926	572
45°	511	396
55°	185	172
65°	50	53
75°	15	16
85°	3	2
90°	0	



TEST NUMBER: P202742

CATALOG NUMBER: LSR6B30D010BZ EC6B30509040 6LBWH1

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	1398.8
2.5°	1401.8
5°	1393.0
7.5°	1381.2
10°	1366.5
12.5°	1351.8
15°	1331.2
17.5°	1304.8
20°	1275.4
22.5°	1243.1
25°	1201.9
27.5°	1149.0
30°	1081.5
32.5°	1010.9
35°	925.7
37.5°	831.7
40°	722.9
42.5°	614.2
45°	511.3
47.5°	414.4
50°	329.1
52.5°	249.8
55°	185.1
57.5°	132.2
60°	91.1
62.5°	67.6
65°	50.0
67.5°	38.2
70°	26.4
72.5°	20.6
75°	14.7
77.5°	8.8
80°	5.9
82.5°	2.9
85°	2.9
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)