

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P204555

Luminaire Tested: **LE\_6B10D010 EC6B10209027 6LBSMW1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P204555  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LE\_6B10D010 EC6B10209027 6LBSMW1  
Description: PORTFOLIO 6 INCH SHALLOW RECESSED DOWNLIGHT  
SHALLOW DISTRIBUTION WITH MATTE WHITE TRIM  
WATTAGE D010TR-10.05 W DE010-10.58 W D5LT-10.2 W DMX-10.6 W DL2-11.8 W  
DL3-11.1 W DLE-11.39 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1185.0 lumens  
Efficiency: N/A  
Efficacy: 119.7 lumens/watt  
Spacing Criteria (0/90/45): 1.24 / 1.24 / 1.34  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 9.9  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P204555

CATALOG NUMBER: LE\_6B10D010 EC6B10209027 6LBSMW1

### Luminous Intensity Polar Plot

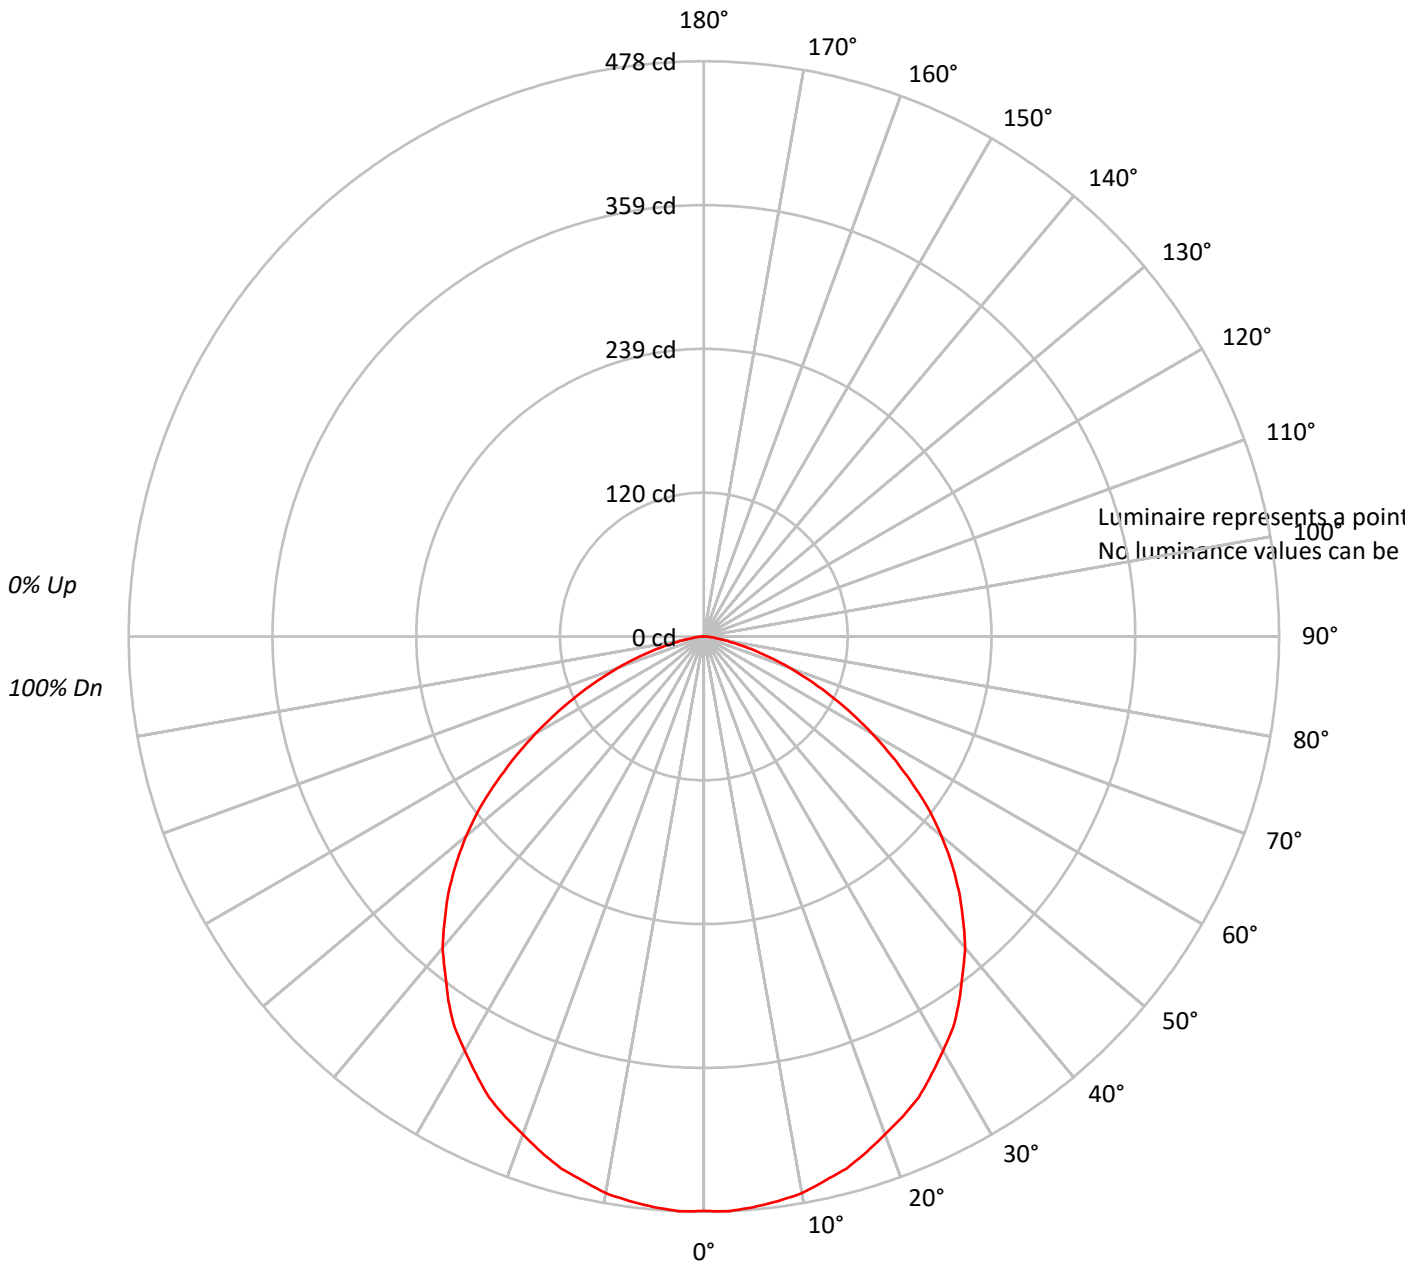



TEST NUMBER: P204555

CATALOG NUMBER: LE\_6B10D010 EC6B10209027 6LBSMW1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				20	
RC	80				70				50				30				10				0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100
1	110	106	102	99	107	104	100	97	99	97	94	96	93	91	92	90	88	86				86
2	101	93	87	82	98	92	86	81	88	83	79	85	81	77	82	79	76	74				74
3	93	83	75	69	90	81	74	69	78	72	67	76	70	66	73	69	65	63				63
4	85	74	65	59	83	72	65	59	70	63	58	68	62	57	66	61	56	54				54
5	78	66	58	51	76	65	57	51	63	56	51	61	55	50	59	54	49	47				47
6	73	60	51	45	71	59	51	45	57	50	44	55	49	44	54	48	44	42				42
7	67	54	46	40	66	54	46	40	52	45	40	51	44	39	49	43	39	37				37
8	63	50	41	36	61	49	41	36	48	41	35	46	40	35	45	39	35	33				33
9	59	46	38	32	57	45	37	32	44	37	32	43	36	32	42	36	32	30				30
10	55	42	34	29	54	42	34	29	41	34	29	40	33	29	39	33	29	27				27

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P204555

CATALOG NUMBER: LE\_6B10D010 EC6B10209027 6LBSMW1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	45.2	3.8
10°-20°	129.0	10.9
20°-30°	194.2	16.4
30°-40°	231.1	19.5
40°-50°	230.7	19.5
50°-60°	187.6	15.8
60°-70°	115.4	9.7
70°-80°	44.7	3.8
80°-90°	7.2	0.6
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	368.4	31.1
0°-40°	599.5	50.6
0°-60°	1017.7	85.9
0°-90°	1185.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1185.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	477	
5°	476	45
15°	458	129
25°	423	194
35°	370	231
45°	300	231
55°	210	188
65°	116	115
75°	41	45
85°	6	7
90°	0	



TEST NUMBER: P204555

CATALOG NUMBER: LE\_6B10D010 EC6B10209027 6LBSMW1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	477.4
2.5°	478.1
5°	476.0
7.5°	473.2
10°	469.8
12.5°	463.4
15°	457.8
17.5°	449.4
20°	440.2
22.5°	431.8
25°	422.6
27.5°	410.0
30°	397.4
32.5°	385.5
35°	370.0
37.5°	353.1
40°	337.8
42.5°	318.8
45°	299.8
47.5°	279.4
50°	257.6
52.5°	235.2
55°	209.9
57.5°	185.4
60°	161.5
62.5°	138.4
65°	115.9
67.5°	94.8
70°	75.1
72.5°	56.9
75°	40.8
77.5°	26.6
80°	16.1
82.5°	9.9
85°	5.6
87.5°	2.8
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)