

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P203211

Luminaire Tested: **LE\_6B10D010 EC6B10208030 6LBMH1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P203211  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LE\_6B10D010 EC6B10208030 6LBMH1  
Description: PORTFOLIO 6 INCH 50 DEGREE CUTOFF RECESSED DOWNLIGHT  
MEDIUM DISTRIBUTION WITH SEMI-SPECULAR CLEAR TRIM  
WATTAGE D010TR-10.05 W DE010-10.58 W D5LT-10.2 W DMX-10.6 W DL2-11.8 W  
DL3-11.1 W DLE-11.39 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 971.2 lumens  
Efficiency: N/A  
Efficacy: 98.1 lumens/watt  
Spacing Criteria (0/90/45): 0.94 / 0.94 / 0.93  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 9.9  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P203211

CATALOG NUMBER: LE\_6B10D010 EC6B10208030 6LBMH1

### Luminous Intensity Polar Plot

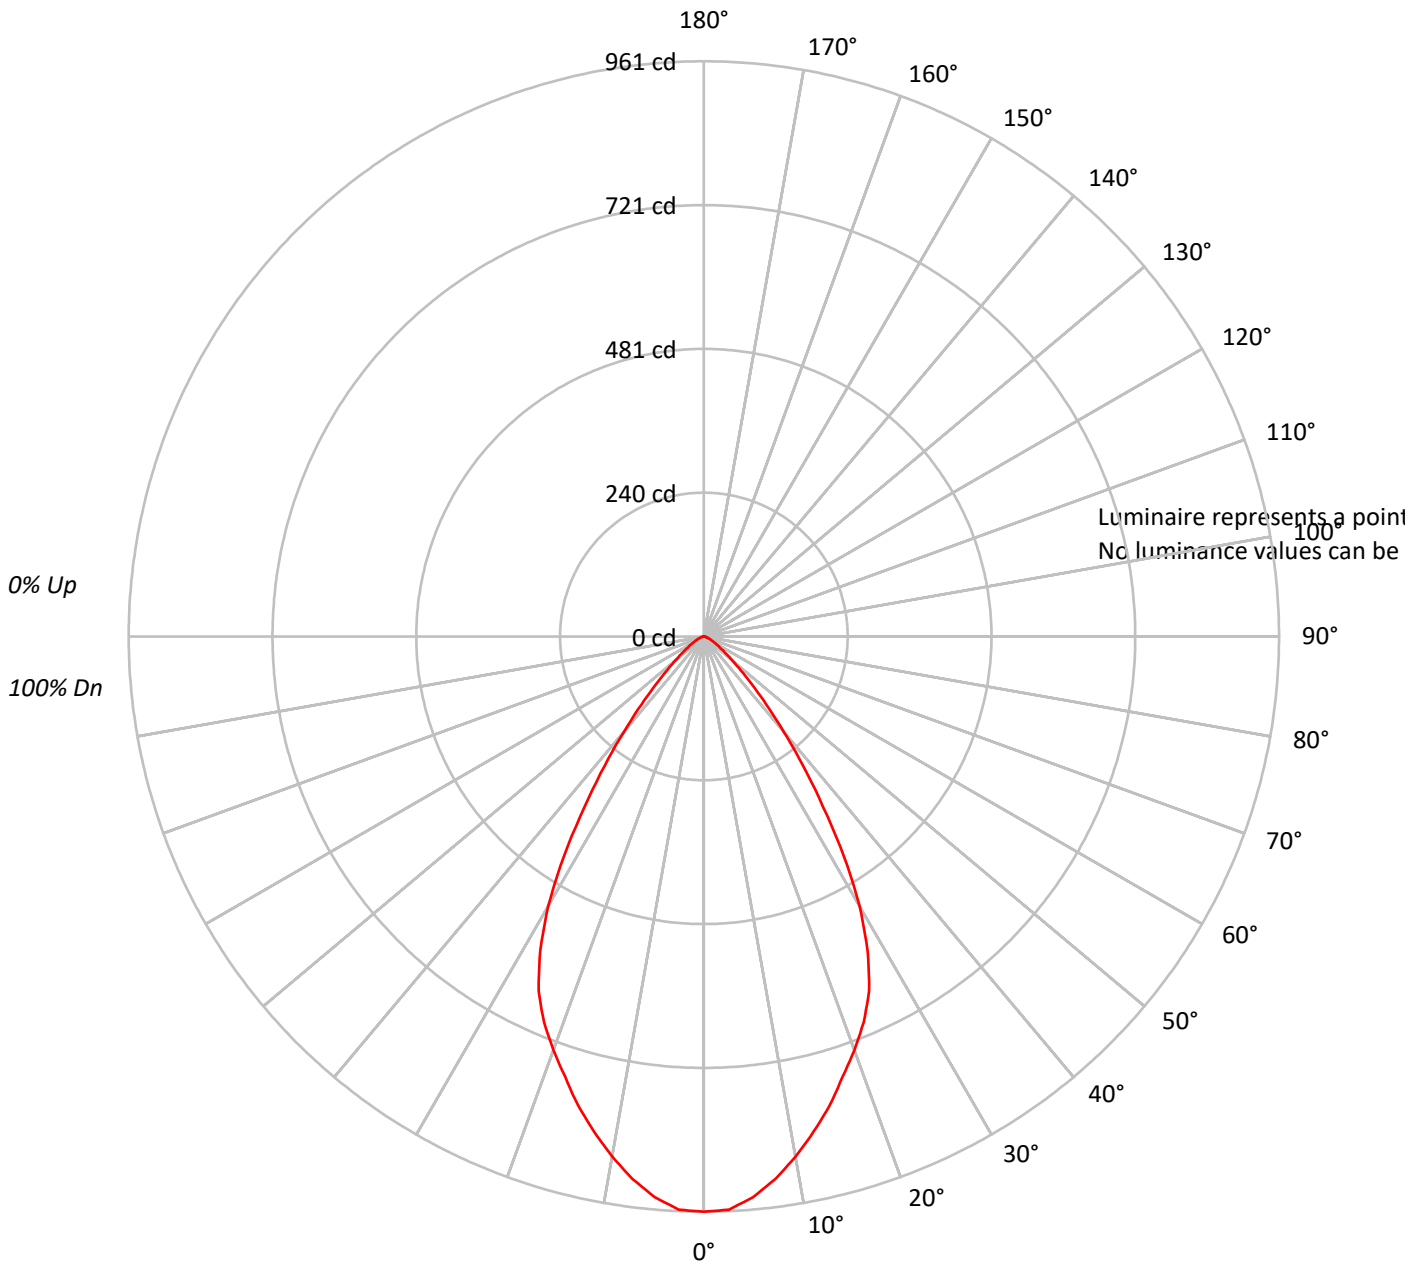



TEST NUMBER: P203211

CATALOG NUMBER: LE\_6B10D010 EC6B10208030 6LBMH1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	92			92
2	107	102	97	93	105	100	96	92	97	93	90	94	91	88	91	89	87	85			85
3	101	94	88	84	99	92	87	84	90	86	82	87	84	81	85	82	80	78			78
4	95	87	81	76	93	86	80	76	84	79	75	82	78	74	80	76	73	72			72
5	90	81	75	70	88	80	74	70	78	73	69	76	72	68	75	71	68	66			66
6	85	75	69	64	83	75	69	64	73	68	64	72	67	63	70	66	63	61			61
7	80	70	64	59	79	70	64	59	68	63	59	67	62	59	66	62	58	57			57
8	76	66	60	55	75	65	59	55	64	59	55	63	58	55	62	58	54	53			53
9	72	62	56	51	71	61	55	51	60	55	51	60	55	51	59	54	51	49			49
10	69	58	52	48	68	58	52	48	57	52	48	56	51	48	55	51	48	46			46

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P203211

CATALOG NUMBER: LE\_6B10D010 EC6B10208030 6LBMH1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	87.9	9.0
10°-20°	227.3	23.4
20°-30°	294.6	30.3
30°-40°	218.7	22.5
40°-50°	92.3	9.5
50°-60°	32.8	3.4
60°-70°	12.7	1.3
70°-80°	4.4	0.4
80°-90°	0.6	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	609.8	62.8
0°-40°	828.5	85.3
0°-60°	953.6	98.2
0°-90°	971.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	971.2	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	961	
5°	940	88
15°	811	227
25°	653	295
35°	347	219
45°	114	92
55°	35	33
65°	12	13
75°	4	4
85°	0	1
90°	0	



TEST NUMBER: P203211

CATALOG NUMBER: LE\_6B10D010 EC6B10208030 6LBMH1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	961.1
2.5°	958.4
5°	940.4
7.5°	914.0
10°	882.1
12.5°	847.4
15°	811.4
17.5°	771.1
20°	735.1
22.5°	697.6
25°	653.2
27.5°	592.2
30°	520.1
32.5°	435.5
35°	346.8
37.5°	271.9
40°	206.6
42.5°	154.0
45°	113.8
47.5°	83.2
50°	61.0
52.5°	45.8
55°	34.6
57.5°	26.4
60°	20.8
62.5°	15.2
65°	12.5
67.5°	9.8
70°	6.9
72.5°	5.5
75°	4.1
77.5°	2.8
80°	1.4
82.5°	1.4
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)