

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P204344

Luminaire Tested: **LE\_6B10D010 EC6B10208030 6LBSGPH1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P204344  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LE\_6B10D010 EC6B10208030 6LBSGPH1  
Description: PORTFOLIO 6 INCH SHALLOW RECESSED DOWNLIGHT  
SHALLOW DISTRIBUTION WITH GRAPHITE HAZE TRIM  
WATTAGE D010TR-10.05 W DE010-10.58 W D5LT-10.2 W DMX-10.6 W DL2-11.8 W  
DL3-11.1 W DLE-11.39 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1269.6 lumens  
Efficiency: N/A  
Efficacy: 128.2 lumens/watt  
Spacing Criteria (0/90/45): 1.16 / 1.16 / 1.26  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 9.9  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P204344

CATALOG NUMBER: LE\_6B10D010 EC6B10208030 6LBSGPH1

### Luminous Intensity Polar Plot

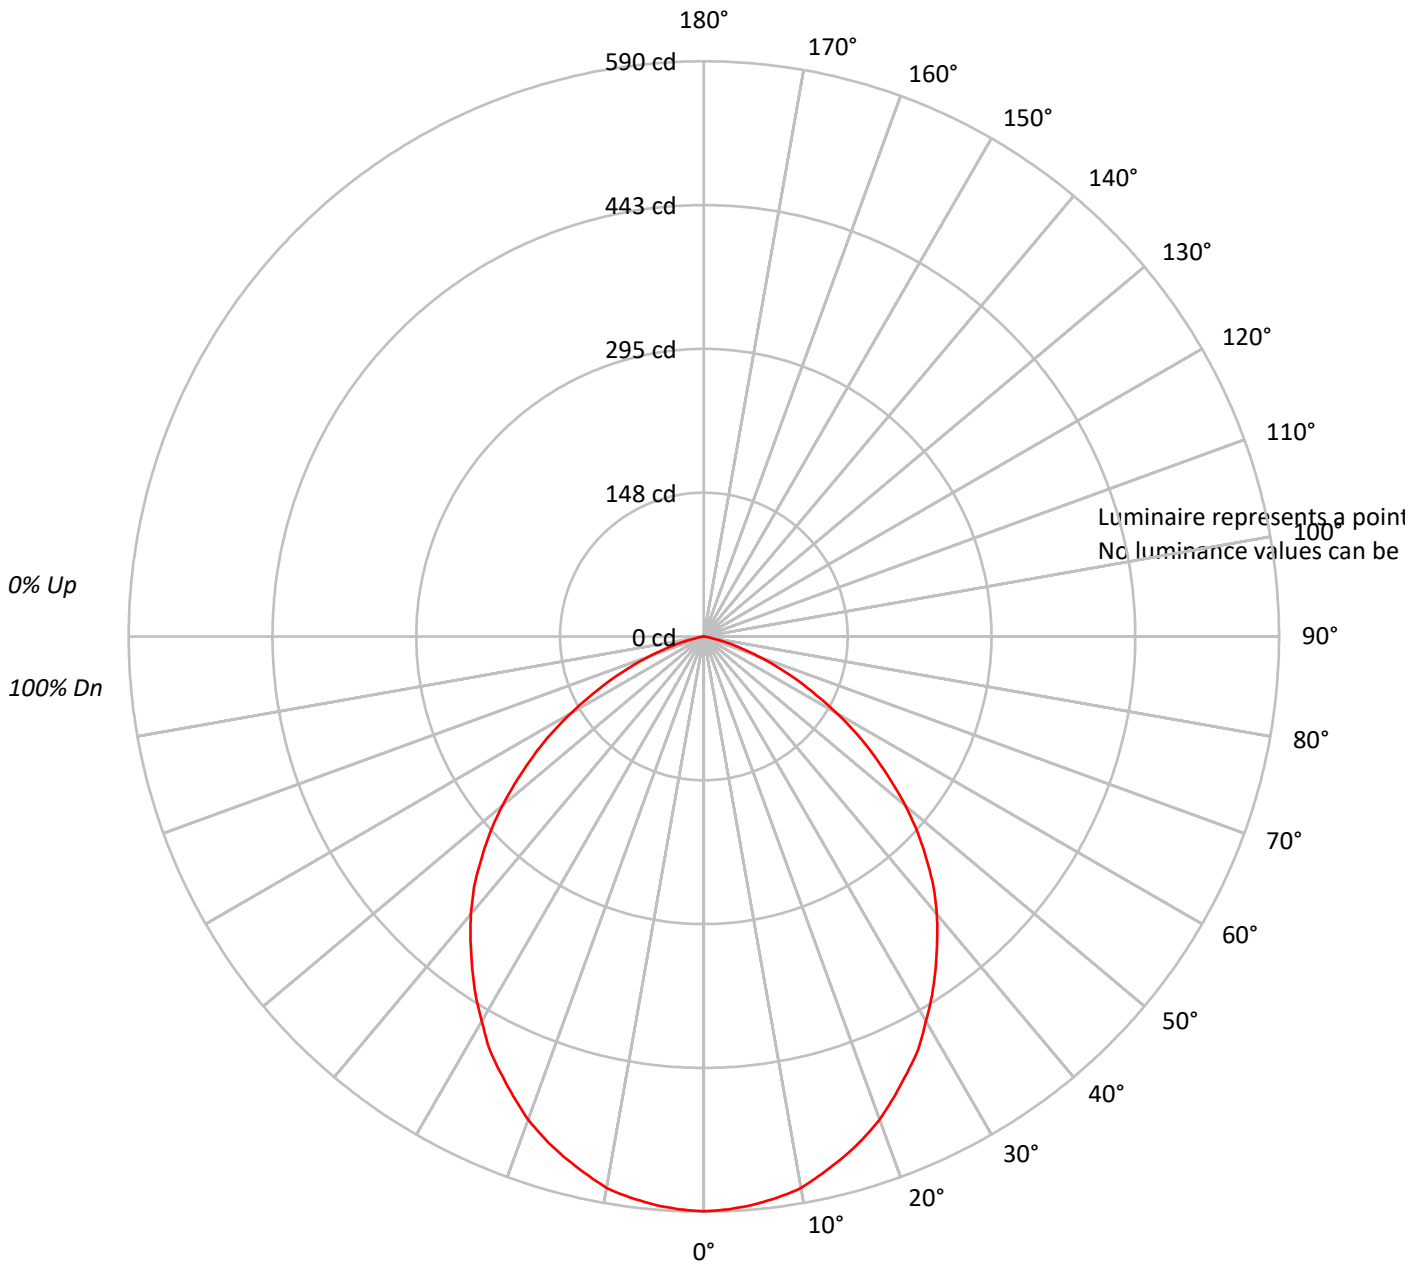



TEST NUMBER: P204344

CATALOG NUMBER: LE\_6B10D010 EC6B10208030 6LBSGPH1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	111	107	103	100	108	105	102	99	101	98	96	97	95	93	93	92	90	88																			
2	102	95	89	84	100	93	88	83	90	85	82	87	83	80	84	81	78	76																			
3	94	85	78	72	92	83	77	71	80	75	70	78	73	69	75	71	68	66																			
4	87	76	68	62	85	75	67	62	72	66	61	70	65	60	68	63	59	57																			
5	80	68	60	54	78	67	60	54	65	59	53	63	58	53	62	56	52	50																			
6	74	62	54	48	73	61	53	48	59	52	47	58	52	47	56	51	47	45																			
7	69	57	48	43	68	56	48	43	54	47	42	53	47	42	52	46	42	40																			
8	65	52	44	38	63	51	44	38	50	43	38	49	42	38	48	42	38	36																			
9	60	48	40	35	59	47	40	35	46	39	35	45	39	34	44	38	34	32																			
10	57	44	37	32	56	44	36	32	43	36	31	42	36	31	41	35	31	30																			

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P204344

CATALOG NUMBER: LE\_6B10D010 EC6B10208030 6LBSGPH1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	55.5	4.4
10°-20°	155.8	12.3
20°-30°	227.3	17.9
30°-40°	259.2	20.4
40°-50°	248.6	19.6
50°-60°	190.5	15.0
60°-70°	104.5	8.2
70°-80°	27.8	2.2
80°-90°	0.4	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	438.7	34.5
0°-40°	697.9	55.0
0°-60°	1137.0	89.6
0°-90°	1269.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1269.6	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	590	
5°	585	56
15°	553	156
25°	494	227
35°	414	259
45°	323	249
55°	213	190
65°	105	105
75°	24	28
85°	0	0
90°	0	



TEST NUMBER: P204344

CATALOG NUMBER: LE\_6B10D010 EC6B10208030 6LBSGPH1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	589.6
2.5°	588.1
5°	585.1
7.5°	580.5
10°	574.5
12.5°	563.8
15°	553.1
17.5°	540.9
20°	527.2
22.5°	510.5
25°	493.6
27.5°	476.9
30°	455.6
32.5°	435.8
35°	414.5
37.5°	393.1
40°	371.8
42.5°	348.9
45°	323.0
47.5°	297.1
50°	269.8
52.5°	240.8
55°	213.4
57.5°	185.9
60°	157.0
62.5°	129.5
65°	105.1
67.5°	80.8
70°	59.4
72.5°	39.6
75°	24.4
77.5°	10.6
80°	3.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)