

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P204867

Luminaire Tested: **LE\_6B10D010 EC6B10209030 6LBCSMB1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P204867  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LE\_6B10D010 EC6B10209030 6LBCSMB1  
Description: PORTFOLIO 6 INCH SHALLOW RECESSED DOWNLIGHT  
SHALLOW DISTRIBUTION WITH CAST MATTE BLACK TRIM  
WATTAGE D010TR-10.05 W DE010-10.58 W D5LT-10.2 W DMX-10.6 W DL2-11.8 W  
DL3-11.1 W DLE-11.39 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1053.1 lumens  
Efficiency: N/A  
Efficacy: 106.4 lumens/watt  
Spacing Criteria (0/90/45): 1.23 / 1.23 / 1.33  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 9.9  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P204867

CATALOG NUMBER: LE\_6B10D010 EC6B10209030 6LBCSMB1

### Luminous Intensity Polar Plot

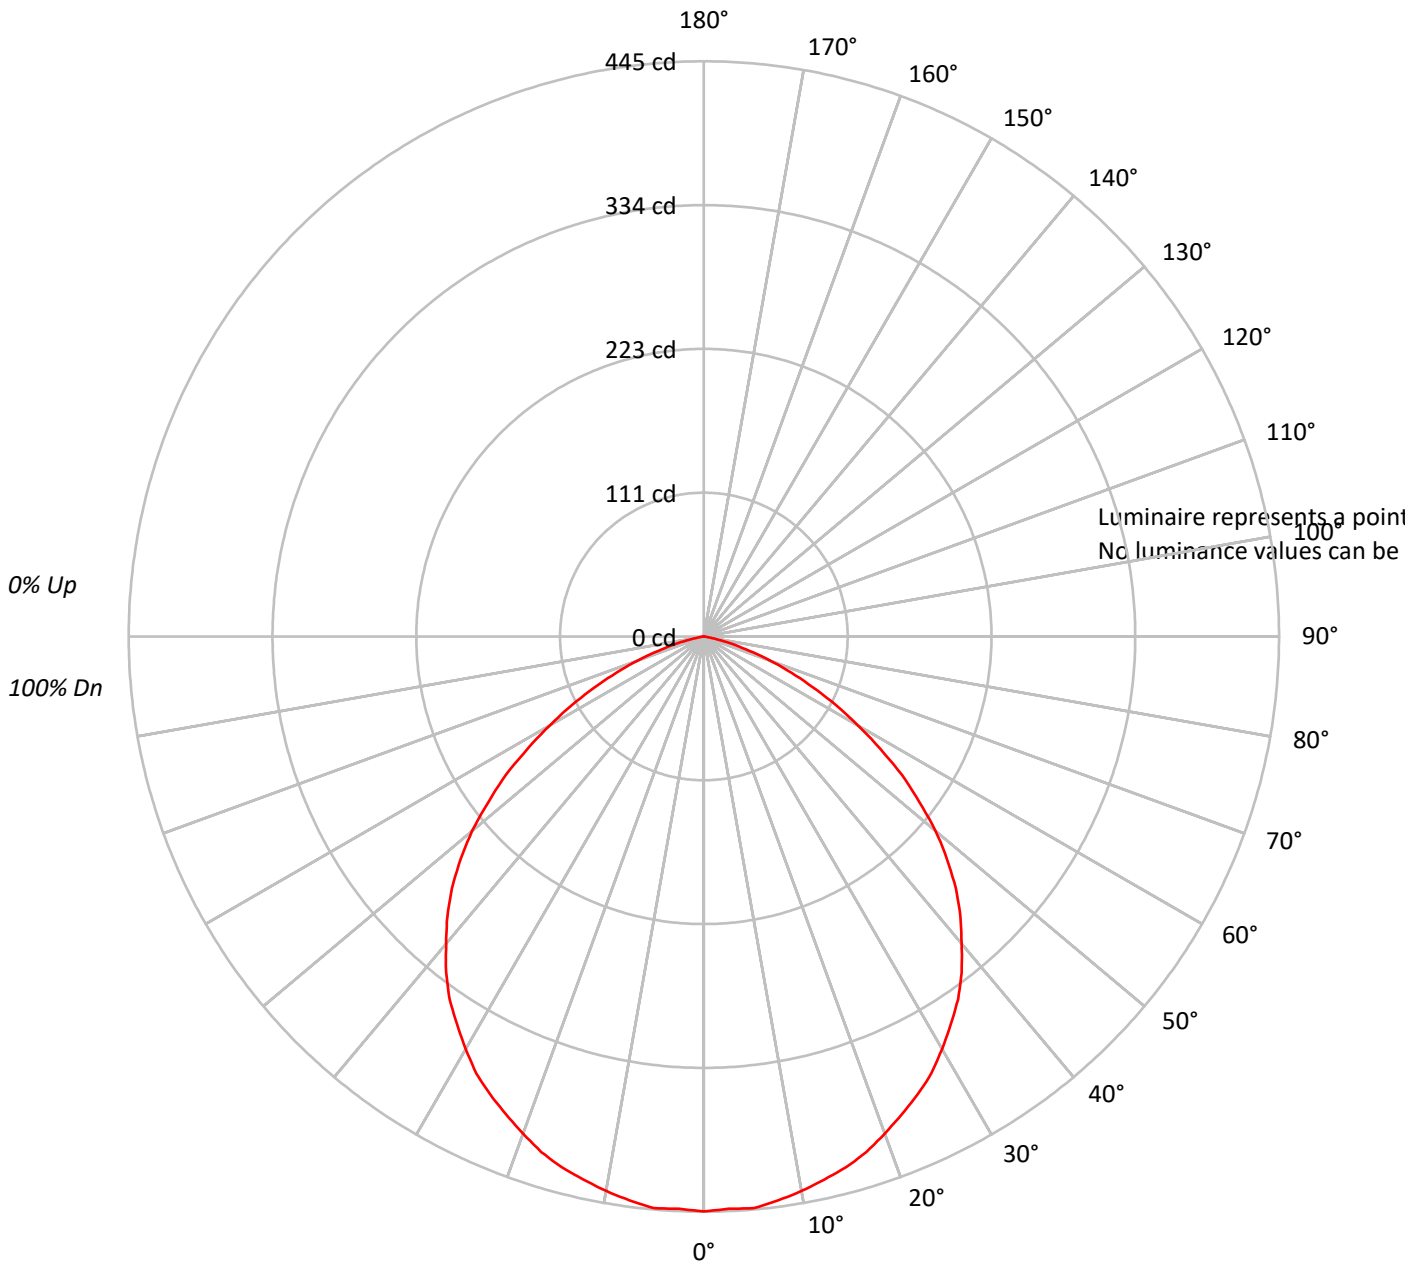



TEST NUMBER: P204867

CATALOG NUMBER: LE\_6B10D010 EC6B10209030 6LBCSMB1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				20	
RC	80				70				50				30				10				0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100
1	111	107	103	100	108	104	101	98	100	98	95	96	94	92	93	91	90	88				88
2	102	95	89	84	99	93	87	83	89	85	81	86	82	79	83	80	77	75				75
3	93	84	77	71	91	83	76	70	80	74	69	77	72	68	74	70	67	65				65
4	86	75	67	61	84	74	66	61	71	65	60	69	63	59	67	62	58	56				56
5	79	67	59	53	77	66	59	53	64	57	52	62	56	52	61	55	51	49				49
6	74	61	53	47	72	60	52	46	58	51	46	57	50	46	55	50	45	43				43
7	68	55	47	41	67	55	47	41	53	46	41	52	45	41	50	45	40	39				39
8	64	51	43	37	62	50	42	37	49	42	37	48	41	37	46	41	36	35				35
9	60	47	39	33	58	46	39	33	45	38	33	44	38	33	43	37	33	31				31
10	56	43	35	30	55	43	35	30	42	35	30	41	34	30	40	34	30	28				28

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P204867

CATALOG NUMBER: LE\_6B10D010 EC6B10209030 6LBCSMB1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	42.1	4.0
10°-20°	119.8	11.4
20°-30°	180.1	17.1
30°-40°	213.7	20.3
40°-50°	211.5	20.1
50°-60°	166.1	15.8
60°-70°	93.1	8.8
70°-80°	26.2	2.5
80°-90°	0.4	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	342.0	32.5
0°-40°	555.7	52.8
0°-60°	933.4	88.6
0°-90°	1053.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1053.1	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	445	
5°	444	42
15°	425	120
25°	391	180
35°	343	214
45°	276	212
55°	187	166
65°	93	93
75°	23	26
85°	0	0
90°	0	



TEST NUMBER: P204867

CATALOG NUMBER: LE\_6B10D010 EC6B10209030 6LBCSMB1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	444.8
2.5°	443.2
5°	444.0
7.5°	440.1
10°	435.6
12.5°	430.4
15°	425.1
17.5°	418.2
20°	409.2
22.5°	400.1
25°	391.1
27.5°	381.2
30°	368.5
32.5°	355.6
35°	342.8
37.5°	327.6
40°	310.2
42.5°	293.8
45°	275.6
47.5°	255.2
50°	234.0
52.5°	209.9
55°	187.2
57.5°	161.6
60°	137.4
62.5°	115.5
65°	92.9
67.5°	73.2
70°	54.4
72.5°	37.0
75°	22.6
77.5°	11.4
80°	3.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)