

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P203427

Luminaire Tested: **LE\_6B10D010 EC6B10209730 6LBMB1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P203427  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LE\_6B10D010 EC6B10209730 6LBMB1  
Description: PORTFOLIO 6 INCH 50 DEGREE CUTOFF RECESSED DOWNLIGHT  
MEDIUM DISTRIBUTION WITH SPECULAR BLACK TRIM  
WATTAGE D010TR-10.05 W DE010-10.58 W D5LT-10.2 W DMX-10.6 W DL2-11.8 W  
DL3-11.1 W DLE-11.39 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 431.7 lumens  
Efficiency: N/A  
Efficacy: 43.6 lumens/watt  
Spacing Criteria (0/90/45): 0.85 / 0.85 / 0.86  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 9.9  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P203427

CATALOG NUMBER: LE\_6B10D010 EC6B10209730 6LBMB1

### Luminous Intensity Polar Plot

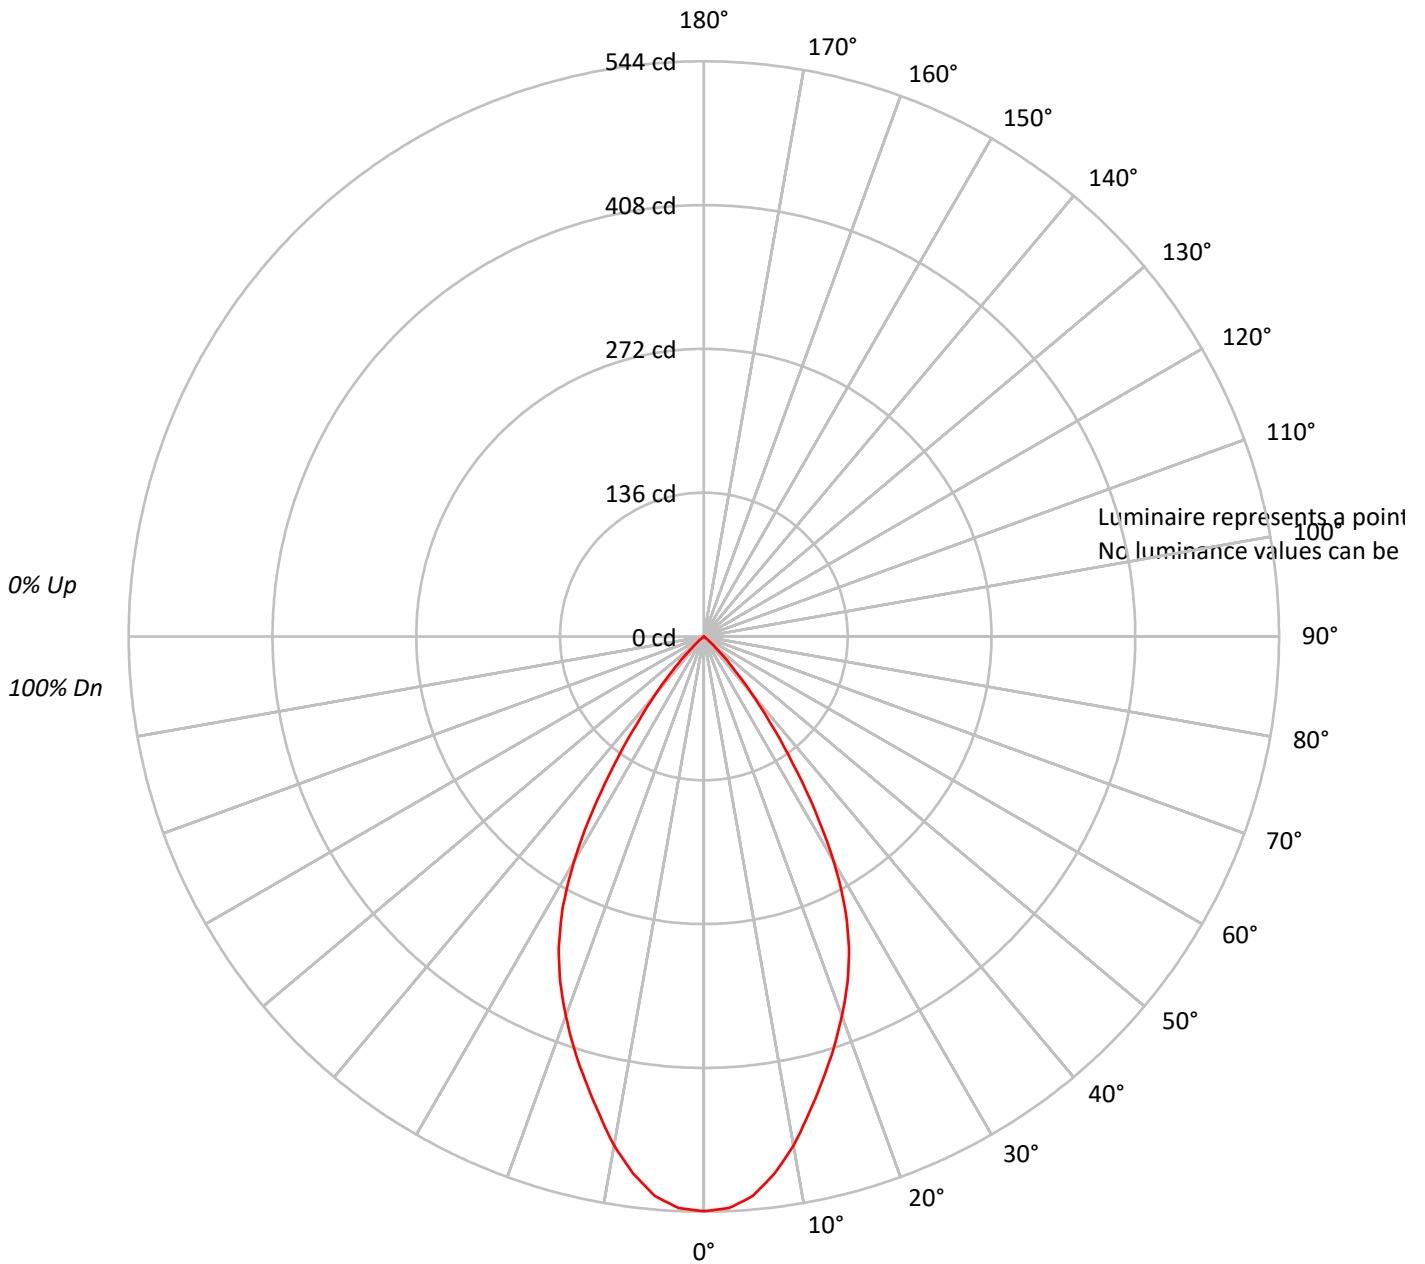



TEST NUMBER: P203427

CATALOG NUMBER: LE\_6B10D010 EC6B10209730 6LBMB1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |    |    |    |    |    |    |    |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |  |  |  |  |  |  |  |  |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|----|----|----|----|----|----|----|----|----|---|--|--|--|--|--|--|----|--|--|--|--|--|--|--|--|---|--|--|--|--|--|--|--|--|
| RF  | 20  |     |     |     |     |     |     |     |     | 20  |     |     |     |     |     |     |     |     | 20 |    |    |    |    |    |    |    |    | 20 |    |   |  |  |  |  |  |  | 20 |  |  |  |  |  |  |  |  |   |  |  |  |  |  |  |  |  |
| RC  | 80  |     |     |     |     |     |     |     |     | 70  |     |     |     |     |     |     |     |     | 50 |    |    |    |    |    |    |    |    | 30 |    |   |  |  |  |  |  |  | 10 |  |  |  |  |  |  |  |  | 0 |  |  |  |  |  |  |  |  |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |  |  |  |  |  |  |  |  |
| RCR |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |    |    |    |    |    |    |    |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |  |  |  |  |  |  |  |  |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 |    |    |    |    |    |    |    |    |    |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |  |  |  |  |  |  |  |  |
| 1   | 114 | 111 | 109 | 106 | 111 | 109 | 107 | 105 | 105 | 103 | 102 | 101 | 100 | 99  | 98  | 97  | 96  | 94  |    |    |    |    |    |    |    |    |    |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |  |  |  |  |  |  |  |  |
| 2   | 108 | 104 | 100 | 96  | 106 | 102 | 98  | 95  | 99  | 96  | 93  | 96  | 93  | 91  | 93  | 91  | 89  | 88  |    |    |    |    |    |    |    |    |    |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |  |  |  |  |  |  |  |  |
| 3   | 103 | 97  | 92  | 88  | 101 | 95  | 91  | 87  | 93  | 89  | 86  | 90  | 87  | 85  | 88  | 86  | 83  | 82  |    |    |    |    |    |    |    |    |    |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |  |  |  |  |  |  |  |  |
| 4   | 98  | 91  | 85  | 81  | 96  | 90  | 85  | 81  | 87  | 83  | 80  | 85  | 82  | 79  | 84  | 81  | 78  | 77  |    |    |    |    |    |    |    |    |    |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |  |  |  |  |  |  |  |  |
| 5   | 93  | 85  | 79  | 75  | 92  | 84  | 79  | 75  | 82  | 78  | 74  | 81  | 77  | 74  | 79  | 76  | 73  | 72  |    |    |    |    |    |    |    |    |    |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |  |  |  |  |  |  |  |  |
| 6   | 89  | 80  | 74  | 70  | 87  | 79  | 74  | 70  | 78  | 73  | 69  | 76  | 72  | 69  | 75  | 71  | 68  | 67  |    |    |    |    |    |    |    |    |    |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |  |  |  |  |  |  |  |  |
| 7   | 84  | 75  | 69  | 65  | 83  | 75  | 69  | 65  | 73  | 68  | 65  | 72  | 68  | 65  | 71  | 67  | 64  | 63  |    |    |    |    |    |    |    |    |    |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |  |  |  |  |  |  |  |  |
| 8   | 80  | 71  | 65  | 61  | 79  | 71  | 65  | 61  | 69  | 64  | 61  | 68  | 64  | 61  | 67  | 63  | 60  | 59  |    |    |    |    |    |    |    |    |    |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |  |  |  |  |  |  |  |  |
| 9   | 77  | 67  | 61  | 58  | 76  | 67  | 61  | 57  | 66  | 61  | 57  | 65  | 60  | 57  | 64  | 60  | 57  | 56  |    |    |    |    |    |    |    |    |    |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |  |  |  |  |  |  |  |  |
| 10  | 73  | 64  | 58  | 54  | 72  | 63  | 58  | 54  | 62  | 57  | 54  | 62  | 57  | 54  | 61  | 57  | 54  | 52  |    |    |    |    |    |    |    |    |    |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |  |  |  |  |  |  |  |  |

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P203427

CATALOG NUMBER: LE\_6B10D010 EC6B10209730 6LBMB1

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 49.3   | 11.4      |
| 10°-20°   | 121.7  | 28.2      |
| 20°-30°   | 146.6  | 34.0      |
| 30°-40°   | 92.7   | 21.5      |
| 40°-50°   | 21.2   | 4.9       |
| 50°-60°   | 0.2    | 0.1       |
| 60°-70°   | 0.0    | 0.0       |
| 70°-80°   | 0.0    | 0.0       |
| 80°-90°   | 0.0    | 0.0       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| 0°-30°    | 317.5  | 73.6      |
| 0°-40°    | 410.2  | 95.0      |
| 0°-60°    | 431.7  | 100.0     |
| 0°-90°    | 431.7  | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 431.7  | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°  | Flux |
|-----|-----|------|
| 0°  | 544 |      |
| 5°  | 531 | 49   |
| 15° | 434 | 122  |
| 25° | 325 | 147  |
| 35° | 146 | 93   |
| 45° | 23  | 21   |
| 55° | 0   | 0    |
| 65° | 0   | 0    |
| 75° | 0   | 0    |
| 85° | 0   | 0    |
| 90° | 0   |      |



TEST NUMBER: P203427

CATALOG NUMBER: LE\_6B10D010 EC6B10209730 6LBMB1

**CANDELA DISTRIBUTION (FULL):**

| 0°    |       |
|-------|-------|
| 0°    | 543.5 |
| 2.5°  | 541.2 |
| 5°    | 531.2 |
| 7.5°  | 512.2 |
| 10°   | 488.8 |
| 12.5° | 460.9 |
| 15°   | 434.1 |
| 17.5° | 408.5 |
| 20°   | 381.6 |
| 22.5° | 354.9 |
| 25°   | 324.8 |
| 27.5° | 289.0 |
| 30°   | 245.5 |
| 32.5° | 196.4 |
| 35°   | 146.2 |
| 37.5° | 103.8 |
| 40°   | 70.2  |
| 42.5° | 43.5  |
| 45°   | 23.4  |
| 47.5° | 10.0  |
| 50°   | 2.2   |
| 52.5° | 0.0   |
| 55°   | 0.0   |
| 57.5° | 0.0   |
| 60°   | 0.0   |
| 62.5° | 0.0   |
| 65°   | 0.0   |
| 67.5° | 0.0   |
| 70°   | 0.0   |
| 72.5° | 0.0   |
| 75°   | 0.0   |
| 77.5° | 0.0   |
| 80°   | 0.0   |
| 82.5° | 0.0   |
| 85°   | 0.0   |
| 87.5° | 0.0   |
| 90°   | 0.0   |



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)