

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P203419

Luminaire Tested: **LE_6B10D010 EC6B10208040 6LBMB1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P203419
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LE_6B10D010 EC6B10208040 6LBMB1
Description: PORTFOLIO 6 INCH 50 DEGREE CUTOFF RECESSED DOWNLIGHT
MEDIUM DISTRIBUTION WITH SPECULAR BLACK TRIM
WATTAGE D010TR-10.05 W DE010-10.58 W D5LT-10.2 W DMX-10.6 W DL2-11.8 W
DL3-11.1 W DLE-11.39 W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 599.3 lumens
Efficiency: N/A
Efficacy: 60.5 lumens/watt
Spacing Criteria (0/90/45): 0.85 / 0.85 / 0.86
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 9.9
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P203419

CATALOG NUMBER: LE_6B10D010 EC6B10208040 6LBMB1

Luminous Intensity Polar Plot

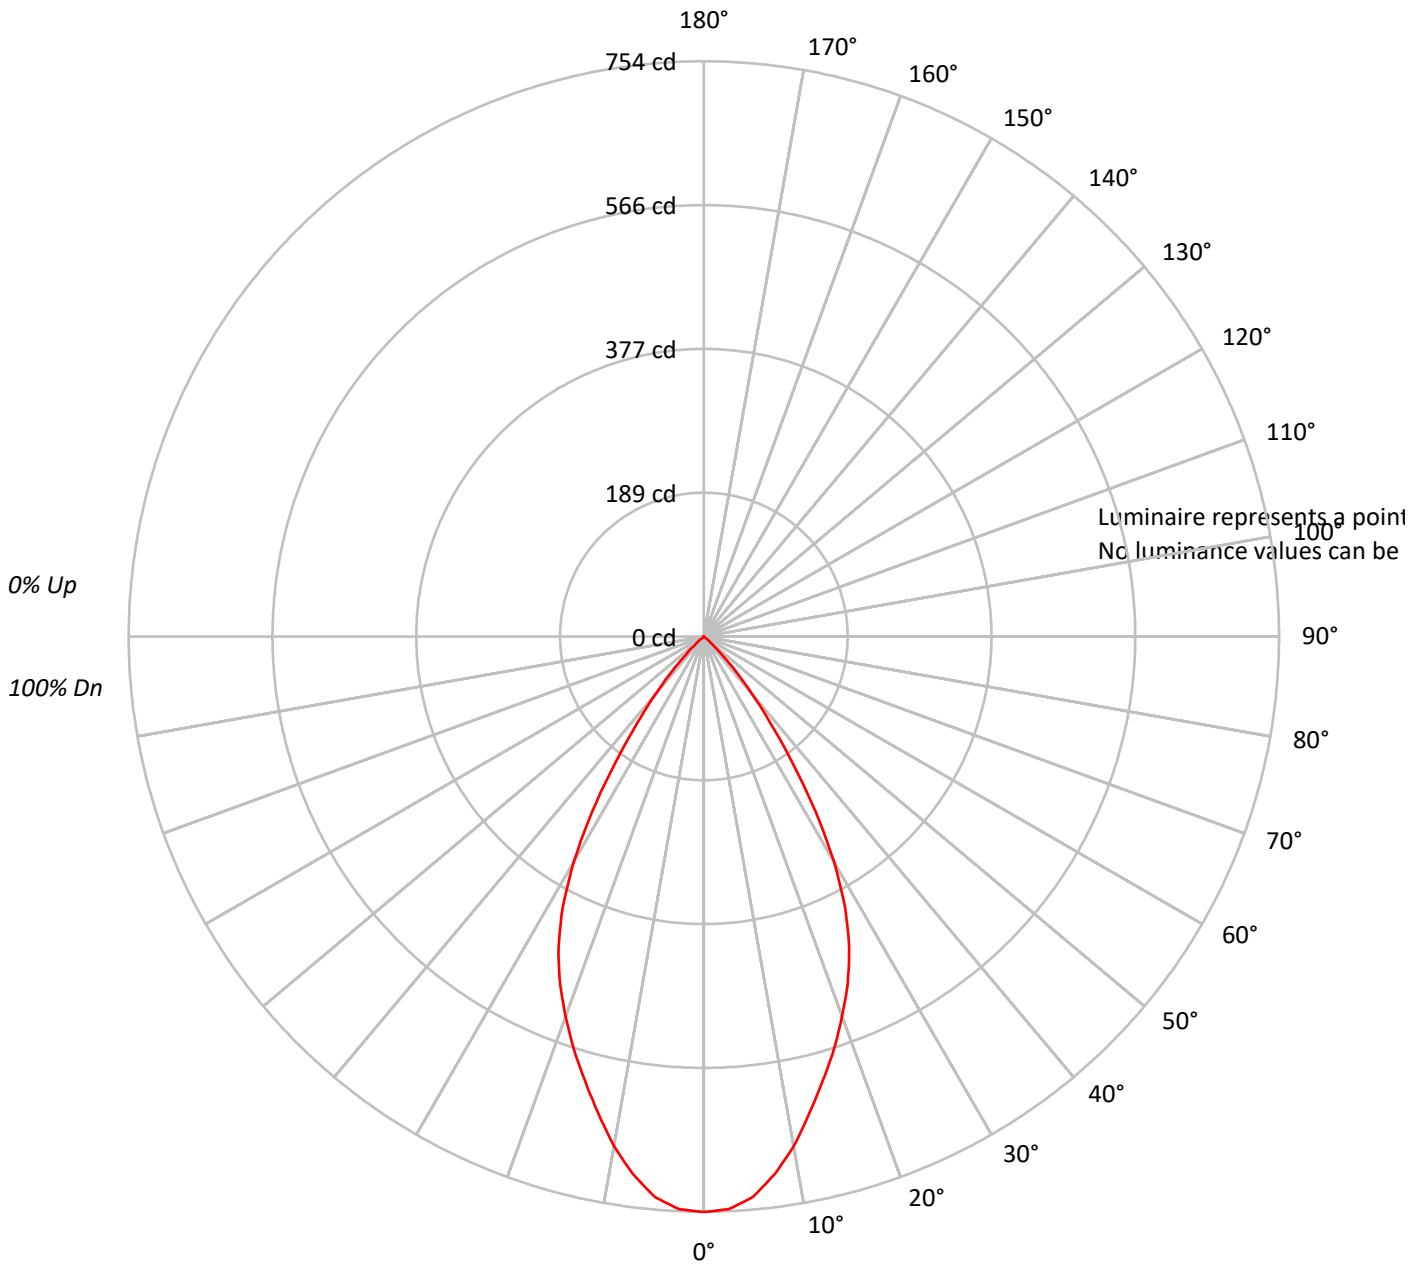



TEST NUMBER: P203419

CATALOG NUMBER: LE_6B10D010 EC6B10208040 6LBMB1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20																	
RC	80									50									30									10									0								
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0															
RCR																																													
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																											
1	114	111	109	106	111	109	107	105	105	103	102	101	100	99	98	97	96	94																											
2	108	104	100	96	106	102	98	95	99	96	93	96	93	91	93	91	89	88																											
3	103	97	92	88	101	95	91	87	93	89	86	90	87	85	88	86	83	82																											
4	98	91	85	81	96	90	85	81	87	83	80	85	82	79	84	81	78	76																											
5	93	85	79	75	92	84	79	75	82	78	74	81	77	74	79	76	73	72																											
6	89	80	74	70	87	79	74	70	78	73	69	76	72	69	75	71	68	67																											
7	84	75	69	65	83	75	69	65	73	68	65	72	68	65	71	67	64	63																											
8	80	71	65	61	79	71	65	61	69	64	61	68	64	61	67	63	60	59																											
9	77	67	61	58	76	67	61	57	66	61	57	65	60	57	64	60	57	56																											
10	73	64	58	54	72	63	58	54	62	57	54	62	57	54	61	57	54	52																											

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P203419

CATALOG NUMBER: LE_6B10D010 EC6B10208040 6LBMB1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	68.4	11.4
10°-20°	168.9	28.2
20°-30°	203.4	33.9
30°-40°	128.7	21.5
40°-50°	29.5	4.9
50°-60°	0.3	0.1
60°-70°	0.0	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	440.8	73.6
0°-40°	569.5	95.0
0°-60°	599.3	100.0
0°-90°	599.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	599.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	754	
5°	737	68
15°	603	169
25°	451	203
35°	203	129
45°	32	29
55°	0	0
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P203419

CATALOG NUMBER: LE_6B10D010 EC6B10208040 6LBMB1

CANDELA DISTRIBUTION (FULL):

	0°
0°	754.4
2.5°	751.4
5°	737.4
7.5°	711.0
10°	678.5
12.5°	639.8
15°	602.6
17.5°	567.0
20°	529.8
22.5°	492.6
25°	450.8
27.5°	401.2
30°	340.8
32.5°	272.6
35°	203.0
37.5°	144.1
40°	97.6
42.5°	60.4
45°	32.5
47.5°	14.0
50°	3.1
52.5°	0.0
55°	0.0
57.5°	0.0
60°	0.0
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)