

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P203845

Luminaire Tested: **LE\_6B15D010 EC6B10209024 6LBNGPH1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P203845  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LE\_6B15D010 EC6B10209024 6LBNGPH1  
Description: PORTFOLIO 6 INCH 50 DEGREE CUTOFF RECESSED DOWNLIGHT  
NARROW DISTRIBUTION WITH GRAPHITE HAZE TRIM  
WATTAGE D010TR-14.39 W DE010-14.29 W D5LT-14.34 W DMX-14.46 W DL2-15.8 W  
DL3-15.28 W DLE-15.432 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 666.2 lumens  
Efficiency: N/A  
Efficacy: 46.6 lumens/watt  
Spacing Criteria (0/90/45): 0.84 / 0.84 / 0.88  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 14.3  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P203845

CATALOG NUMBER: LE\_6B15D010 EC6B10209024 6LBNGPH1

### Luminous Intensity Polar Plot

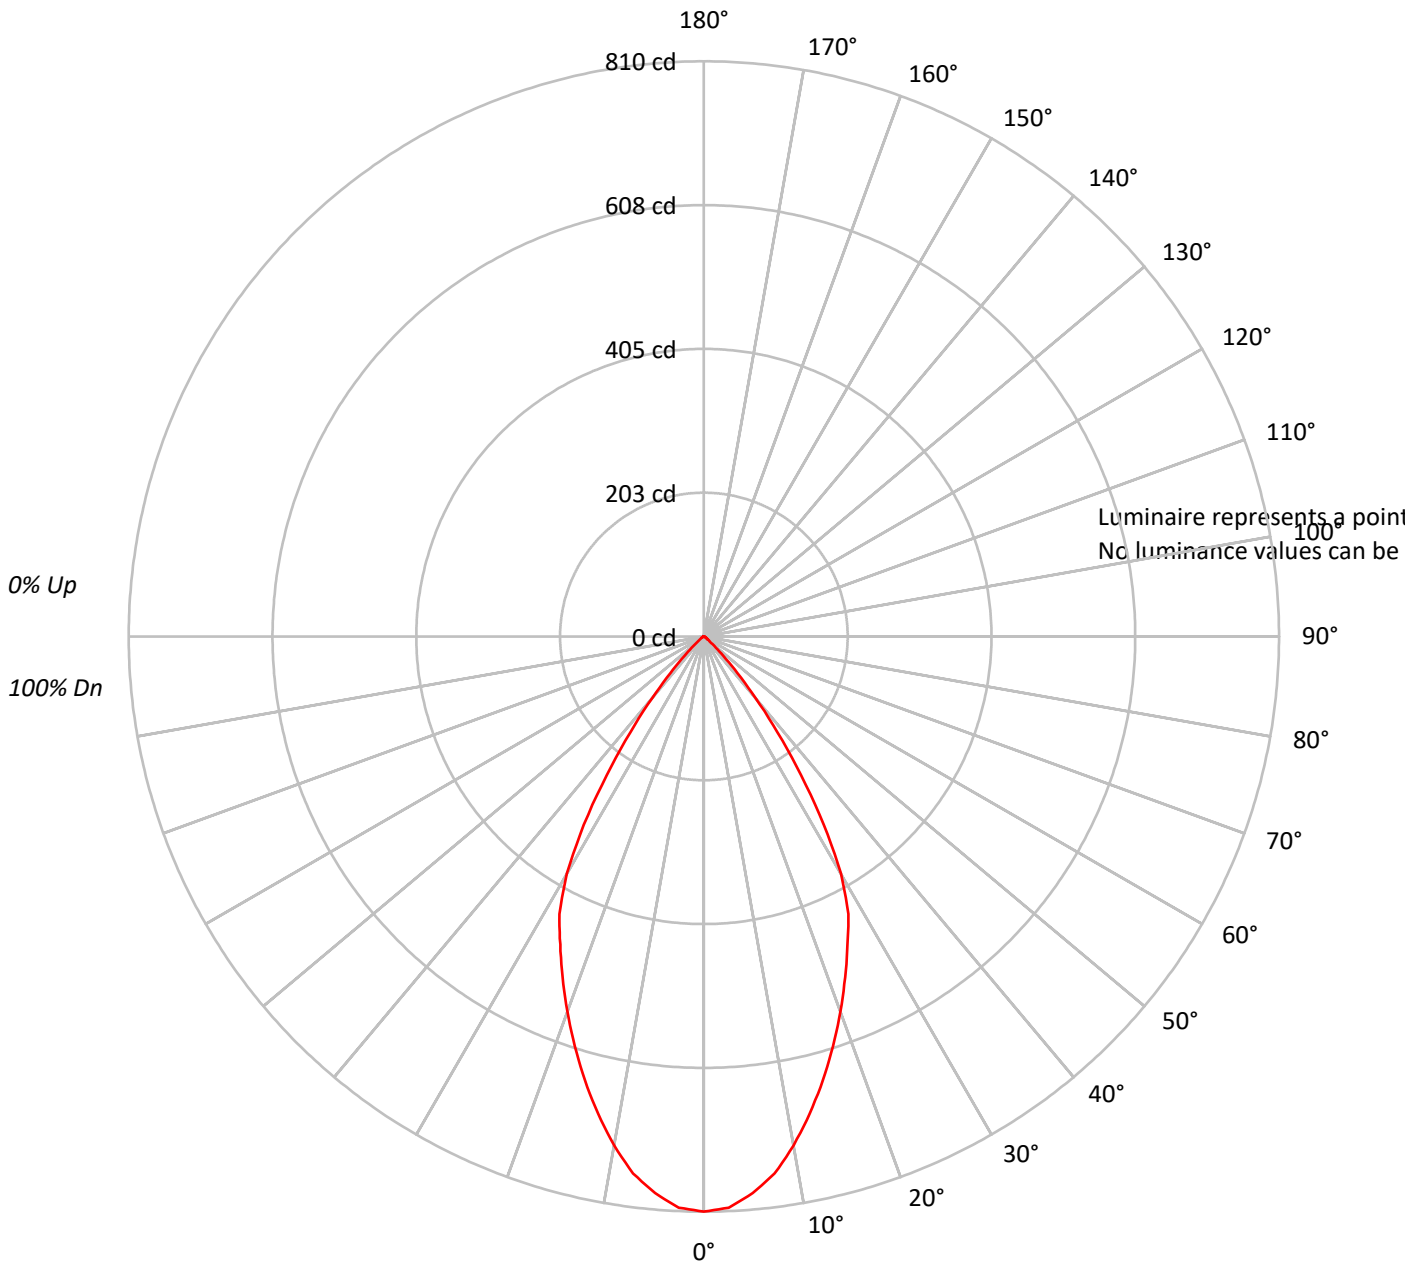



TEST NUMBER: P203845

CATALOG NUMBER: LE\_6B15D010 EC6B10209024 6LBNGPH1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	114	111	108	106	111	109	106	104	105	103	101	101	100	98	97	96	95	94																			
2	108	103	99	96	106	101	98	95	98	95	93	95	93	91	92	91	89	87																			
3	103	96	91	87	101	95	90	87	92	88	85	90	87	84	88	85	83	81																			
4	97	90	84	80	96	89	84	80	87	82	79	85	81	78	83	80	77	76																			
5	93	84	78	74	91	83	78	74	82	77	73	80	76	73	78	75	72	70																			
6	88	79	73	69	86	78	73	69	77	72	68	75	71	68	74	70	67	66																			
7	84	74	68	64	82	74	68	64	72	67	64	71	67	63	70	66	63	62																			
8	80	70	64	60	78	69	64	60	68	63	60	67	63	59	66	62	59	58																			
9	76	66	60	56	75	66	60	56	65	60	56	64	59	56	63	59	56	54																			
10	72	63	57	53	71	62	57	53	61	56	53	61	56	53	60	56	52	51																			

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P203845

CATALOG NUMBER: LE\_6B15D010 EC6B10209024 6LBNGPH1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	73.3	11.0
10°-20°	180.8	27.1
20°-30°	219.1	32.9
30°-40°	149.3	22.4
40°-50°	35.6	5.3
50°-60°	5.5	0.8
60°-70°	2.0	0.3
70°-80°	0.6	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	473.2	71.0
0°-40°	622.4	93.4
0°-60°	663.5	99.6
0°-90°	666.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	666.2	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	810	
5°	787	73
15°	647	181
25°	479	219
35°	238	149
45°	38	36
55°	6	6
65°	2	2
75°	0	1
85°	0	0
90°	0	



TEST NUMBER: P203845

CATALOG NUMBER: LE\_6B15D010 EC6B10209024 6LBNGPH1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	809.9
2.5°	805.2
5°	787.0
7.5°	762.8
10°	727.8
12.5°	688.2
15°	647.2
17.5°	604.8
20°	562.1
22.5°	519.6
25°	478.6
27.5°	440.6
30°	385.9
32.5°	314.5
35°	238.5
37.5°	170.1
40°	112.4
42.5°	69.9
45°	38.0
47.5°	19.8
50°	10.6
52.5°	7.6
55°	6.1
57.5°	4.5
60°	3.0
62.5°	3.0
65°	1.5
67.5°	1.5
70°	1.5
72.5°	1.5
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)