

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P204994

Luminaire Tested: **LE_6B20D010 EC6B10209027 6LBCS1MMS**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P204994
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LE_6B20D010 EC6B10209027 6LBCS1MMS
Description: PORTFOLIO 6 INCH SHALLOW RECESSED DOWNLIGHT
SHALLOW DISTRIBUTION WITH CAST MATTE METALLIC SILVER TRIM
WATTAGE D010TR-21.86 W DE010-20.46 W D5LT-21.24 W DMX-20.89 W DL2-22.5 W
DL3-21.8 6 W DLE-22.46 W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2151.6 lumens
Efficiency: N/A
Efficacy: 103.4 lumens/watt
Spacing Criteria (0/90/45): 1.16 / 1.16 / 1.27
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 20.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P204994

CATALOG NUMBER: LE_6B20D010 EC6B10209027 6LBCS1MMS

Luminous Intensity Polar Plot

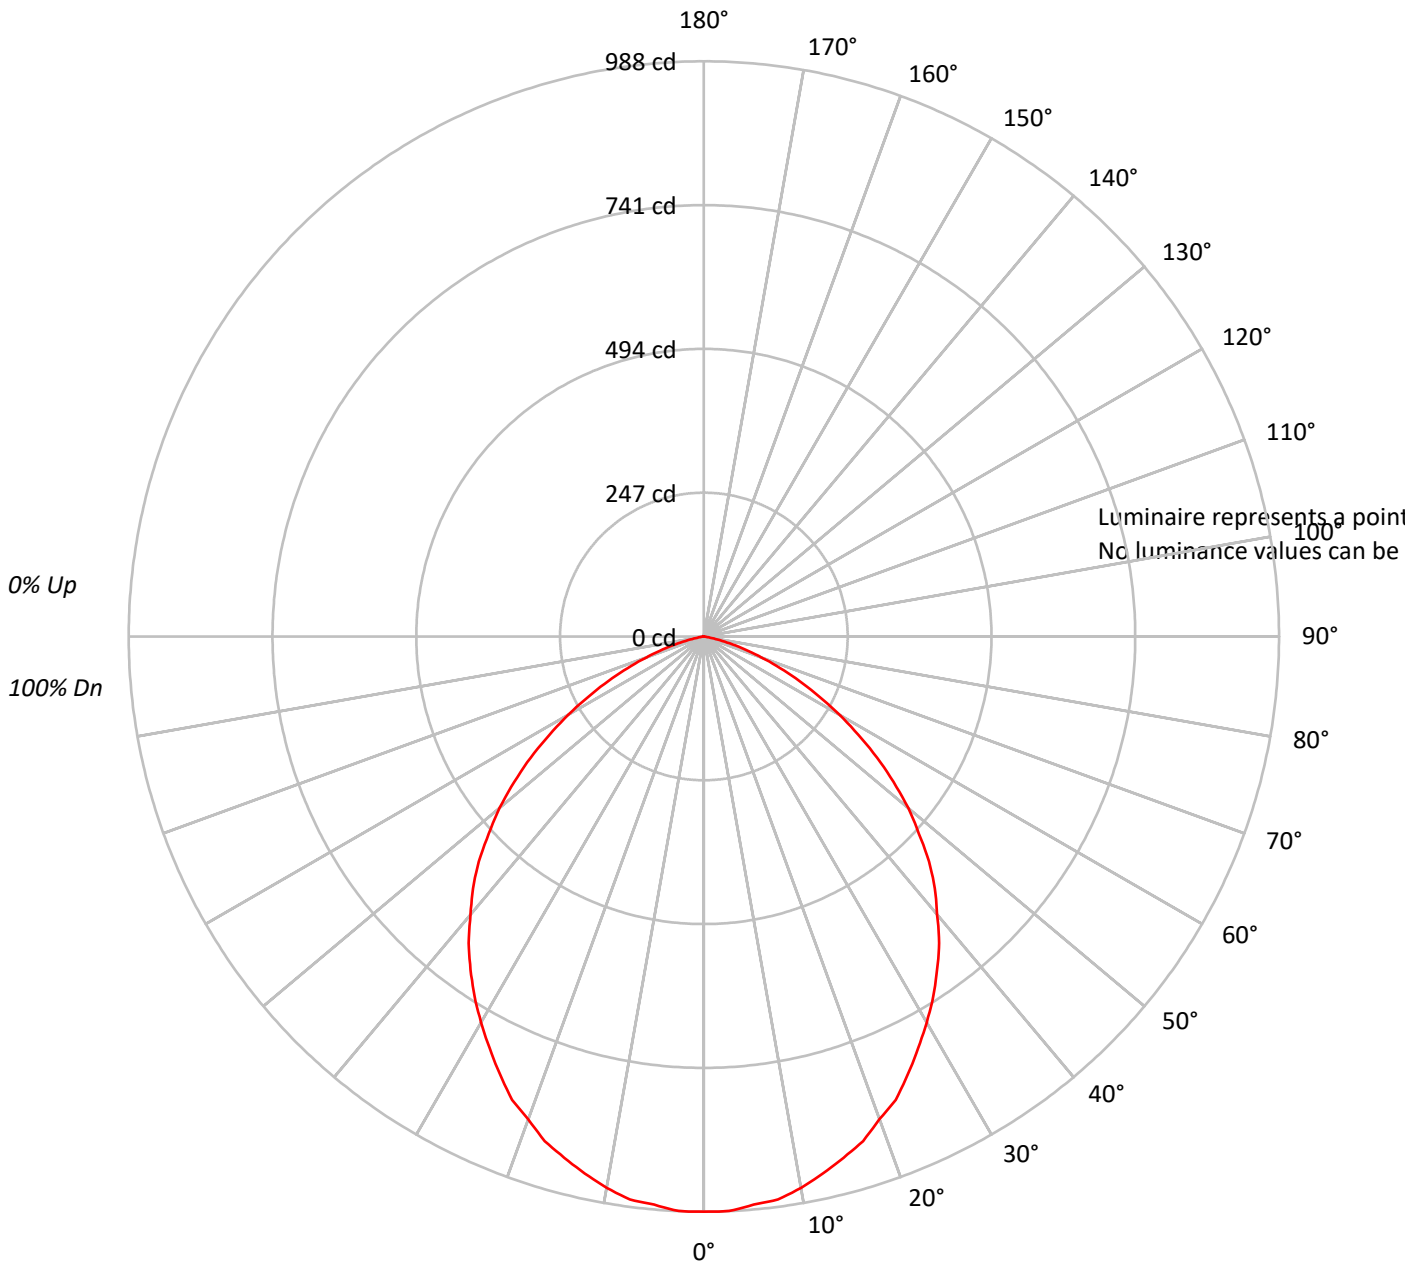



TEST NUMBER: P204994

CATALOG NUMBER: LE_6B20D010 EC6B10209027 6LBCS1MMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	111	107	103	100	108	105	101	98	100	98	95	97	94	92	93	91	90	88																			
2	102	95	89	84	99	93	88	83	90	85	81	86	83	79	83	80	78	76																			
3	94	85	77	72	92	83	76	71	80	74	70	77	73	69	75	71	67	65																			
4	87	76	68	62	84	74	67	61	72	66	61	70	64	60	68	63	59	57																			
5	80	68	60	54	78	67	59	54	65	58	53	63	57	53	61	56	52	50																			
6	74	62	54	48	72	61	53	47	59	52	47	58	51	47	56	51	46	44																			
7	69	56	48	42	67	56	48	42	54	47	42	53	46	42	51	46	41	40																			
8	64	52	44	38	63	51	43	38	50	43	38	48	42	38	47	42	37	36																			
9	60	48	40	35	59	47	40	34	46	39	34	45	39	34	44	38	34	32																			
10	57	44	36	31	55	43	36	31	43	36	31	42	35	31	41	35	31	29																			

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P204994

CATALOG NUMBER: LE_6B20D010 EC6B10209027 6LBCS1MMS

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	93.1	4.3
10°-20°	261.3	12.1
20°-30°	381.6	17.7
30°-40°	436.5	20.3
40°-50°	419.5	19.5
50°-60°	323.9	15.1
60°-70°	180.8	8.4
70°-80°	52.6	2.4
80°-90°	2.3	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	736.0	34.2
0°-40°	1172.5	54.5
0°-60°	1915.9	89.0
0°-90°	2151.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2151.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	988	
5°	980	93
15°	927	261
25°	829	382
35°	699	436
45°	547	419
55°	363	324
65°	181	181
75°	46	53
85°	1	2
90°	0	



TEST NUMBER: P204994

CATALOG NUMBER: LE_6B20D010 EC6B10209027 6LBCS1MMS

CANDELA DISTRIBUTION (FULL):

	0°
0°	988.0
2.5°	988.0
5°	979.8
7.5°	975.5
10°	961.6
12.5°	944.9
15°	926.9
17.5°	908.8
20°	882.2
22.5°	861.4
25°	829.4
27.5°	797.4
30°	765.4
32.5°	733.4
35°	698.6
37.5°	663.8
40°	623.5
42.5°	587.2
45°	546.9
47.5°	501.0
50°	457.9
52.5°	410.5
55°	363.2
57.5°	314.5
60°	268.6
62.5°	222.6
65°	180.9
67.5°	142.0
70°	105.8
72.5°	73.8
75°	45.9
77.5°	23.6
80°	8.4
82.5°	2.8
85°	1.4
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)