

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P205090

Luminaire Tested: **LE\_6B20D010 EC6B10208030 6LBMLI1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P205090  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LE\_6B20D010 EC6B10208030 6LBML1  
Description: PORTFOLIO 6 INCH 50 DEGREE CUTOFF RECESSED DOWNLIGHT  
MEDIUM DISTRIBUTION WITH SPECULAR CLEAR TRIM  
WATTAGE D010TR-21.86 W DE010-20.46 W D5LT-21.24 W DMX-20.89 W DL2-22.5 W  
DL3-21.8 6 W DLE-22.46 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 2279.6 lumens  
Efficiency: N/A  
Efficacy: 109.6 lumens/watt  
Spacing Criteria (0/90/45): 0.85 / 0.85 / 0.85  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 20.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P205090

CATALOG NUMBER: LE\_6B20D010 EC6B10208030 6LBMLI1

### Luminous Intensity Polar Plot

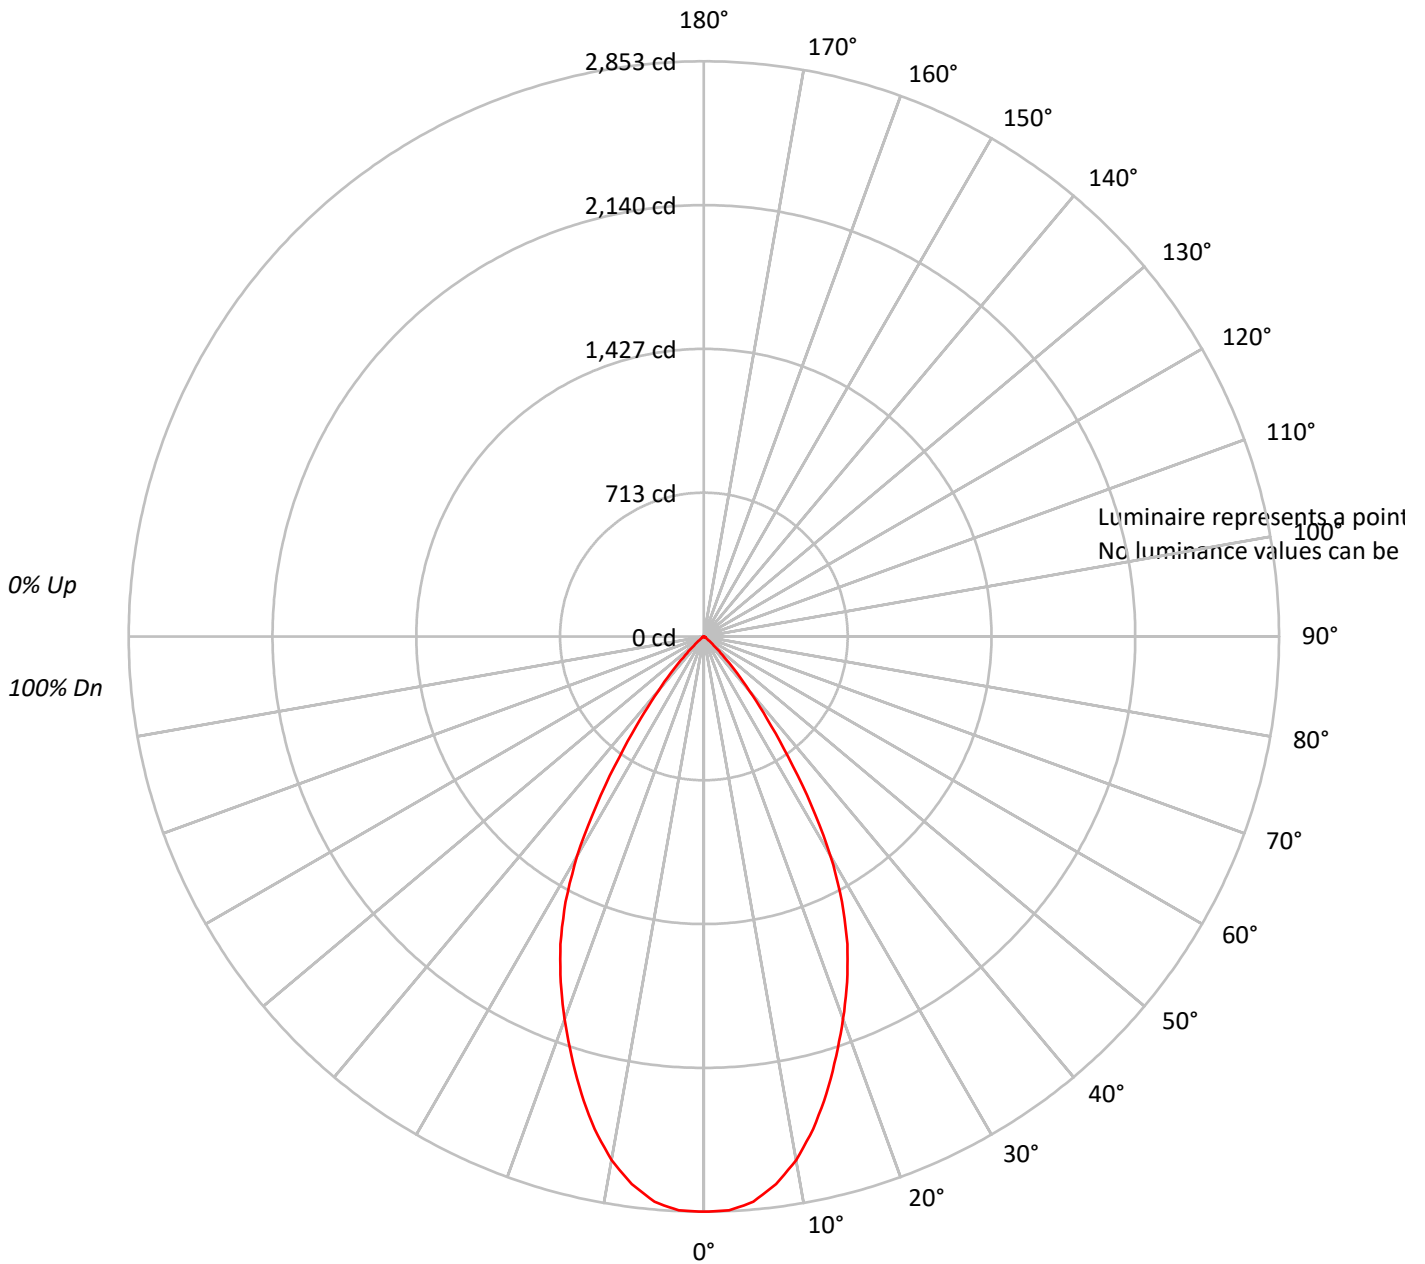



TEST NUMBER: P205090

CATALOG NUMBER: LE\_6B20D010 EC6B10208030 6LBMLI1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	114	111	109	106	111	109	107	105	105	103	101	101	100	98	98	97	96	94																			
2	108	103	100	96	106	102	98	95	99	96	93	96	93	91	93	91	89	88																			
3	103	97	92	88	101	95	91	87	93	89	86	90	87	85	88	85	83	82																			
4	98	91	85	81	96	89	84	81	87	83	80	85	82	79	83	80	78	76																			
5	93	85	79	75	91	84	79	75	82	78	74	81	77	73	79	76	73	71																			
6	89	80	74	70	87	79	74	70	78	73	69	76	72	69	75	71	68	67																			
7	84	75	69	65	83	75	69	65	73	68	65	72	68	64	71	67	64	63																			
8	80	71	65	61	79	70	65	61	69	64	61	68	64	60	67	63	60	59																			
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55																			
10	73	64	58	54	72	63	58	54	62	57	54	62	57	54	61	57	54	52																			

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P205090

CATALOG NUMBER: LE\_6B20D010 EC6B10208030 6LBMLI1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	262.8	11.5
10°-20°	654.3	28.7
20°-30°	760.6	33.4
30°-40°	465.8	20.4
40°-50°	115.7	5.1
50°-60°	13.5	0.6
60°-70°	5.1	0.2
70°-80°	1.9	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1677.7	73.6
0°-40°	2143.4	94.0
0°-60°	2272.6	99.7
0°-90°	2279.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2279.6	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	2853	
5°	2815	263
15°	2348	654
25°	1683	761
35°	729	466
45°	128	116
55°	12	14
65°	6	5
75°	3	2
85°	0	0
90°	0	



TEST NUMBER: P205090

CATALOG NUMBER: LE\_6B20D010 EC6B10208030 6LBMLI1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	2852.8
2.5°	2849.9
5°	2814.9
7.5°	2739.0
10°	2636.9
12.5°	2502.8
15°	2348.1
17.5°	2181.9
20°	2018.5
22.5°	1855.1
25°	1683.1
27.5°	1484.8
30°	1257.2
32.5°	991.8
35°	729.2
37.5°	513.4
40°	350.0
42.5°	218.8
45°	128.4
47.5°	72.9
50°	37.9
52.5°	17.5
55°	11.6
57.5°	8.8
60°	8.8
62.5°	5.9
65°	5.9
67.5°	2.9
70°	2.9
72.5°	2.9
75°	2.9
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)